

Process Manual

Technical guidelines for the insulation of industrial installations



EXCELLENCE
IN FIRESAFE SOLUTIONS


Overview RTI System solutions

1.2 Piping

P. 19


1.2.1 Insulation with pipe sections

P. 26




1.2.2 Insulation with load-bearing mats

P. 28




1.2.3 Insulation with wired mats

P. 30



1.2.4 Insulation Support

P. 32




1.2.5 Cladding

P. 34




1.2.6 Pipe hangers and pipe support

P. 38




1.2.7 Insulation of valves and flanges

P. 38




1.2.8 Insulation of pipe elbows and T pieces

P. 41




1.2.9 Reducers

P. 42




1.2.10 Expansion joints

P. 43




1.2.11 Tracing

P. 44




1.2.12 Foot traffic

P. 45




1.3 Insulation of vessels

P. 46

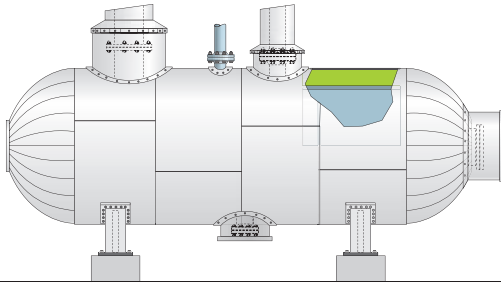


1.4 Insulation of columns

P. 52

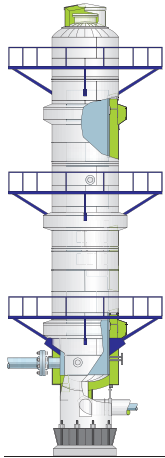

1.5 Insulation of storage tanks

P. 58

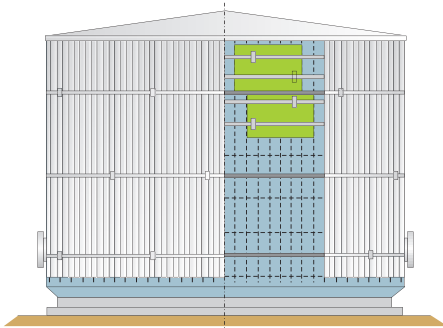


1.6 Boiler

P. 68


1.6.1 Insulation of boilers

P. 68

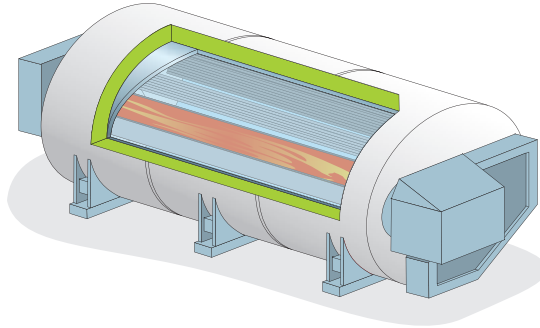


1.6.2 Supercritical steam generators

P. 71



1.7 Insulation of flue gas ducts

P. 77

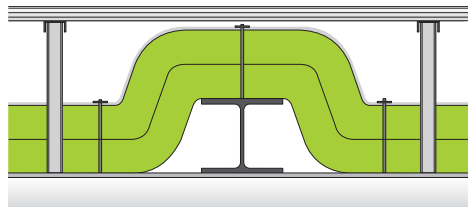

1.8 Cold boxes

P. 85

Contents

1	System solutions	5
	1.1 Planning and preparation	7
	1.2 Insulation of piping	19
	1.3 Insulation of vessels	46
	1.4 Insulation of columns	52
	1.5 Insulation of storage tanks	58
	1.6 Insulation of boilers	68
	1.7 Insulation of flue gas ducts	77
	1.8 Cold boxes	85
2	Theory	89
	2.1 Norms & standards	90
	2.2 Product properties & test methods	110
	2.3 Bases for thermal calculations	122
3	Tables	129
	3.1 Units, conversion factors and tables	130
	3.2 Product properties insulation and cladding materials	142
	3.3 Usage tables	145
4	Products	163
	Rockwool 850	165
	Rockwool 851	166
	ProRox WM 70	168
	ProRox WM 80	170
	ProRox WM 100	172
	Rockwool Duraflex	174
	Rockwool Flexiboard	176
	Rockwool Multiboard	178
	Rockwool HT600	180
	Rockwool HT660	182
	Rockwool HT700	184
	Rockwool CRS	186
	Rockwool 251	188
	Rockwool Rocktight	190
	Rockwool Loose fill	193
	Rockwool Granulate	194



RTI, Excellence in Firesafe Solutions

As an independent organisation within the international Rockwool group, Rockwool Technical Insulation (RTI) is *the* specialist in technical insulation, passive fire safety and marine insulation. In addition to providing a complete range of stone wool products for the insulation of industrial plants and technical installations in buildings and ships, RTI offers an extensive range of system solutions for preventive fire protection. With its excellent products, ongoing innovation and qualified employees, RTI is a reliable and expert partner which sets new standards. Rockwool has been successfully meeting the challenges of the market with entrepreneurial creativity and technical innovative strength for over 60 years now, which is reflected in its range of high quality product and system solutions.

Dear customer,

Rockwool Technical Insulation (RTI) is a known entity in the insulation market. Specialists such as yourself often willingly turn to our products and expertise in technical insulation, passive fire protection and marine insulation. We have now packaged some of that expertise into a new practical guide: the 'Industrial Insulation Process Manual'.

The new manual is a handy and compact instrument which is very convenient to consult. Fold-out sections take you straight to the right page, whether you are looking for straightforward piping insulation or for more complex applications for columns, tanks and boilers. In addition to the many pictures and photographs, a whole range of tables and diagrams clarify the information provided.



Keep this manual close by. It is a handy tool for the application of our insulation solutions in a process environment. Should you have any further questions about a specific application, procedure or practical problems, please don't hesitate to contact one of the RTI sales team:

for **the Netherlands:** +31 (0) 475 35 36 18

for **Belgium:** +32 (0) 2 715 68 20

for **Germany:** +49 (0) 2043 408 606

for **France:** +33 (0) 1 40 77 82 11

for **Export (Africa, Middle East, India,...):** +31 (0) 475 35 38 35

for **Poland:** +48 601 848 482

for **Czech Republic:** +420 606 702 056

for **Slovakia:** +421 903 235 027

for **Baltics:** +370 69 94 33 92

for **Switzerland:** +41 81 734 11 11


Please consult our website: www.rockwool-rti.com

Best regards

Frank Jacobs
Managing Director
Rockwool Technical Insulation Group



EXCELLENCE
IN FIRESAFE SOLUTIONS

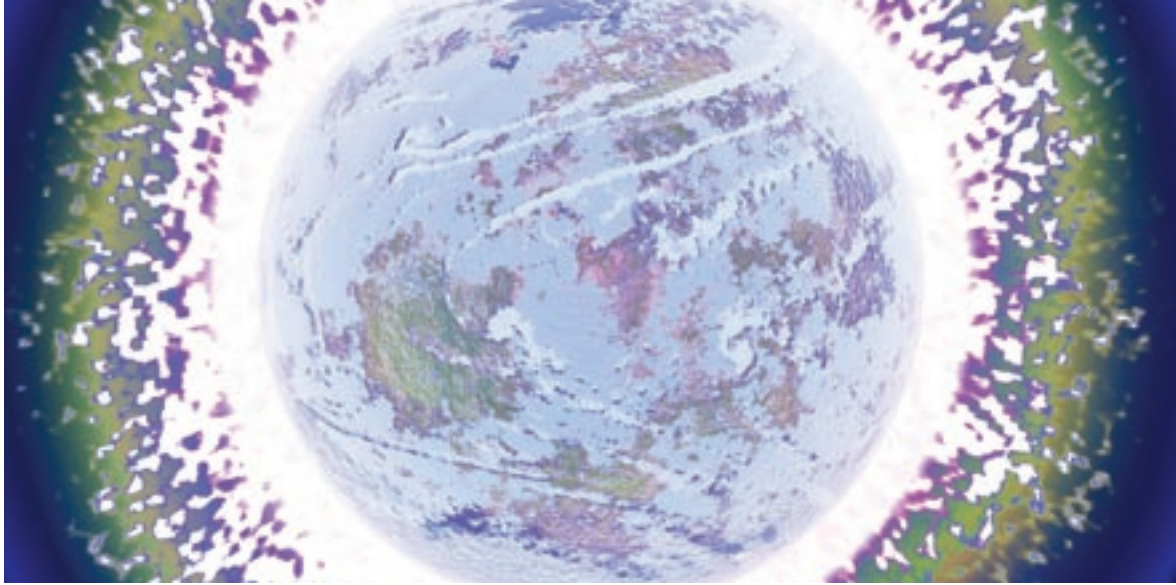

The Rockwool Technical Insulation Process Manual

Know-how for designers, site supervisors and managers of industrial plants

Energy keeps the world in motion. Without energy, everything would come to a standstill. The global economy is dependent upon a secure, efficient supply of energy. Over eighty percent of the energy currently being consumed however is obtained from non-renewable resources. Energy resources are becoming increasingly scarce, whilst at the same time the demand for energy is exploding. This means that owners, designers and operators of large, industrial plants are challenged with the task of reducing their energy consumption as much as possible in order to ensure the long term sustainability of their operations.

The time for making excuses for poor energy efficiency is past, because nowadays there are a great many efficient insulation systems that enable scarce energy reserves to be put to the best possible use. The Rockwool Technical Insulation Process Manual illustrates these systems both theoretically and practically.

The process manual is aimed at designers, installers and managers of industrial plants and provides an

overview of the possible modern insulation techniques for, by way of example, chemical or petrochemical installations and power stations. Based on current standards and regulations the manual provides accessible, practical guidelines for the implementation of numerous insulation applications.

Restriction of thermal losses to an absolute minimum, including during transfer or storage, can considerably reduce the energy consumption of industrial plants. This also results in a reduction in carbon dioxide (CO₂) emissions, which are created each time fossil fuels such as coal or gas are burnt and which, as a greenhouse gas, is responsible for the global increase in temperature.

From an environmental perspective, adequate insulation of industrial plants is a significant means of reducing (CO₂) emissions. This measure pays off in two ways, because within the framework of the EU Emission Trading Scheme, CO₂ reduction equally signifies a reduction in emission costs.



In addition, the right insulation keeps temperatures, for example in pipes and storage tanks, within strict tolerances, thereby ensuring reliable process efficiency. At the same time, adequate insulation protects the plant itself. Modern insulating materials can thoroughly protect plant components from moisture and associated corrosion. Installation and process maintenance costs can be reduced considerably and the effective lifetime of industrial plants can be successfully maximised.


Furthermore, industrial insulation also provides a significant contribution to personal protection. Optimum insulation reduces process temperatures and noise in the industrial environment to an acceptable level, to the limits generally regarded in the industry to be those required for a safe and comfortable working environment.

With a complete range of techniques and insulation systems, Rockwool Technical Insulation (RTI) offers designers and construction supervisors optimum tailored solutions for the petrochemical, energy, ship building and processing industries.

In the “Flow of Energy” diagram on the following page, you will find an overview of all of the sectors in which Rockwool is active. All of RTI’s products, such as pipe sections, slabs, wired mats and lamella mats, as well as loose insulating wool, fulfil the highest quality and safety standards and comply with the strictest, and therefore safest, fire safety classes. Stone wool is non flammable up to temperatures of approximately 1,000 °C and therefore provides a crucial contribution towards passive fire protection.

As a supplement to this process manual, RTI also regularly makes information about technical innovations, product solutions and recent and relevant documents available online at www.rockwool-rti.com. The process manual is a guideline and can only provide general advice for specific instances in the field of plant and processes. For these instances, RTI’s insulation experts are available to provide advice during the design, engineering and implementation phases. Please find our contact details on the back cover of this manual.

RTI, Flow Of Energy

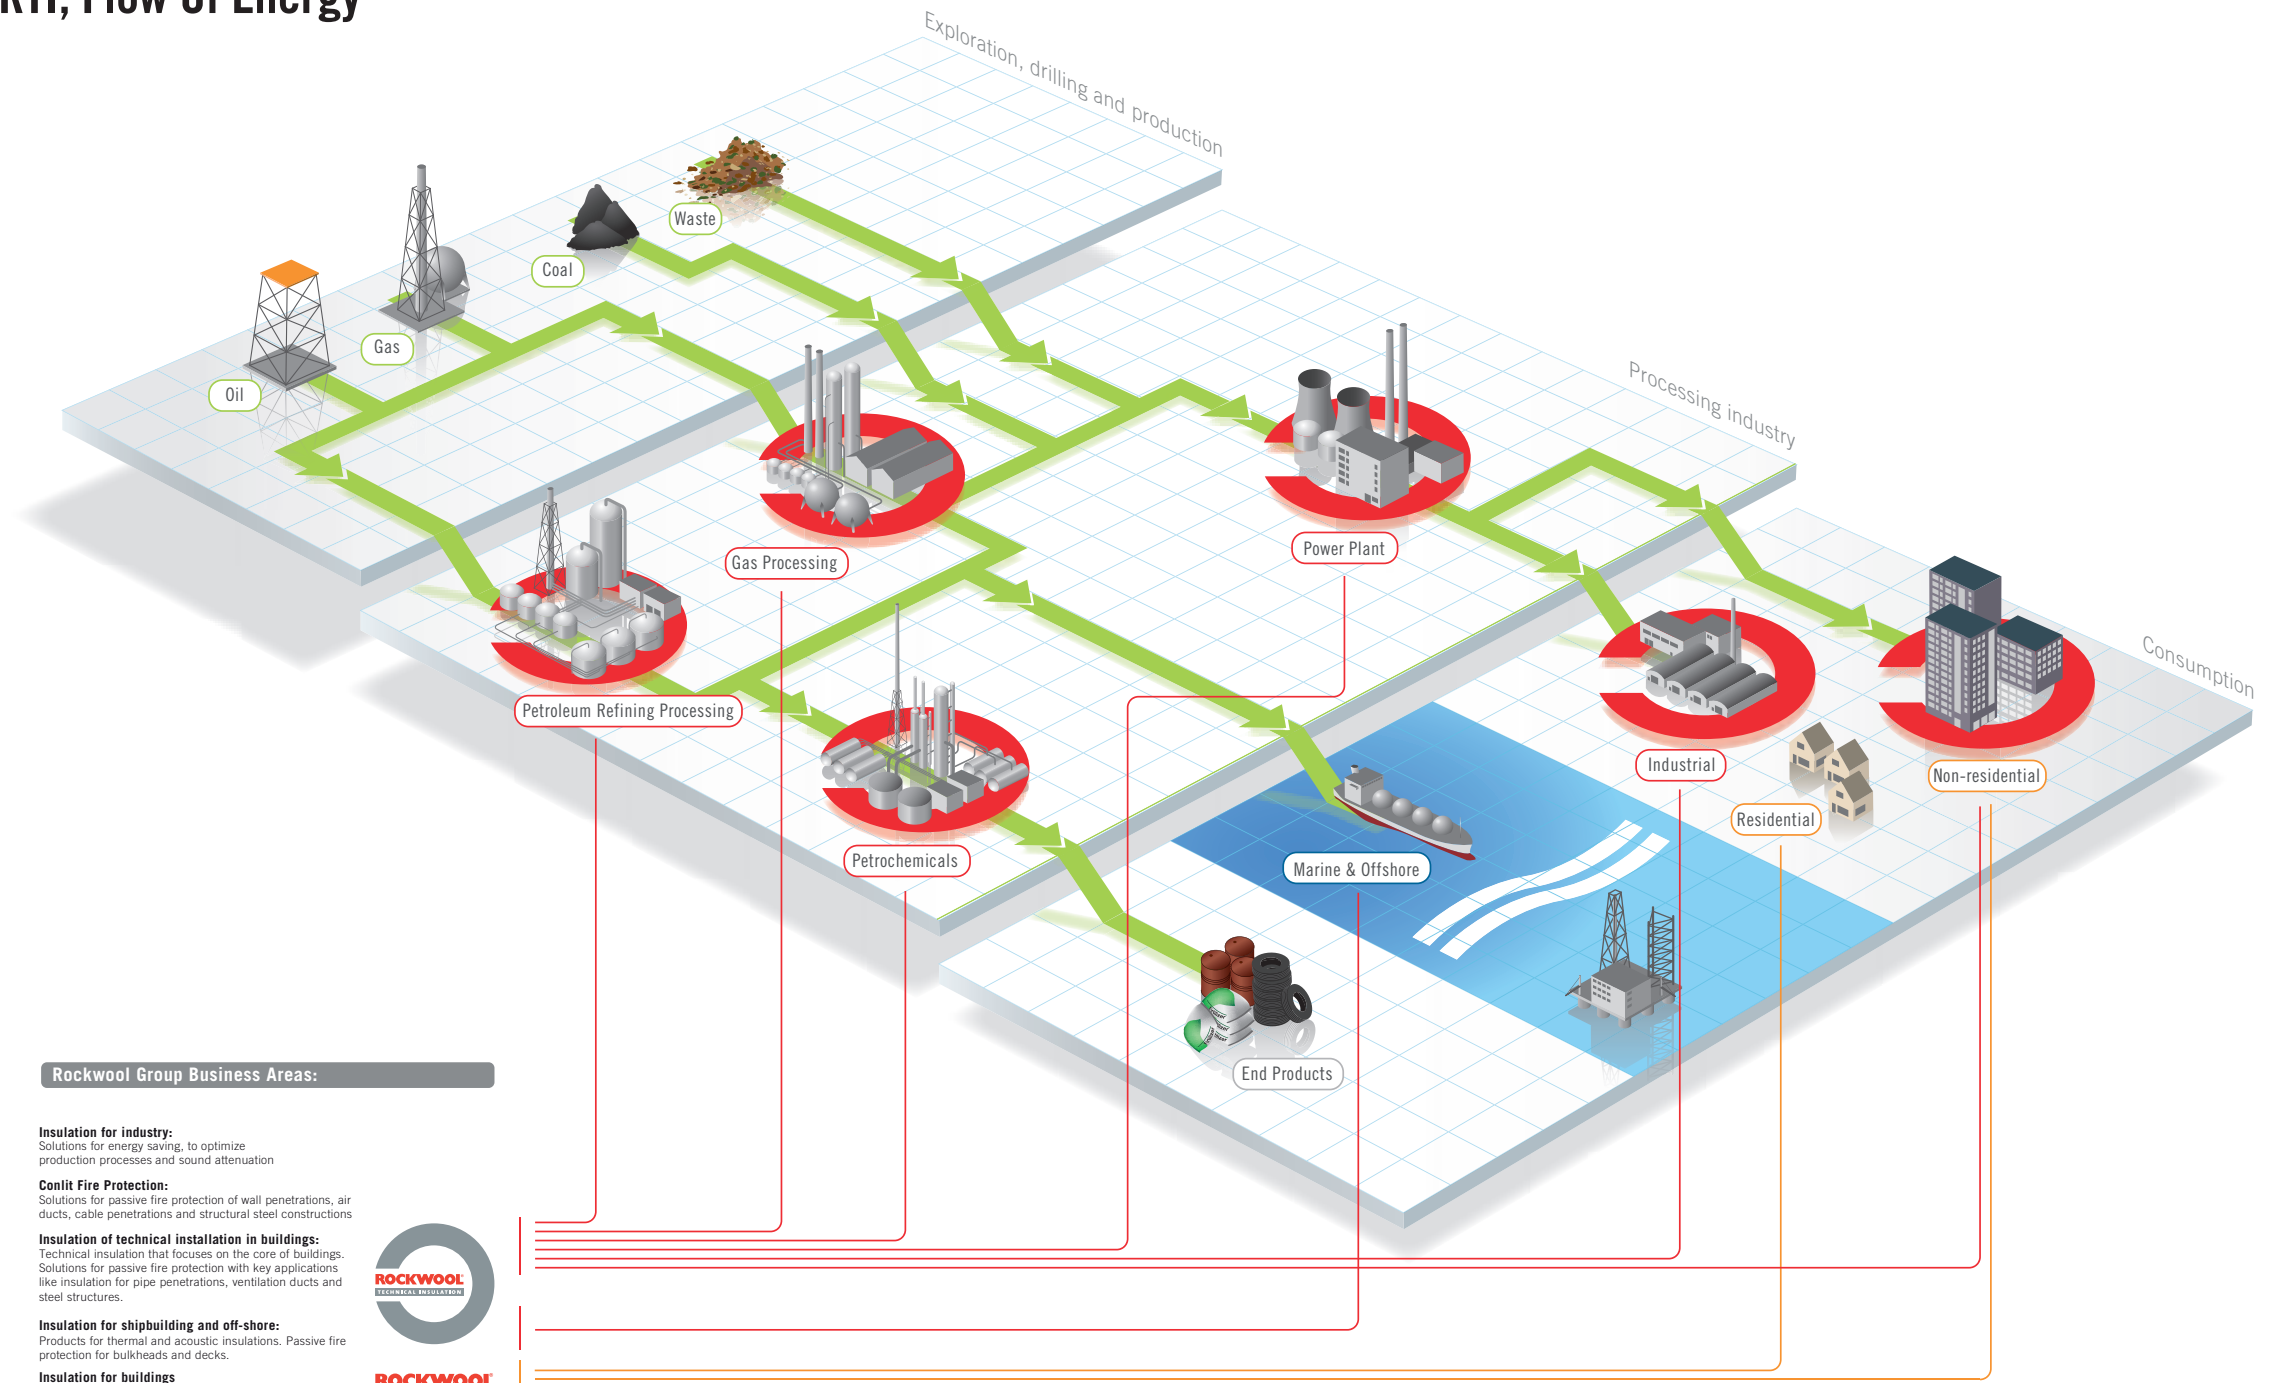

Rockwool Group Business Areas:

Insulation for industry:

Solutions for energy saving, to optimize production processes and sound attenuation

Conlit Fire Protection:

Solutions for passive fire protection of wall penetrations, air ducts, cable penetrations and structural steel constructions

Insulation of technical installation in buildings:

Technical insulation that focuses on the core of buildings. Solutions for passive fire protection with key applications like insulation for pipe penetrations, ventilation ducts and steel structures.

Insulation for shipbuilding and off-shore:

Products for thermal and acoustic insulations. Passive fire protection for bulkheads and decks.

Insulation for buildings (residential, commercial, public, industry)

Thermal and acoustic insulations.



ROCKWOOL



1. System solutions

Table of contents

1.1	Planning and preparation	7
1.1.1	Decision criteria for the design of an insulation system	7
	A. Functional requirements	8
	B. Safety aspects	12
	C. Economics	13
	D. Environmental	14
	E. Corrosion prevention	14
1.1.2	Design & planning of the insulation work	15
1.1.3	Corrosion prevention	15
1.1.4	Storage of insulation materials	18
1.2	Insulation of piping	19
1.2.1	Insulation with pipe sections	26
1.2.2	Insulation with load-bearing mats	28
1.2.3	Insulation with wired mats	30
1.2.4	Insulation support	32
1.2.5	Cladding	34
1.2.6	Pipe hangers and pipe supports	38
1.2.7	Insulation of valves and flanges	39
1.2.8	Insulation of pipe elbows and T pieces	41
1.2.9	Reducers	42
1.2.10	Expansion joints	43
1.2.11	Tracing	44
1.2.12	Foot traffic	45
1.3	Insulation of vessels	46
1.4	Insulation of columns	52
1.5	Insulation of storage tanks	58
1.6	Insulation of boilers	68
1.6.1	Insulation of fire tube boilers	68
1.6.2	Supercritical steam generators	71
1.7	Insulation of flue gas ducts	77
1.7.1	Installation of the insulation systems for flue gas ducts	77
1.7.2	Cladding of flue gas ducts	81
1.7.3	Acoustic insulation of flue gas ducts	84
1.8	Cold boxes	85

1. System solutions

1.1 Planning and preparation

The design of a suitable insulation system for technical installations is a major factor for its economical operation, functionality, security, durability and environmental impact. Additionally, the installation-specific heat losses are specified for the entire life cycle of the plant. Corrections at a later stage, such as subsequently increasing the thickness of the insulation, for example, may no longer be possible due to lack of space. Corrections at a later stage may also entail a far greater investment compared to the original planning. Continually rising energy costs are also often overlooked factors when dimensioning the insulation. Insulation thicknesses that are designed to last take energy price increases into account. They form an important criterion for the economical operation of the installation after just a few years.

We have an obligation to future generations to treat our environment with care. Correctly dimensioned insulation systems constitute an important contribution to environmental protection, carbon dioxide (CO₂) reduction and to economic success, because: CO₂ reduction is also an economical operation, as it lowers the costs for CO₂ emission certificates. Nowadays, conservational and economical operations are no longer conflicting ideas, but on the contrary, they are two inseparable parameters.

1.1.1. Decision criteria for the design of an insulation system

Selecting a suitable insulation system depends on the following four parameters:

- **A. Functional requirements**
 - a. Object dimensions
 - b. Method of operating the installation
 - c. Operating temperatures
 - d. Permissible heat losses or temperature changes of the medium
 - e. Frost protection
 - f. Ambient conditions
 - g. Maintenance and inspection
- **B. Safety aspects**
 - a. Personal protection
 - b. Fire protection
 - c. Explosion prevention
 - d. Noise reduction within the plant
- **C. Economics**
 - a. Economical insulation thickness
 - b. Pay-back time
- **D. Environment**
- **E. Corrosion prevention**


1.1 Planning and preparation

A. Functional requirements


a) Object dimensions

The space requirements of the insulation must be taken into account when the installation is being designed and planned. Therefore, the insulation thicknesses should be determined in the early planning stages and the distances between the individual objects should be taken into account in the piping isometrics. To guarantee systematic installation of the insulation materials and the cladding without increased expense, observe the minimum distances between the objects as specified in the following illustrations.


Minimum distances between vessels and columns (dimensions in mm)

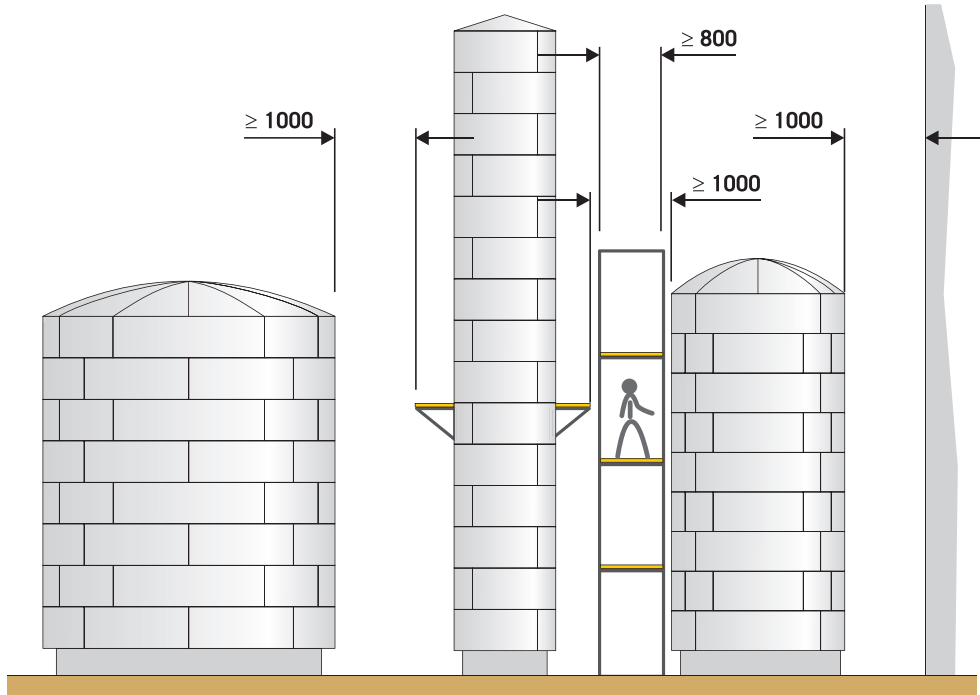

Minimum distances between insulated pipes (dimensions in mm)

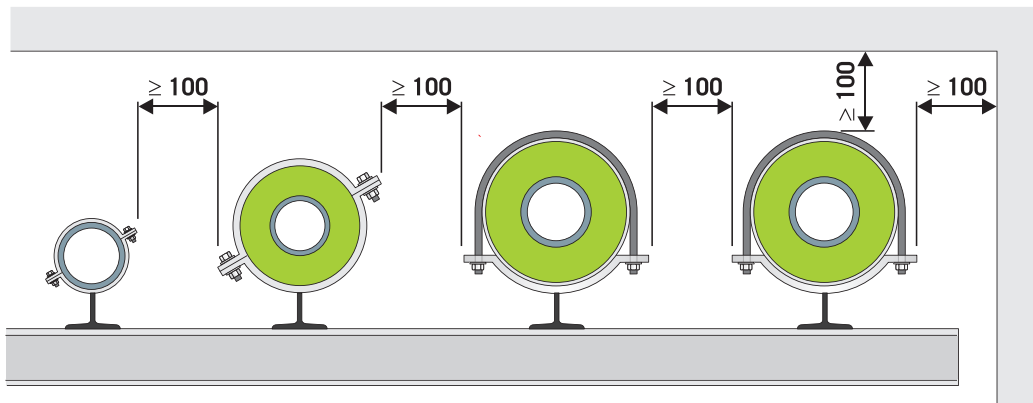

Minimum distances within range of pipe flanges (dimensions in mm)

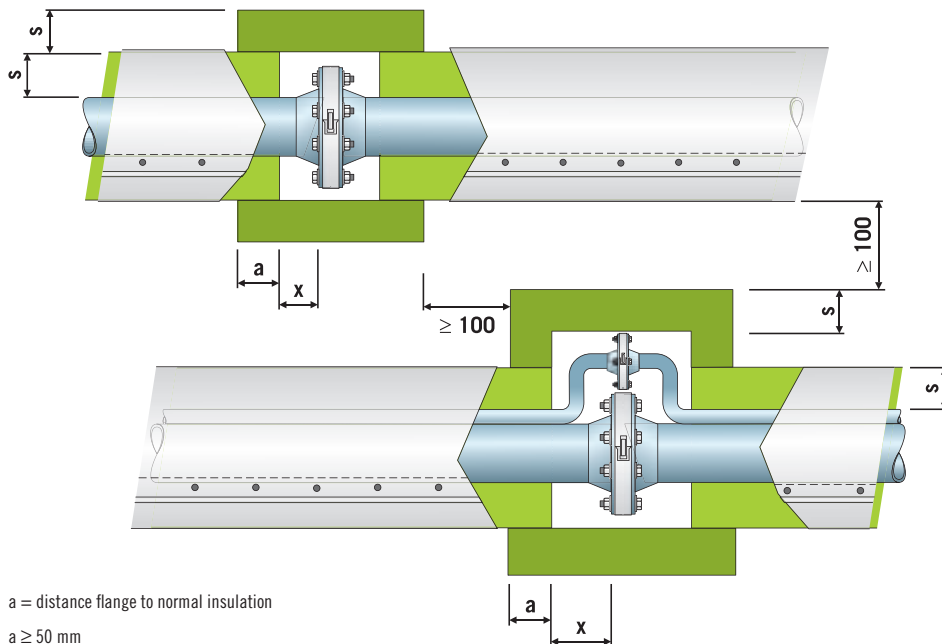

a = distance flange to normal insulation

$a \geq 50$ mm

x = bolt length + 30 mm

s = insulation thickness

1.1 Planning and preparation

A. Functional requirements

b) Operation of the installation

To select a suitable insulation system, the operating method of the installation must be considered. A basic distinction is made between continuous and interrupted operation. With continuous operation, the operating temperatures are constantly above or constantly below the ambient temperatures. The interrupted operating method, also referred to as intermittent or batch operation, is characterised by the fact that the installation is switched off between each operating phase and during that time can assume ambient temperatures. For special applications, so called dual temperature systems, the operating temperature alternates between above or below the ambient temperature.

c) Operating temperature

The appropriate insulation material should be resistant to the intended operating/peak temperatures. This product property is assessed by the maximum service temperature (also see Chapter 2.3 “Product properties”).

d) Permissible heat losses or temperature changes of the medium

With many technical processes, it is essential that media in vessels, columns or tanks do not fall below a specific lower temperature limit, otherwise chemical processes will not proceed as intended or the media will set and can no longer be pumped or extracted. Over-cooling can lead to the precipitation of, for example, sulphuric acid in exhaust and flue gas streams, which furthers corrosion in the pipes or channels.

With flowing media, it is essential to ensure that the temperature of the medium is still at the desired level at the end of the pipe. The thermal insulation is designed

according to these requirements. Under extreme conditions (for example, lengthy periods of storage, long transport routes or extreme temperatures), installing tracing may be necessary, to ensure that the media is kept within the required temperature limits.

Use “**Rockassist**”, a thermo-technical engineering calculation program, to ensure the optimum engineering and design of these insulations. Please visit www.rockassist.com or the rockwool-rti.com website for consulting the Rockassist program on line.



Inside buildings, uninsulated or poorly insulated parts of installations can heat the room climate unnecessarily. This leads to higher room temperatures, which can have a negative effect on the working environment - both for the people who work long hours under these conditions and for the electronic components. In addition to the increased heat losses, further energy consumption is required to air condition the rooms. The design of the insulation and the related reductions in terms of heat losses from parts of installations should be relevant to the entire infrastructure and use of the building.

e) Frost protection

Installations that are situated outside are at risk from frost in the winter. In addition to the undesirable malfunctioning of installations, installations also risk damage caused by the expansion of frozen water. Adequate measures – so called frost protection - must be taken to protect the installation from freezing. Insulation can reduce heat losses and postpone the moment at which the installation freezes. Insulation alone, however, cannot indefinitely prevent the installation from freezing. Installing additional tracing may be necessary between the object and the insulation. To prevent freezing, the insulation must be designed so that the density of heat flow rate of the insulated object is less than the heat conducted by the tracing.



f) Ambient conditions

Select an insulation system that offers long-lasting resistance to the surrounding environment.

- Atmospheric influences: wind, rain
- Mechanical loads such as vibrations or foot traffic
- Corrosive environment (close to the sea, chemicals,...)

Prevent the ingress of moisture into the insulation system. Moisture accumulation in insulation increases

thermal conductivity and the risk of corrosion of the insulated installation components.

Cladding must be installed to prevent the ingress of moisture into the system. However, with installations situated outside with operating temperatures $< 120\text{ }^{\circ}\text{C}$ or with installations operating intermittently, there is a high risk of moisture accumulation. This is caused by moisture condensing from the ambient air inside the cladding.

For this reason, retain an air space of at least 15 mm between the insulation and the cladding. In addition, drainage and ventilation holes of minimum 10 mm diameter and at intervals of maximum 300 mm should be provided on the underside or at the lowest point of the cladding. If necessary, the insulation and cladding must resist chemical influences that develop within the environment.

g) Maintenance and inspection

To avoid complicating routine maintenance and inspection work unnecessarily with the insulation, maintenance-intensive areas must be taken into account, especially when designing the insulation work. Removable insulation systems, such as removable coverings and hoods, could be fitted in such areas, for example. Easily removable covering systems are also recommended for flanges and pipe fittings. These coverings are generally fastened with quick-release clamps, which can be opened without special tools. The insulation of fixtures such as flanges or pipe fittings must be interrupted at a sufficient distance to allow installation or dismantling to be carried out. In this case, take the bolt length at flange connections into consideration. The connection of the insulation should have an extremity and any fixtures in the range of the insulation, including the interruption in the installation, should be insulated with removable coverings.

1.1 Planning and preparation



B. Safety aspects

a) Personal protection

Surface temperatures in excess of 60 °C can lead to skin burns, if the surface is touched. Therefore, all accessible installation components should be designed to prevent people being exposed to the risk of injury by burns. The insulation applied to such plant components must ensure that surface temperatures in excess of 60 °C do not occur during operation. Use the Rockwool Thermo-technical engineering program “Rockassist” to calculate the required insulation thickness. All of the operational parameters must be known to achieve a reliable design, including, for example, the temperature of the object, the ambient temperature, air movement, surface materials, distance from other objects, etc.

Note

As the surface temperature depends on a set of physical parameters, which cannot always be calculated or estimated with any degree of certainty, the surface temperature is not a guaranteed measurement. Also refer to Technical Letter No. 5 of the German BFA WKSb “The problem of guaranteeing surface temperatures”.

If the required protection (temperature) cannot be

achieved by insulation, apply additional protective devices, such as safety guards or enclosure of the object.

b) Fire protection

The general fire protection requirements imposed on structural installations are usually defined within the local Building Codes or the specifications of plant owner. Structural installations must be designed, built, modified and maintained to prevent the outbreak of a fire and the spread of fire and smoke. In the event of a fire, the rescuing of people and animals and effectively extinguishing the fire must be made possible. During the design of the installation, it is vital to determine the nature and scope of the fire prevention measures together with the building supervisory board, the fire brigade, insurance companies and the operator.

As a basic principle, consider the fact that the fire load in a building or technical installation can be considerably increased by flammable insulation materials. On the other hand, non-flammable insulation materials such as mineral wool, which has a melting point of > 1,000 °C, not only have a positive impact on the fire load, but in the event of a fire, also constitute a certain fire protection for the installation component.

Installation components with tracing, in particular, which use thermal oil as a heat transfer medium, have an increased risk of catching fire in the event of a leak. In this case, ensure that the thermal oil cannot penetrate into the insulation material.

c) Explosion prevention

If there is a risk of fire and explosion, the surface temperature of the object and the cladding must be considerably lower than the ignition temperature of the flammable substance and/or gas mixtures. This requirement also applies to thermal bridges, such as

pipe mounting supports, supporting structures and spacers etc.

With regard to insulation systems, explosion protection can only be achieved with a doubleskin covering. A doubleskin covering is a factory made cladding that has been welded or soldered to make it air proof and diffusion-resistant. In addition special (local) explosion regulations must be observed.



In many cases (e.g. the German Guideline ZH 1/200) electro statically charged substances, such as unearthed cladding or non-conductive plastics, are used in explosive areas, “static electricity” must be earthed.

d) Noise protection

The guidelines for noise in the ordinance and workplace are stated in the local regulations and standards. Generally, the level of the guideline values depends on the nature of the activity, such as:

- ARAB (Belgium)
- ARBO (Netherlands)
- Code du travail (France)

The sound propagation of installation components can be reduced using insulation systems. The nature and effect of the sound insulation depend on the frequency and the sound pressure level.


C. Economics

In the industry there are two grades of insulation. The first grade focuses on reducing heat losses and the prevention of injuries to people operating or working nearby the installations. The second grade of insulation, the so called “economical insulation thickness” focuses on significant heat loss reduction and as a result achieving a better return on investment.

a) Economical insulation thickness

Insulation reduces the heat losses from the object. The thicker the insulation, the greater the heat reduction and consequently, the more energy is saved. However, the investment and expenditure, e.g. for depreciation, interest rates and higher maintenance costs also rise if the insulation thickness is increased. At a certain insulation thickness, the sum of the two cost flows reaches a minimum. This value is known as the economical insulation thickness. A qualitative curve of a similar costs function is shown below.

The German VDI guideline 2055 describes in detail various calculation methods used to determine the economical insulation thickness.

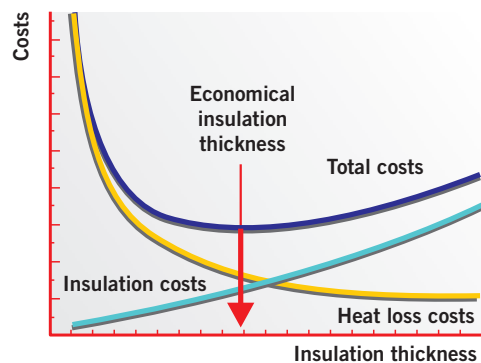

1.1 Planning and preparation

C. Economics

The energy costs cannot be based solely on the current price. Developments over recent years indicate that substantial increases in energy prices are also anticipated for the future. Increasing energy prices are tending to bring about a shift in economic insulation thicknesses towards larger thicknesses.

b) Pay-back time

In addition to the economical insulation thickness, another frequently used economical parameter is the return on investment period (ROI), also referred to as the payback period. This is defined as the period within which the cost of the insulation is recuperated through savings on heat loss costs.

$$\text{ROI period} = \frac{\text{Costs of the insulation}}{\text{annual saving}} \text{ [a]}$$

In the case of technical insulation systems, the return on investment period is generally very short, often being much less than one year. Considering only the return on investment period, however, can be deceptive, as this approach disregards the service life of the installation. With long-life installations, it is advisable to select higher insulation thicknesses, even if this means accepting a longer return on investment period. Throughout the entire service life of the installation however, the increased insulation thickness results in a significantly higher return on the investment in insulation and achieves a much more economic operation of the installation.

D. Environmental

The burning of fossil fuels, such as coal, oil or gas, not only depletes the available primary energy sources, but also, due to the emission of carbon dioxide (CO₂) into the atmosphere, places a burden on the environment.

The increasing CO₂ concentration in the Earth's atmosphere plays a significant part in the global increase in temperature, also referred to as the "greenhouse effect". CO₂ absorbs the thermal radiation emanating from the earth's surface and in doing so reduces the dissipation of heat into space. This will lead to a change in the world's climate with as yet inestimable consequences. Reducing CO₂ emission can only be achieved through more efficient management of fossil fuels.

Increasing the insulation thicknesses is essential for the reduction of CO₂ emissions. Also refer to the Technical Letter No. 6 of the German BFA WKS B "High rate of return on environmentally friendly insulation layer thicknesses".

Reducing CO₂ emissions also has a positive financial benefit for businesses within the context of the EU emissions trading scheme. The benefits of increased



insulation thicknesses in technical installations are twofold, as the costs for both energy consumption and CO₂ emissions are decreased.

E. Corrosion Prevention

See chapter 1.1.3

1.1.2 Design & planning of the insulation work

Requirements with regard to the later insulation works must already be included in the design and construction phase of industrial plants. It is therefore advisable to involve all project managers at an early stage, to preclude unnecessary and unprecedented problems during the insulation works from the outset.

All preparatory works must be completed according to the relevant insulation standards such as DIN 4140, AGI Q05 and the CINI manual. The following preconditions must be fulfilled:

- If necessary, work has been carried out on the object to protect against corrosion
- Tracing and technical measurement equipment have been installed
- The minimum distance between the objects has been observed (see illustrations on pages 8 and 9)
- The surface displays no coarse impurities
- Mounting supports have been installed on the object to accommodate the support structure (For details see Worksheet AGI Q153)
- Collars and sealing discs have been fitted to the object (For details see Worksheet AGI Q152)
- Taps on the object are long enough to ensure that flanges lie outside the insulation and can be screwed on without hindrance
- Supports are designed so that insulation, water vapour retarders and cladding can be professionally installed
- The insulation can be applied without any obstacles (e.g. by scaffolding)
- Welding and bonding work has been carried out on the object
- The foundations have been completed

1.1.3 Corrosion prevention

National economies are damaged to a great extent due to the lack of, or inadequate forms of, protection against corrosion. This considerably reduces the service life of industrial plants, and more frequently, essential shutdown or overhaul work impairs the efficiency of the installation.

It is commonly, but wrongly, assumed that the insulation system also protects an installation against corrosion. For each installation it must be determined whether protection against corrosion is required and, if so, which are the appropriate measures.

Generally, the design of the insulation system & corrosion protection will depend on the following parameters.

- Operation of the installation
 - Continuous operation
 - Interrupted/intermittent operation
 - Operation involving varying temperatures
- Operating temperatures of the installation
- Metals used
 - Non-alloy or low-alloy steel
 - Austenitic stainless steel
 - Copper
- External influences upon the installation
 - Internal/external
 - Environment of the installation (chemically aggressive?)

The best practices may vary per country and/or standard. The design of the corrosion protection is often carried out in accordance with [EN ISO 12944-1 to 7](#) "Coating materials – Protection against the corrosion of steelwork by means of coating systems". However, since this standard does not adequately take into account the specific features of protecting against corrosion in insulation systems, the requirements of

1.1 Planning and preparation

1.1.3 Corrosion prevention

AGI Q151 "Protection against corrosion in the case of hot and cold insulation in industrial plants" must also be considered.

DIN 4140

DIN 4140 states the following advice relating to protection against corrosion:

- In the case of cold insulation, if the object is made of non-alloy or low alloy steel, it must be protected against corrosion.
- In the case of objects made, for example, of austenitic stainless steel or copper, the installation must be tested in each individual case by the planner to determine whether protection against corrosion is necessary.
- Objects made from austenitic stainless steel do not require protection against corrosion if the temperature never – even for a short period – exceeds 50 °C

Note

Protection against corrosion should be applied in the case of all installations made from non-alloy or low-alloy steel where the operating temperatures are below 120 °C. Protection against corrosion may be omitted in the case of:

- Installations operating continuously under extremely cold conditions (below -50 °C) such storage tanks, as well as
- Insulated surfaces of power plant components, such as boiler pressure components, flue gas and hot air ducts and steam pipe systems with operating temperatures that are constantly above 120 °C.

CINI Manual "Insulation for industries"

CINI recommends applying corrosion protection prior to the insulation work at any time.

- In all phases, pay attention to CUI (corrosion under insulation) prevention: design, construction, paint & coating work, application of the insulation system, inspection and maintenance. Equipment and piping sections like nozzles and supports etc. should be designed and maintained to prevent ingress of water into the insulation system.
- The "paint" specifications are split up into:
 - Construction material (carbon steel, stainless steel)
 - Temperature ranges from minus 30 °C to 540 °C) with special attention to the temperature range between -20 °C and 150 °C.
- The corrosion protection can be achieved using aluminium foil wrapping, thermal sprayed aluminium (so called TSA) or paint.

Protection against corrosion may be omitted in the case of installations operating continuously under extremely cold conditions (< -30 °C)

Application

Before applying the corrosion protection coating with the most layers, the surface must be free from grease, dust and acid and, for better adhesion, the priming coat should be roughened. Blasting is recommended as a surface preparation method (with austenitic stainless steel, use a ferrite free blasting abrasive).

Observe the corresponding processing guidelines of the coating manufacturer. If metals with different electrochemical potentials, such as aluminium and copper, come into contact with one another, there is a risk of electrochemical corrosion. If necessary, this can be avoided using insulating, intermediate layers such as non-metallic straps. The presence of moisture will increase the development of electrochemical corrosion.

The table further on this page, which has been derived from the standard DIN 4140, indicates the initial risks of electrochemical corrosion in cases where various combinations of metals are used.

Material		Combination material					
Metal	Surface ratio in proportion to combination material	Zinc	Aluminium	Ferritic steel	Lead	Austenitic stainless steel	Copper
Zinc	Small	-	M	M	H	H	H
	Large	-	L	L	L	L	L
Aluminium	Small	L	-	L	H	H	H
	Large	L	-	L	M	L	H
Ferritic steel	Small	L	L	-	H	H	L
	Large	L	L	-	L	L	L
Lead	Small	L	L	L	-	H	H
	Large	L	L	L	-	M	M
Austenitic stainless steel	Small	L	L	L	L	-	M
	Large	L	L	L	L	-	L
Copper	Small	L	L	L	L	L	-
	Large	L	L	L	L	L	-

L - Light or little corrosion to material

M - Moderate corrosion to material, for example, in very humid atmospheres

H - Heavy electrochemical corrosion to material

Observation: The table shows the corrosion of the “material”, and not that of the “combination material”.

“Light” means: “small-scale in proportion to the combination material”, “heavy” means: “large-scale in proportion to the combination material”.

Example 1: Material is a zinc galvanised screw in combination material, a cladding made from austenitic stainless steel: Row “zinc small”: “H” – heavy corrosion of the screw.

Example 2: Material, a cladding made from austenitic stainless steel screwed on with a screw galvanised with combination material zinc: Row “austenitic stainless steel large”. “L” – the corrosive attack upon the austenitic steel is light.

Note

The table does not take into account forms of corrosion with other root causes, such as stress corrosion. For further information, see Chapter 2.3

“Product properties” – AS-quality.

1.1 Planning and preparation

1.1.4 Storage of insulation materials

Incorrect storage of insulation materials outdoors can – mainly due to moisture – cause the insulation to deteriorate. Moisture in insulation materials has the following negative influences. The thermal conductivity of water is approximately 25 times greater than that of air, which is present in cells or between the fibres in insulation. An increase in moisture therefore results in an increase in the thermal conductivity of the insulation and, correspondingly, a decrease in the insulation efficiency. Even a moisture content of 1 % can result in an increase of thermal conductivity by 25 %. A higher moisture also means a significantly higher weight, which, as a rule, is not taken into account in the static design of an insulation system. Moisture causes many types of corrosion that virtually never develop in a dry system. The major types of corrosion in relation to insulation technology are oxygen, electrochemical and stress corrosion. Insulation materials for austenitic components, which in stainless steel quality are manufactured with a low chloride ion content, irrecoverably lose this property when moisture is introduced. Insulation materials must be protected against moisture when stored, during installation and when fitted. If storage in a closed structure is impossible, protect the insulation material from weather influences by covering it with waterproof material. Ensure the insulation is not in direct contact with the floor; otherwise it may become wet as a result of ground moisture.

1. System solutions

1.2 Insulation of piping

Piping plays a central role in many industrial processes in chemical or petrochemical installations such as power plants, as it connects core components such as appliances, columns, vessels, boilers, turbines etc. with one another and facilitates the flow of materials and energy. To guarantee a correct process cycle, the condition of the media within the pipes must remain within the set limitations (e.g. temperature, viscosity, pressure, etc.). In addition to the correct isometric construction and fastening of the piping, the piping insulation also has an important function. It must ensure that heat losses are effectively reduced and that the installation continues to operate economically and functionally on a permanent basis. This is the only way to guarantee the maximum efficiency of the process cycle throughout the design service life without losses as a result of faults.

Requirements for industrial piping

The basic efficiency and productivity factors of piping for the processing industry include energy efficiency, dependability and reliability under different conditions, in addition to the functionality of the process control, an appropriate structure that is suitable for the operating environment, as well as mechanical durability. The thermal insulation of piping plays a significant role in fulfilling these requirements.

Thermal insulation

The functions of proper thermal insulation for piping include:

- Reduction of heat losses (cost savings)
- Reduction of CO₂ emissions
- Frost protection
- Process control: ensuring the stability of the process temperature
- Noise reduction
- Condensation prevention
- (Personal) protection against high temperatures



Rockwool Products for pipe insulation

Rockwool Technical Insulation (RTI) offers a wide range of products for pipe insulation in industrial plants. Pre-formed pipe sections such as the Rockwool 850, load bearing mats such as Rockwool Duraflex, as well as various wired mats such as ProRox WM 70 and WM 100 were developed with this specific field of application in mind. All these products are easy to install and contribute to a high level of efficiency, functionality and reduced heat losses. Continuous internal and external inspection and high levels of quality assurance ensure the consistently high quality of all RTI products.

The examples of use below cannot fully take into account the particular circumstances of the construction-related factors. Determine whether the products are suitable for the corresponding application in each individual case. If in doubt, consult the RTI Experts.

The applicable standards and regulations must also be observed. A few examples follow:

- DIN 4140 (Insulation works on technical industrial plants and in technical facility equipment)
- AGI Q101 (Insulation works on power plant components)
- CINI-Manual "Insulation for industries"

1.2 Insulation of piping

Hot insulation systems

Principally, a thermal insulation structure for piping consists of an appropriate insulating material, usually covered by sheet metal cladding. This protects the object and the insulation from external influences such as the weather or mechanical loads. Spacers are also essential with insulation such as wired mats, which do not offer sufficient resistance to pressure to hold the weight of the cladding and other external loads. These spacers transfer the cladding loads directly onto the object. In the case of vertical piping, support structures are fitted to take on the loads of the insulation and the cladding. In general, support structures and spacers form thermal bridges.

Selecting a suitable insulation system depends on numerous parameters. These are described in greater detail in Chapter 1.1. Regarding the different forms of piping insulation, a fundamental distinction can be drawn between the following insulation systems.

Insulation with pipe sections

Generally, the best insulation is achieved using Rockwool pipe sections. The sections can be used up to temperatures of 620°C. They are supplied ready split and hinged for quick and easy snap-on assembly and are suitable for thermal and acoustical insulation of industrial pipe work. Due to their excellent fit and high compression resistance pipe sections can often be applied in a single layer without any additional spacers. If multiple layers are required, Rockwool Technical Insulation can also supply double layered - so called 'nested' - pipe sections. This reduces installation costs considerably. Also the number of thermal bridges, which have a negative influence on the insulation, is greatly reduced, while a lower thickness may be applied compared to wired mats.

Using pipe sections for the insulation of pipes results in considerably reduced installation time and costs. The lack of spacers and "unforeseen" gaps minimises heat losses and the risk of personal injuries due to hot spots on the cladding. At temperatures above 300 °C, the provisional application of spacers must be determined in each individual case.

Pipe sections are always precisely tailored to the corresponding pipe diameter to minimise the risk of convection and processing defects. Rockwool pipe sections are available in diameters of 17 to 915 mm.



Insulation with load-bearing mats

Load bearing mats, such as Rockwool Duraflex, are the latest development in the insulation sector. Rockwool Duraflex is a stone wool insulation mat (with a special fibre structure) bonded onto fibreglass reinforced aluminium foil. The flexible application makes the mats easy to cut. Typical applications include:

- pipe diameters \geq DN 350, or;
- piping with a high number of shaped pieces such as elbows or T-joints.

Rockwool Duraflex can be applied up to temperatures of 300 °C. Their high compression resistance means, that in many cases, load bearing mats can be applied without any additional spacers. Consequently the number of thermal bridges, which have a negative influence on the insulation, is greatly reduced.

The result is considerably reduced installation time and costs. The lack of spacers and “unforeseen” gaps minimises heat losses and the risk of personal injuries due to hot spots on the cladding.

Load-bearing mats are tailored to the corresponding length of the pipe circumference on site and are fastened with clamps.



Insulation with wired mats

Wired Mats, such as ProRox WM 70, are lightly bonded stone wool mats, usually stitched with galvanized wire onto a galvanized wire mesh.

Pipe insulation with wired mats has been a time-tested universal solution for many decades now. Due to their flexibility and high temperature resistance, wired mats can be easily cut and mounted onto the piping. These wired mats are ideal for application in situations where the use of pipe sections or load bearing mats is difficult or impossible:

- temperatures above 300 °C
- pipe diameters \geq DN 350,
- piping with a high number of shaped pieces such as elbows or T-joints.

Wired mats have a relatively low resistance to pressure and from a practical point of view should only be mounted in combination with spacers or support structures. Because of the resulting thermal bridges, better insulation performances are often achieved in the lower and middle temperature range (up to 300 °C) with pipe sections or load bearing mats rather than with wired mats.



1.2 Insulation of piping

Comparison of the different insulation systems

The particular advantage of pipe sections and load-bearing mats lies in the fact that support structures are not required and therefore thermal bridges caused by the insulation are minimised or removed. On the other hand, wired mat systems have their advantages due to their maximum service temperature in the case of hot face insulation.


The advantages of pipe sections and load-bearing mats at a glance are:

- It is not necessary to install spacers or support structures.
- The pipe sections and load bearing mats, such as Rockwool Duraflex, are applied more quickly without the interference of spacers.

- Both products offer an even, firm surface for installing the sheet cladding
- The lack of spacers gives rise to lower heat losses.
- It yields an even surface temperature across the sheet cladding.
- In comparison to wired mats, a more shallow insulation thickness can be applied. The operating costs of the installation decrease as a result of lower heat losses.


Generally speaking, a spacer or support structure functions as a thermal bridge, as a result of which the heat loss in the total insulation is increased considerably.

Insulation system with a spacer ring

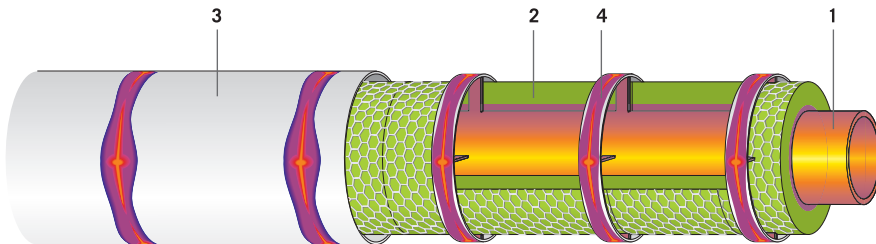

1. Pipe - 2. Insulation: ProRox WM - Wired Mats - 3. Cladding -
4. Spacer ring

Insulation system without a spacer ring

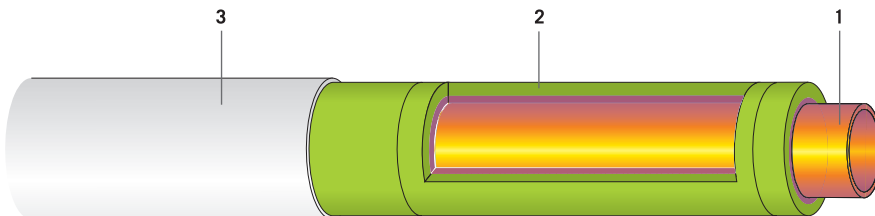

1. Pipe - 2. Insulation: Rockwool 850 - Pipe Sections or Rockwool Duraflex - 3. Cladding

Required insulation thicknesses

If the three insulation systems are compared, taking into consideration similar heat losses, clear advantages are seen with regard to the insulation thicknesses with systems using Rockwool 850 pipe sections and Rockwool Duraflex load-bearing mats. These do not use spacers, in contrast to insulation systems made using wired mats. The table below shows the required insulation thicknesses taking into account the following boundary conditions:

- Medium temperature: 250 °C
- Ambient temperature: 10 °C
- Wind speed: 5 m/s
- Cladding: Aluminium-zinc
- Heat loss: 150 W/m
- Application of spacers in the case of wired mats

Nominal diameter Ø DN	NPS (inch)	Pipe diameter mm	Minimum insulation thickness		
			Pipe sections	Load bearing mats	Wired mats
			Rockwool 850	Rockwool Duraflex	ProRox WM 70
50	2	60	30	n.a.	n.a.
80	3	89	30	n.a.	n.a.
100	4	108	40	n.a.	n.a.
150	6	159	60	n.a.	n.a.
200	8	219	70	100	120
250	10	273	90	130	150
300	12	324	100	140 (2*70)	180 (2*90)
350	14	356	110	160 (2*80)	200 (2*100)

Multiple layer insulation

n.a. = not applicable

1.2 Insulation of piping

Selection of pipe insulation systems

Generally, the best insulation is achieved using Rockwool pipe sections. The sections are quick and easy to install. Their excellent fit and high compression resistance means pipe sections can be applied in a single layer without any additional spacers. They also have a lower insulation thickness.

Load bearing mats, such as Rockwool Duraflex, are usually applied for the insulation of large pipe diameters and shaped pieces like elbows and T-joints. Generally, wired mats such as ProRox WM are applied within the higher temperature range ($T > 300\text{ °C}$).

Generally speaking, a spacer or support structure functions as a thermal bridge, as a result of which the heat loss in the total insulation is increased considerably.

The design of an insulation system depends upon many factors such as the dimensions, mechanical loads, safety aspects, economics, etc. Consequently this also requires a considered selection of the insulation material. Use the application matrix on the next page as a guide.

Comparison

Pipe sections and load-bearing mats offer the advantage that spacers are generally not required.

- Pipe sections and load-bearing mats are applied more quickly without the interference of spacers.
- Both products offer an even, firm surface for installing the cladding.
- The lack of spacers creates lower heat losses
- It yields an even surface temperature across the cladding
- In comparison to wired mats, a more shallow insulation thickness can be used. With a same insulation thickness, the operational costs of the installation decrease as a result of lower heat losses.

Application	Temperature (°C)	Pipe sections	Load bearing mats	Wired mats	
		Rockwool 850	Rockwool Duraflex	ProRox WM 70	ProRox WM 100
Piping	< 300 °C	●●●●●●	●●●●	●●	●
	300 °C - 580 °C	●●●		●●	●
	> 580 °C				●●●
Short sections, (many) elbows, valves, flanges	< 300 °C	●	●●●●●	●●●	●●
	300 °C - 580 °C	●		●●●	●●
	580 °C - 680 °C				●●●
Piping with tracing		●●●●●●	●●●●	●●	●
City heating pipes	D ≤ 356 mm	●●●●●●	●●●●●●		
	D > 356 mm	●●●●●	●●●●●●		

Note: ●●●●● = most optimal product

1.2 Insulation of piping

1.2.1 Insulation with pipe sections

Generally, the best insulation is achieved using Rockwool pipe sections. The sections can be used up to temperatures of 620 °C. They are supplied ready split and hinged for quick and easy snap-on assembly and are suitable for thermal and acoustic insulation of industrial pipe work. Their excellent fit and high compression resistance means pipe sections can be applied in a single layer without any additional spacers or support structures. Consequently the number of thermal bridges, which have a negative influence on the insulation, is greatly reduced, while a low thickness may be applied compared to wired mats. The result is considerably reduced installation time and costs. The lack of spacers and “unforeseen” gaps minimises heat losses and the risk of personal injuries due to hot spots on the cladding .

At temperatures above 300 °C, the provisional application of spacers must be determined in each individual case. Rockwool pipe sections are available in a wide range of diameters, ranging from 17 to 915 mm.

Note

Due to their low thermal conductivity, better thermal insulation values can be achieved with pipe sections than, for example, with wired mats. With insulation on straight pipe sections, a combination of both products in the same insulation thickness is therefore not advisable. If this combination is essential, for example, in the case of bends or shaped pieces, it is vital to select the correct insulation thickness. This is the only way to guarantee that no unexpected, potentially hazardous surface temperatures occur.

Insulation thicknesses to guarantee protection against contact

The table below is an initial guide to help select suitable insulation thicknesses for the guards. It is based on the following boundary conditions:

- Ambient temperature: 25 °C
- Wind speed: 0.5 m/s
- Cladding: galvanised steel bright
- Maximum surface temperature: 60 °C
- Insulation: Rockwool 850 pipe sections

External diameter			Temperature of the medium (°C)								
Nominal diameter \varnothing DN	NPS (inch)	(mm)	≤100	150	200	250	300	350	400	450	500
25	1	33,0	30	30	30	30	30	40	50	70	80
50	2	60,3	30	30	30	30	40	50	70	80	100
80	3	88,9	30	30	30	40	50	60	80	90	110
100	4	114,3	30	30	30	40	50	70	80	100	120
150	6	168,3	30	30	30	50	60	80	90	120	140
200	8	219,1	30	30	40	50	70	80	100	120	150
250	10	273,0	30	30	40	50	70	90	110	130	160
300	12	323,9	30	30	40	50	70	90	110	140	160


Multiple layer insulation

In the event of differing boundary conditions, please contact the RTI sales team. The thermo-technical engineering program “Rockassist” can be used to design the insulation according to the specific requirements.

Installation

Before starting the insulation works, ensure that all preparatory work on the object has been completed. Refer to Chapter 1.1 for details.

The Rockwool 850 pipe section is mounted directly onto the pipe to form a close fit. With horizontal pipes, the lengthwise joint of the pipe section should be turned towards the underside at the 6 o'clock position. With vertical pipes, the lengthwise joints should be staggered at an angle of 30 ° to one another. Secure the pipe sections with galvanised binding wire or with steel bands. With an insulation thickness exceeding 120 mm (or temperatures > 300 °C), install the insulation in at least two layers. If the insulation is assembled in multiple layers, the joints of the individual insulation layers must be staggered.

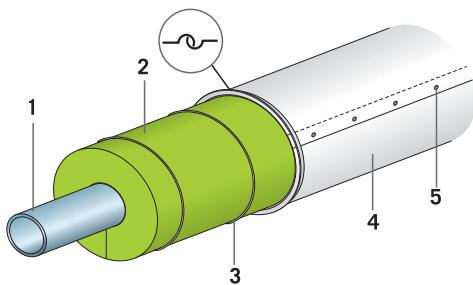

1. Pipe - 2. Insulation: Rockwool 850 Pipe Sections -
3. Clamp or binding wire - 4. Sheet cladding - 5. Sheet-metal screw or rivet

Support structures and spacers

Spacers are not generally essential in insulation systems with pipe sections. With pipes that are exposed to large mechanical loads (e.g. strong vibrations) and/or temperatures above 300 °C, determine whether a spacer ring is required in each individual case

With pipes that have been installed vertically, with a height in excess of four metres, fit support structures to transfer the dead load of the insulation system onto the pipe. Attach the first support ring to the lowest point of the vertical pipe. The distance between the support rings should not exceed approximately four metres.

1.2 Insulation of piping

1.2.2 Insulation with load-bearing mats

Load bearing mats (such as Rockwool Duraflex) are the latest development in the insulation business. Rockwool Duraflex is a stone wool insulation mat (with a special fibre structure) bonded onto fibreglass reinforced aluminium foil. The flexible application makes the mats easy to cut. Load bearing mats are ideal for application as pipe insulation in situations where the use of pipe sections is difficult. For instance where pipe diameters \geq DN 350, or in case of a high number of shaped pieces such as elbows or T-joints.

Rockwool Duraflex can be applied up to temperatures of 300 °C. Due to the high compression resistance, load bearing mats can be applied without additional spacers in many cases. Consequently, the number of thermal bridges which have a negative influence on the insulation, is greatly reduced.

The result is considerably reduced installation time and costs. The lack of spacers minimises heat losses and the risk of personal injuries caused by hot spots on the cladding. Load-bearing lamella mats are precisely tailored to the corresponding length of the pipe circumference on site and are fastened with clamps.

Insulation thicknesses to guarantee protection against contact

The table below is an initial guide to help select suitable insulation thicknesses for the guards. It is based on the following boundary conditions:

- Ambient temperature: 25 °C
- Wind speed: 0.5 m/s
- Cladding: galvanised steel bright
- Maximum surface temperature: 60 °C
- Insulation: Rockwool Duraflex

Nominal diameter \varnothing DN	External diameter		Temperature of the medium (°C)				
	NPS (inch)	(mm)	≤ 100	150	200	250	300
200	8	219,1	30	30	40	60	80
250	10	273,0	30	30	40	60	80
300	12	323,9	30	30	50	70	90
400	16	406,4	30	30	50	70	90
500	20	508,0	30	30	50	70	100

In the event of differing boundary conditions, please contact the RTI sales team. The thermo technical engineering program "Rockassist" can be used to design the insulation according to the specific requirements.

Installation


Before starting the insulation works, ensure that all preparatory work on the object has been completed. Refer to Chapter 1.1 for details

Cut the mats to the required length, based on the external insulation diameter (pipe diameter + two times the insulation thickness). Fasten the mat firmly to the pipe with steel bands. Ensure that the mats form a tight joint and that no lengthwise joints or circular joints are visible. The joints of the individual mats are securely taped with self-adhesive aluminium tape. If the insulation is assembled in multiple layers, the joints of the individual insulation layers must be staggered.

Support structures and spacers

Spacers are not generally essential in insulation systems with load bearing mats. With pipes that are exposed to large mechanical loads (e.g. strong vibrations), determine whether a spacer ring is required in each individual case

With pipes that have been installed vertically, with a height in excess of four metres, fit support structures to transfer the dead load of the insulation system onto the pipe. Attach the first support ring to the lowest point of the vertical pipe. The distance between the support rings should not exceed approximately four metres.

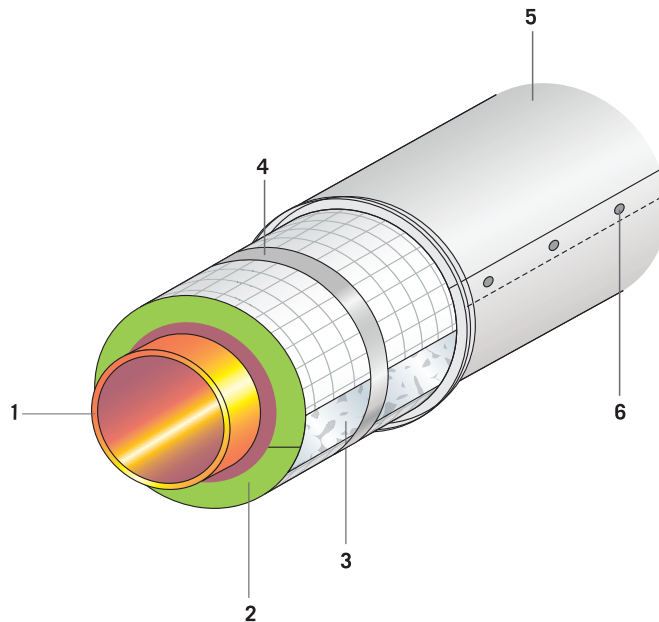

- 1. Pipe - 2. Insulation: e.g. Rockwool Duraflex -
- 3. Selfadhesive aluminium tape - 4. Steel bands -
- 5. Sheet cladding - 6. Sheet-metal screw or rivet

1.2 Insulation of piping

1.2.3 Insulation with wired mats

Pipe insulation with wired mats has been a time-tested universal solution for many decades now. Due to their flexibility and high temperature resistance, wired mats can be easily cut and mounted onto the piping. These wired mats are ideal for application on large pipe diameters and shaped pieces as elbows or T-joints.

Wired mats have a relatively low resistance to pressure and from a practical point of view should only be mounted in combination with spacers. Because of the resulting thermal bridges, better insulation performances are often achieved in the lower and middle temperature range (up to 300 °C) with pipe sections or load bearing mats rather than with wired mats.

Insulation thicknesses to guarantee protection against contact

The table below is an initial guide to help select suitable insulation thicknesses for the guards. It is based on the following boundary conditions:

- Ambient temperature: 25 °C
- Wind speed: 0.5 m/s
- Cladding: galvanised steel bright
- Maximum surface temperature: 60 °C
- Insulation: ProRox WM 70

External pipe diameter			Temperature of the medium (°C)					
Nominal diameter Ø DN	NPS (inch)	(mm)	≤100	200	300	400	500	600
200	8	219,1	30	50	90	140	200	270
250	10	273,0	30	50	100	150	210	280
300	12	323,9	30	60	100	160	220	300
400	16	406,4	30	60	110	160	230	310
500	20	508,0	30	60	110	170	240	330

Multiple layer installation


In the event of differing boundary conditions, please contact the RTI sales team. The thermo technical engineering program "Rockassist" can be used to design the insulation according to the specific requirements.

Installation

Before starting the insulation works, ensure that all preparatory work on the object has been completed. Refer to Chapter 1.1 for details.

Cut the mat to a length so that it can be fitted to the pipe with slight pre stressing. Wire the closing joints (lengthwise and circular) of the mats together using steel wire (0.5 mm thickness) or secure with mat hooks. Stainless steel pipes and pipes with an operating temperature > 400 °C can only be insulated with wired mats with stainless steel stitching wire and wire netting to prevent galvanic corrosion cracking.

With an insulation thickness of more than 120 mm (or temperatures > 300 °C), apply multiple layer insulation. If the insulation is assembled in multiple layers, the lengthwise and crosswise joints of the individual insulation layers must be staggered. If mechanical loads are anticipated, use steel straps to secure the wired mats.

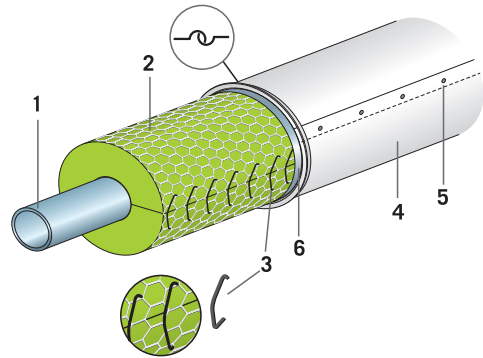


1. Pipe - 2. Insulation: ProRox Wired Mat- 3. Joint edge closed with mat hooks - 4. Sheet-metal cladding - 5. Sheet-metal screw or riveted bolt - 6. Spacer ring

Support structures and spacers

As wired mats do not offer sufficient resistance to pressure to bear the weight of the cladding, spacer or support structures should be applied. More information can be found in 1.2.4.

With pipes that have been installed vertically, with a height in excess of four metres, fit support structures to transfer the dead load of the insulation system onto the pipe. Attach the first support ring to the lowest point of the vertical pipe. The distance between the support rings should not exceed approximately four metres.

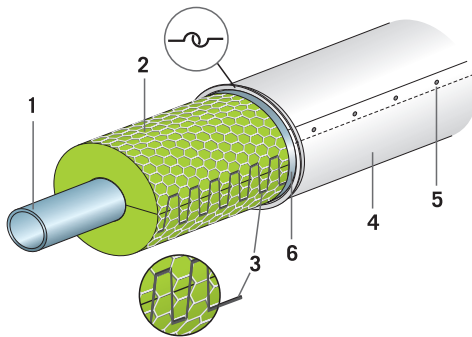

1. Pipe - 2. Insulation: ProRox Wired Mats - 3. Stitching of the joint edge with binding wire - 4. Sheet cladding - 5. Sheet-metal screw or riveted bolt - 6. Spacer ring

1.2 Insulation of piping


1.2.4 Insulation support

A. Spacers

The purpose of spacers is to keep the cladding at a predetermined distance from the pipe. Spacers are essential when the insulation (e.g. wired mats) cannot bear the mechanical load of the cladding. The use of spacers is generally not necessary if pipe sections or load bearing mats are used.

Use a support structure or spacers on pipes where mechanical loading (e.g. strong vibrations) of the insulation is expected and/or the temperature is higher than 300 °C.

Spacer rings usually consist of metal rings on which the sheet cladding rests, and metal or ceramic bars used as spacers, which rest on the pipe. Elastic spacers such as Omega clamps are frequently used to reduce the transference of vibrations. With steel spacers, apply at least three bars, whereby the maximum distance – measured as circumference of the external ring – must be a total of maximum 400 mm. With ceramic spacers, apply at least four bars at a maximum permissible distance of 250 mm.

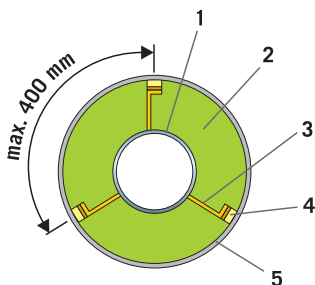


1. Pipe - 2. Rockwool Insulation - 3. Spacer - 4. Thermal dividing layer - 5. Support ring

Dimension spacers of support construction

The number of spacers depends on the insulation, temperature and the mechanical load. Use the following intermediate distances as a guide.

Insulation system	Horizontal piping		Vertical piping	
	≤ 300 °C	> 300 °C	≤ 300 °C	> 300 °C
Pipe sections	none	3 to 4 m	none	5 to 6 m
Load bearing mats	none	3 to 4 m	none	5 to 6 m
Wired mats	1 m	1 m	1 m	1 m

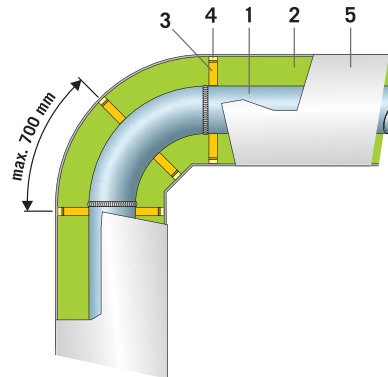


1. Pipe - 2. Rockwool Insulation - 3. Spacer - 4. Thermal dividing layer - 5. Cladding

The spacers on pipes are located under the circular joint of the cladding. On shaped sections such as pipe elbows, spacers are fitted at the start and at the end. If the external distance between the two spacers exceeds 700 mm, place additional spacers between the two.

B. Support construction

The purpose of support structures is to transfer the mechanical load of the insulation system and the forces affecting the insulation system onto the object. Support structures are essential in the case of vertical piping. In addition to the static and dynamic forces, changes in piping length and support structures due to temperature must also be taken into account when dimensioning. Support structures are fastened to mounting supports, which are welded to the pipe beforehand, or are mounted directly onto the pipe via a clamping action with so-called double clamping rings. With temperatures above 350 °C, the support structures must be made of high-temperature steels.

The table below is an initial dimensioning guide, and shows the weight of the insulation system against the nominal width of the pipe and the insulation thickness. The table accounts for an insulation with an apparent density of 100 kg/m³, including the spacer and a 1.0 mm strong galvanised sheet (11 kg/m²).

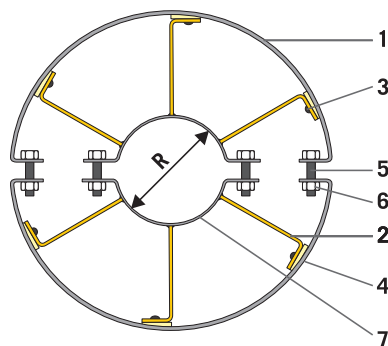

1. Support ring - 2. Bar - 3. Rivet or screw connection -
4. Thermal decoupling - 5. Clamping screw - 6. Screw nut -
7. Internal clamping ring

Weight of the insulation (kg/m. pipe)

External diameter			Weight of insulation system in relation to different insulation thicknesses	Insulation thickness in mm							
Nominal diameter ø DN	NPS (inch)	mm		30	40	50	60	80	100	120	140
15	½	21,3	kg/m	4	5	6	8	11	15	19	24
25	1	33,7	kg/m	4	5	7	8	12	15	20	25
50	2	60,3	kg/m	5	7	8	10	13	17	22	27
65	2 ½	76,1	kg/m	6	7	9	10	14	18	23	28
80	3	88,9	kg/m	7	8	10	11	15	19	24	29
100	4	114,3	kg/m	8	9	11	12	16	21	26	31
200	8	219,1	kg/m	12	14	16	18	23	28	33	39
300	12	323,9	kg/m	17	19	21	24	29	35	41	47
500	20	508,0	kg/m	25	28	31	34	40	47	54	62
700	28	711,0	kg/m	34	37	41	44	52	60	69	78
planar surface			kg/m ²	15	16	17	18	20	22	24	26

1.2 Insulation of piping

1.2.5 Cladding

Suitable cladding should be applied to protect the insulation from weather influences, mechanical loads and (potentially corrosive) pollution. Selecting the appropriate cladding depends on various factors, such as working loads, foot traffic, wind and snow loads, ambient temperatures and conditions.

Note:

An insulation system resistant to foot traffic must not become permanently damaged if a person weighing 100 kg, (weight including any tools being carried) walks across it. It is not designed to bear additional loads, such as the placing of heavy equipment. For the purpose of the safety regulations, a durable insulation is not considered to be a walkable surface!

When selecting the appropriate cladding, take the following points into account:

- As a general rule, galvanised steel is used in buildings due to its mechanical strength, fire resistance and low surface temperature (in comparison to an aluminium cladding).
- Aluminium is used outdoors, because it is easy to fit and more cost-effective than stainless steel and does not tend to corrode under common weather conditions.
- In corrosive environments, aluminised steel, stainless steel or glass reinforced polyester (grp: e.g. Rocktight) is used as cladding. Stainless steel is recommended for use in environments with a fire risk.
- The surface temperature of the cladding is influenced by the material type. The following applies as a general rule: the shinier the surface, the higher the surface temperature.
- To exclude the risk of galvanic corrosion, only use combinations of metals that do not tend to corrode due to their electrochemical potentials (also see page 17 in section 1.1).
- For acoustic insulation, a noise absorbent material (bitumen, mylar foil) is mounted on the insulation or inside the cladding. To reduce the risk of fire, limit the surface temperatures of the cladding to the maximum operating temperature of the noise absorbent material.

Cladding material	Areas at risk of fire	Corrosive environment	Max. surface temperature		
			< 50 °C	< 60 °C	>60 °C
Aluminium sheet	-	-			●
Aluminium/zinc coated steel sheet	-	-			●
Galvanised steel sheet	●	-			●
Austenitic stainless steel sheet	●	●			●
Aluminised steel sheet	●	●			●
Plastic-coated steel or aluminium	-	-		●	
Glass fibre-reinforced polyester (e.g. Rocktight)	-	●			90 °C
Coatings/mastics	-	-			80 °C
Foils	-	-	●		

The thickness of the metal sheet depends on the pipe diameter and the type of the metal.

With special acoustic requirements, a larger thickness (≥ 1 mm) is generally used.

Recommended sheet thickness and overlaps regarding cladding made from flat sheets (conform CINI)

External diameter of the insulation (mm)	Minimum thickness of metal cladding sheet (recommended by CINI)				
	Aluminium (CINI 3.1.01)	Aluminised steel sheet (CINI 3.1.02)	Alu-Zinc coated steel sheet (CINI 3.1.03)	Zinc coated steel sheet (CINI 3.1.04)	Austenitic stainless steel sheet (CINI 3.1.05)
< 140	0,6	0,56	0,5	0,5	0,5
130 - 300	0,8	0,8	0,8	0,8	0,8
> 300	1,0	0,8	0,8	0,8	0,8

The recommended sheet thickness deviates to a certain level per standard/country. The thickness recommended by CINI is shown in the table above. See section 3.2.2 for the thickness according to DIN 4140 .

To reduce the risk of galvanic corrosion, it is very important to use the correct screws, straps etc. See the table on page 17 for more information.

The basic guidelines are:

- Fasten sheet cladding on lengthwise joints with at least six sheet metal screws or blind rivets every metre.
- Place the screws or blind rivets equidistantly. If screws or rivets are fitted in two rows, do not stagger the screws or rivets.
- The cladding can also be held in place with corrosion-resistant straps instead of screws or rivets.
- Do not use aluminium screws.


1.2 Insulation of piping

1.2.5 Cladding

Influence of the cladding on the surface temperature

In addition to the insulation thickness, the thermal conductivity of the insulation and the ambient conditions (for example temperature and wind), the surface temperature of insulation is also influenced by the emissions ratio of the cladding. The following applies as a general rule for thermal insulation: the shinier a surface is (lower emissivity), the higher the surface temperature. The following example shows the various surface temperatures that depend on the cladding:

- Diameter: DN 100 (114 mm)
- Temperature of the medium: 500 °C
- Place of installation: Interior (Wind speed 0.5 m/s)
- Insulation: ProRox WM 70, wired mats; thickness: 100 mm
- Various cladding materials
 - Aluminium sheet
 - Galvanised steel sheet, bright
 - Stainless steel
 - Paint-coated plastic cladding

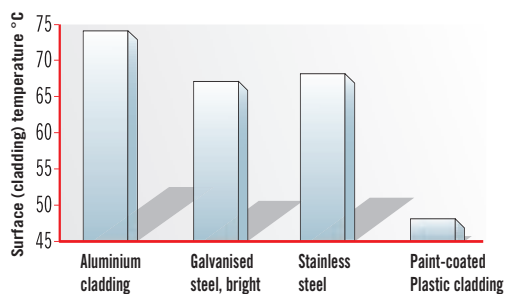

Cladding in corrosive environments

To guarantee the functionality of a technical insulation, it is important to protect it against atmospheric influences and prevent the ingress of moisture into the insulation. Moisture in the insulation system increases thermal conductivity, thereby reducing the effectiveness of the thermal protection. It also poses a high risk of corrosion to the component. In certain applications, the cladding system is also expected to offer chemical resistance, as well as being resistant to cleaning methods such as steam blasting. Alongside the insulation and construction, selecting a suitable cladding system is very important as it forms the basis for a long service life, low maintenance costs and low heat loss of a technical insulation.

Rockwool Technical Insulation has therefore developed an innovative cladding system for technical insulation: Rocktight.

Rocktight – a durable protection for insulation

Rockwool Rocktight is a fibreglass reinforced polyester mat, which hardens when exposed to ultraviolet (UV) light. The material contains resins, glass fibres and a special filling agent and is (unprocessed) protected against UV rays by foils on both sides.

Rocktight is soft and flexible when unprocessed. It can be cut or trimmed in any shape and easily mounted onto the insulation in this state. The polyester then hardens when exposed to ultraviolet (UV) light. Once hardened, Rocktight is watertight and forms a mechanical protection for the insulation.

The advantages:

- Long service life:

Rocktight creates a sealed, watertight cladding for Rockwool insulation systems. This minimises damage caused by atmospheric influences or general wear and tear. Rocktight is resistant to many chemical substances and forms a mechanical protection for the insulation.

- Easy to clean:

Insulation systems cased in Rocktight can be cleaned with steam-jet air ejectors, without the risk of water penetrating the insulation and causing damage.

- Low start-up costs:

The cutting and processing take place directly on site. This avoids costly prefabrications, as is the case with sheet cladding.

- Flexible applications:

Rocktight can be used for cold and thermal insulation of underground and aboveground pipes, for example in offshore plants. Its high flexibility enables application on complex, shaped objects.

Rockwool Rocktight is characterised by easy processing. It can be cut easily using a knife directly on site

and, as an unhardened Rocktight mat is highly flexible, it can be simply shaped to cover complex geometric shapes such as pipe elbows, T-joints or pipe fittings.

Rockwool Rocktight has a protective foil on both sides. It is supplied in rolls in cardboard packaging. The roll is also wrapped in black foil that is resistant to UV light. The underside (the side facing the object) is covered with a dark foil and has a rough, self-adhesive surface. The flat surface of the outside is covered with a white foil. After each use, place the roll in the sealed cardboard packaging to minimise the risk of hardening caused by daylight or UV light.

Rocktight requires a dry, clean (ventilated) work environment. For outdoor applications, tents should be erected if necessary, to protect the unhardened Rocktight mat from UV light.

Note

- High temperatures: Rockwool Rocktight can be used in temperatures of up to 90 °C. In case of higher temperatures, fit an end-cap to lower the temperature.
- Chemical resistance: Rockwool Rocktight is resistant to numerous chemicals.
- Expansion joints: fit expansion joints to accommodate expansion of the Rocktight material and the steel pipe.




1.2 Insulation of piping

1.2.6 Pipe hangers and pipe supports

There is a wide range of solutions for pipe hangers and pipe supports. The following illustrations show the possibilities described below for insulation systems:


- Pipe hangers in direct contact with the piping
- Pipe supports in direct contact with the piping
- Pipe supports not in direct contact with the piping (commonly used with cold insulation systems)

Pipe hangers in direct contact with the piping

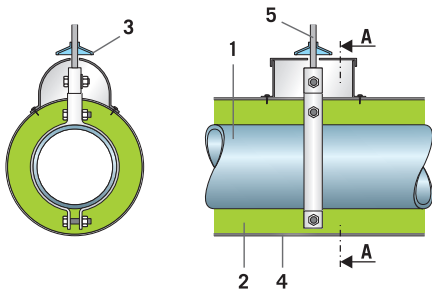


1. Pipe - 2. Insulation: Rockwool 850 – pipe section -
3. Collar - 4. Sheet cladding - 5. Pipe hanger

Pipe support in direct contact with the piping

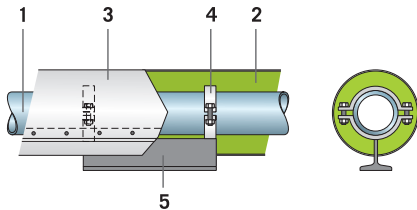

1. Pipe - 2. Insulation: Rockwool 850 – pipe section -
3. Sheet cladding - 4. Pipe clamp - 5. Pipe saddle

Pipe support not in direct contact with the piping

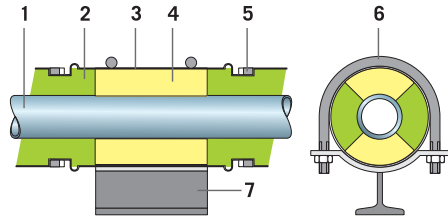

1. Pipe - 2. Insulation: Rockwool 850 pipe sections -
3. Sheet cladding - 4. Load-bearing insulation - 5. Seal -
6. Stirrup - 7. Pipe saddle


A basic rule applying to all pipe attachments is that the insulation system (i.e. the insulation and cladding) must not be damaged if the piping expands. Damage to the cladding of outdoor installations, in particular, can allow the ingress of moisture in the material. The result may be permanent damage of the insulation system and as a consequence high heat losses, and dangerously high surface temperatures and corrosion etc.

1.2.7 Insulation of valves and flanges

Heat losses incurred through non insulated fixtures such as valves and flanges are substantial, even at low temperatures. Refer to Table A14 of the VDI guideline 2055 for information about heat losses from non-insulated pipe fittings and flanges (see section 3.3.11). The table states that an uninsulated valve (DN100), located outside loses almost as much heat at 100 °C as 36 metres of uninsulated piping. The temperature of the medium can also decrease to such an extent at non-insulated fittings or flanges, that process critical temperatures are reached, at which point for example, the medium will start to crystallise. Valves and flanges should therefore be insulated as much as possible.


To avoid damage during inspection or repairs, the insulation for valves and flanges is designed with removable coverings or hoods, to allow rapid disassembly. Removable coverings or hoods are usually insulated from the inside with wired mats (e.g. ProRox WM 70). The coverings are fastened to the object with lever fastenings, which are fixed directly onto the covering or on to straps. Take the following conditions into account when designing insulated coverings for fittings and flanges:

- The overlap distance of the insulated covering over the insulated pipe should be at least 50 mm.
- The pipe insulation should end at the flanges, leaving a gap equal to the bolt length + 30 mm and should be closed off with a lock washer so the flange can be loosened without damaging the insulation.
- With valves, an extended spindle should preferably be fitted horizontally or below the pipe to prevent leakage along the spindle shaft.
- The cladding must be fitted to prevent the ingress of moisture in the insulation. On inclined or vertical piping, for example, mount rain deflectors above the removable coverings. If the ingress of moisture into the insulation is unavoidable, make 10 mm. diameter drain holes in the removable covering.

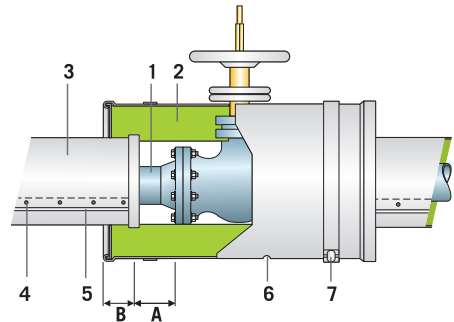

1. Pipe - 2. Insulation: ProRox WM wired mats - 3. Cladding
 - 4. Sheet-metal screw or Rivet - 5. Swage - 6. Drainage opening - 7. Strap - $B \geq 50 \text{ mm}$ - $A = \text{bolt length} + 30 \text{ mm}$


A number of possible design options for insulation systems for pipe fittings and flanges follow:

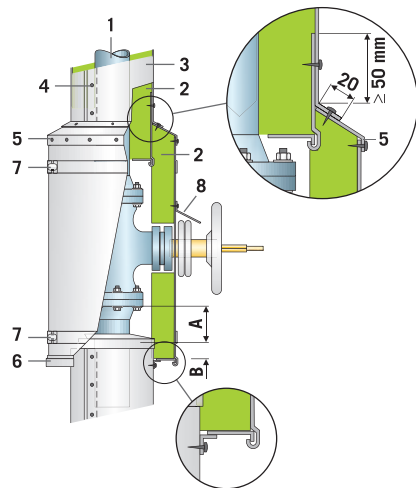


1. Pipe - 2. Insulation: ProRox WM wired mats - 3. Cladding -
 4. Sheet-metal screw or rivet - 5. Rain deflector - 6. Lock washer - 7. Straps - 8. Rain deflector - $B \geq 50 \text{ mm}$ - $A = \text{bolt length} + 30 \text{ mm}$

1.2 Insulation of piping


1.2.7 Insulation of valves and flanges

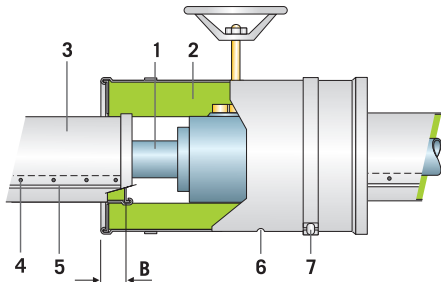


- 1. Pipe - 2. Insulation: ProRox WM wired mats - 3. Cladding
- 4. Sheet-metal screw or rivet - 5. Swage - 6. Drainage opening - 7. Straps – $B \geq 50$ mm

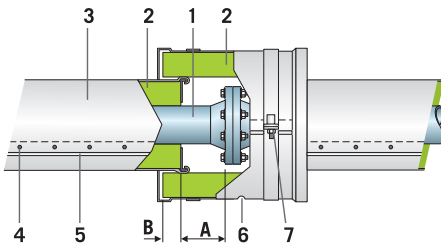

- 1. Pipe - 2. Insulation: e.g. ProRox WM wired mats -
- 3. Cladding - 4. Sheet-metal screw or rivet - 5. Swage -
- 6. Drainage opening - 7. Straps – $B \geq 50$ mm -
- A = Bolt length + 30 mm

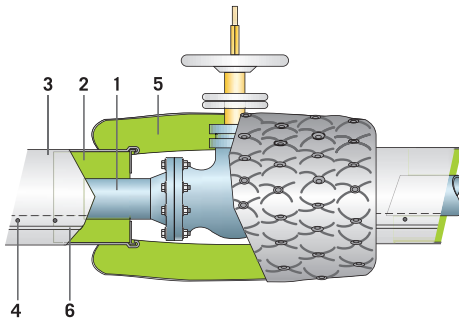


- 1. Pipe - 2. Insulation: e.g. Rockwool - 3. Cladding -
- 4. Sheet-metal screw or rivet - 5. Removable coverings (insulated from the inside with e.g. Rockwool 160 wired mats) - 6. Swage

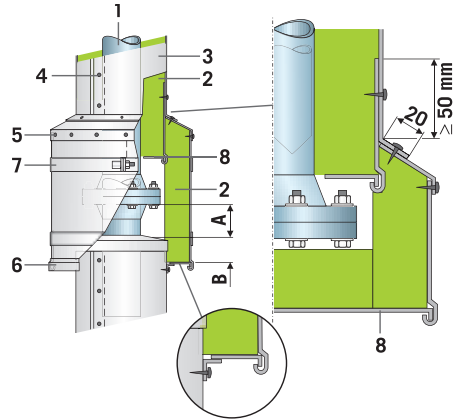


- 1. Pipe - 2. Insulation: ProRox WM wired mats - 3. Sheet -
- 4. Sheet-metal screw or rivet - 5. Rain deflector - 6. Lock washer - 7. Straps - 8. Lock washer - $B \geq 50$ mm - A = Screw length + 30 mm

Leakages

With pipes where a leaking fluid content could damage the insulation or the coating system in the removable covering, mount flange straps with a leak detection fitting around the flange. Flange bands can also prevent flammable products from penetrating into the insulation material and can help prevent the outbreak of fire.

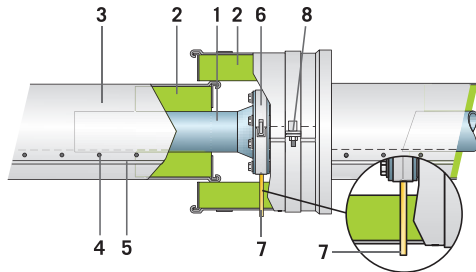

- 1. Pipe - 2. Insulation: ProRox WM wired mats - 3. Cladding -
- 4. Sheet-metal screw or rivet - 5. Swage - 6. Flange band -
- 7. Leak detection fitting - 8. Clamps

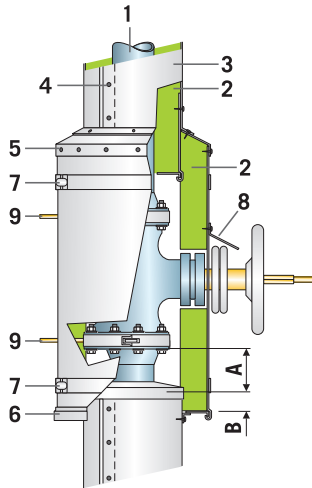

- 1. Pipe - 2. Insulation - 3. Cladding - 4. Sheet-metal screw or rivet - 5. Collar - 6. Collar - 7. Clamps - 8. Rain deflector -
- 9. Leak detection fitting - B \geq 50 mm - A = bolt length + 30 mm

1.2.8 Insulation of pipe elbows and T pieces


The cladding of elbows and T-pieces is susceptible to damage, due to expanding or vibrating pipes. There is a particular risk of moisture penetrating damaged swage connections in the cladding, if the object is located outdoors.

For the insulation of shaped pieces, we recommend using the same insulation in the same thickness as used for the pipe.

Insulation of pipe elbows with Rockwool pipe sections

For the insulation of pipe elbows with pipe sections (e.g. Rockwool 850), the pipe sections are cut into segments and tightly fitted onto the pipe elbow with the lengthwise joints facing downwards. The angular division of the segments should correspond to the

radius of the pipe elbow. The pipe section segments are fastened to the pipe elbow with clamps or binding wire. Joints between the individual segments are plugged tightly with loose Rockwool.

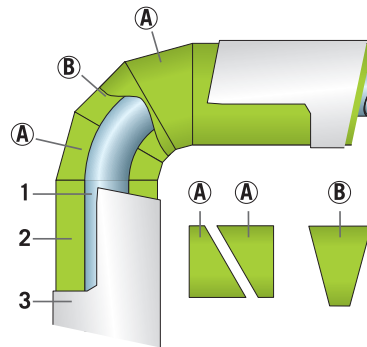

- 1. Pipe - 2. Insulation: Rockwool 850 - pipe sections -
- 3. Cladding - A and B = Segmented pipe sections

Insulation of pipe elbows with wired or load bearing mats


If the piping is insulated with wired mats or load bearing mats, shaped pieces such as pipe elbows or T-pieces are generally insulated with the same mats. In this case, the mats are cut into so-called fish-shaped elbow segments. These are mounted onto the pipe elbow to seal the elbow. With wired mats, all the joints (both circular and lengthwise joints) are sewn together with binding wire or mat hooks. Spacers are required at least at the start and end of the elbow (for more details, please see page 30).

Load-bearing mats are fixed to the pipe elbow with metal or plastic straps. Any gaps between the individual segments are plugged up with loose Rockwool. Secure the joint edges with self-adhesive aluminium tape.


1.2 Insulation of piping

1.2.7 Insulation of pipe valves and flanges


The diagrams below show how the sheet is mounted onto shaped pieces.

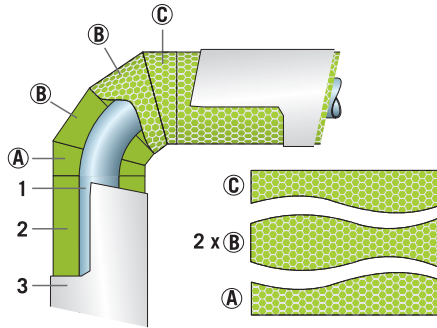

1. Pipe - 2. Rockwool Insulation - 3. Cladding - A to C: Elbow segments of mats

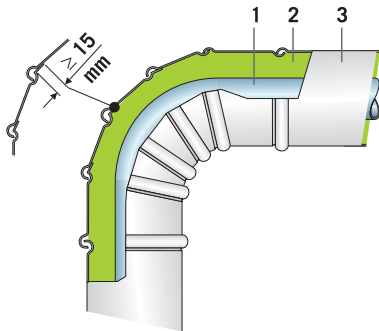


1. Pipe - 2. Rockwool Insulation - 3. Cladding

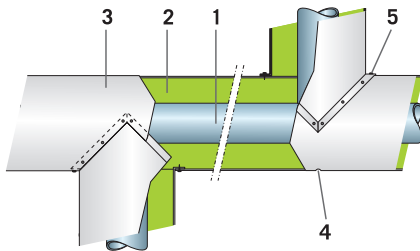


1. Pipe - 2. Rockwool Insulation - 3. Cladding -
4. Drainage opening - 5. Edging with mastic compound

1.2.9 Reducers

Pipes that branch out with many outlets reduce the pipe diameter. Examples of how to install reducers follow:

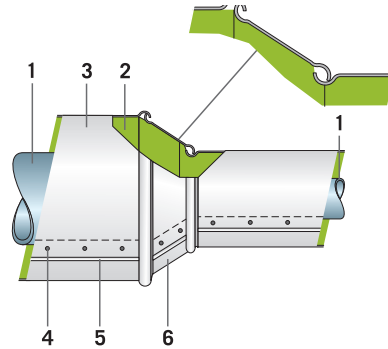

1. Pipe - 2. Rockwool Insulation - 3. Cladding - 4. Sheet-metal screw or rivet - 5. Swage - 6. Reducer

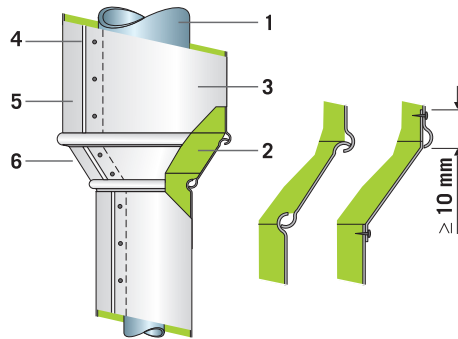

1. Pipe - 2. Rockwool Insulation - 3. Cladding - 4. Sheet-metal screw or rivet - 5. Swage - 6. Reducer

1.2.10 Expansion joints

In thermal insulation systems, large differences between the piping and the cladding temperature can occur. The materials used for the pipe, insulation, insulation support and cladding also have different thermal expansion coefficients. This leads to different thermal elongations of the various components in the insulation system, which must be allowed for using constructive measures. The elongation “ Δl ” can be determined as follows:

$$\Delta l = l \cdot \Delta t \cdot \alpha$$


In this formula, l corresponds to the length of the pipe, Δt corresponds to the difference in temperature between the cold and warm pipe (or cladding) and α corresponds to the linear thermal expansion coefficient (see tables in chapter 4).

Example for the thermal elongation of steel

$\Delta l(\text{mm})/\text{m}$	Δt
0,55	50
1,10	100
1,65	150
2,20	200


If below expansion joints for thermal length compensation have been built into the pipe, the insulation system must be designed so that insulation cannot enter the bellows, thereby compromising the compensatory effect. The expansion bellows are covered with a sheet

that is then insulated (see diagram). With temperatures above 300 °C, do not use galvanised sheets due to the risk of galvanic corrosion (cracking).

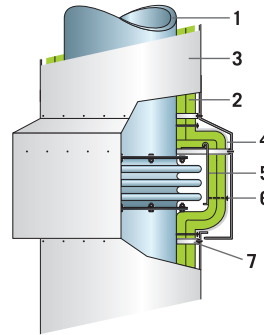

- 1. Pipe - 2. Insulation: ProRox WM wired mats - 3. Cladding
- 4. Aluminium foil - 5. Cover sheet - 6. Mat pin with clip -
- 7. Spacer

To compensate for thermal expansion of the cladding, install the expansion joints shown below.

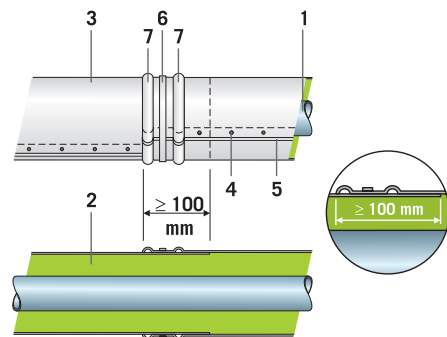

- 1. Pipe - 2. Insulation: ProRox WM wired mats - 3. Cladding
- 4. Sheet-metal screw or rivet - 5. Swage - 6. Metal strap -
- 7. Circumferential seam

1.2 Insulation of piping


1.2.11 Tracing

When media are transported over long distances, in particular, the media inside the piping can spoil, set or be at risk from frost in the winter. Insulation can reduce heat losses and postpone the moment at which the installation freezes. Insulation alone, however, cannot indefinitely prevent the installation from freezing. Installing additional tracing may be necessary between the object and the insulation.


A distinction is made between pipe tracing and electrical tracing. In pipe tracing systems, a heating pipe is fitted parallel and close to the media pipe. Steam, warm water or thermal oil flows through the tracing pipes as a heat transfer medium. Electrical tracing consists of cables mounted onto the pipes. These cables heat the pipes

Traced pipes can be insulated with pipe sections or mats. Ensure that no insulation occupies the space between the tracing and the pipe; otherwise the heat transfer will be hampered. Pipes are therefore often wrapped in aluminium foil. If pipe sections are used, select a correspondingly larger internal diameter of the pipe section. With vertical piping, sealing the end of each pipe section with loose Rockwool is recommended to prevent convection (chimney effect).


The diagrams on the right show various design options.

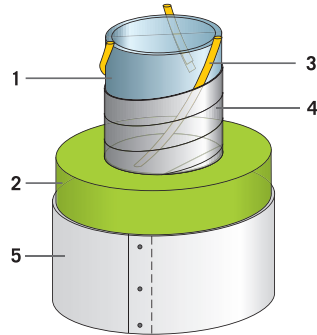

1. Pipe - 2. Insulation: Rockwool 850 - pipe section -
3. Electrical tracing - 4. Aluminium foil - 5. Cladding

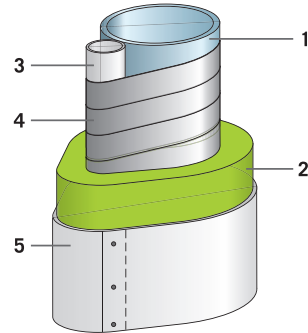

1. Pipe - 2. Insulation: Rockwool Duraflex or ProRox WM -
wired mats - 3. Tracing - 4. Aluminium foil - 5. Cladding

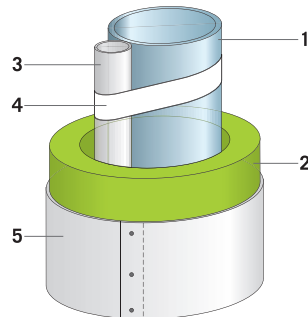

1. Pipe - 2. Insulation: Rockwool 850 pipe section -
3. Tracing - 4. Binding tape - 5. Cladding

1.2.12 Foot traffic


Avoid walking on insulated pipes, as this can damage the insulation. Damage caused by foot traffic includes dented sheet cladding and gaps at the sheet seams. Water can penetrate the insulation through these gaps and cause lasting damage to the entire insulation system. The result is often greater heat losses and corrosion.

Note

An insulation system resistant to foot traffic must not become permanently damaged if a person weighing 100 kg, (weight including any tools being carried) walks on it. It is not designed to bear additional loads, such as the placing of heavy equipment. For the purpose of the safety regulations, a durable insulation is not considered to be a walkable surface.

In special applications, reinforcing the cladding is recommended, e.g. using a reinforcement sheet.

Pipe insulation systems resistant to foot traffic require an insulation material with a high mechanical strength (e.g. Rockwool 851 pipe sections). Using other insulation materials such as wired mats, which are not resistant to pressure, is not recommended, as the sheet cladding only rests on the spacers and tends to dent when walked upon.

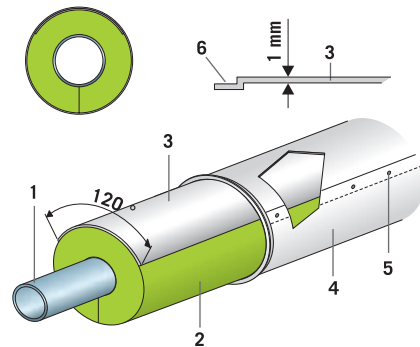

1. Pipe - 2. Insulation: Rockwool 851 pipe section -
3. Reinforcement sheet - 4. Cladding - 5. Sheet-metal screw or rivet - 6. Joggle

1. System solutions

1.3 Insulation of vessels

Vessels are a major component in installations for various procedures in almost all fields of industry.

Many production processes require different substances that are stored in vessels and used in the individual processes later in the procedure. The vessels primarily store liquid, solid or gaseous substances, which are added to the process as and when required. Raw materials, fuels or end products are usually stored in large storage tanks.

It is often important to store the substances within certain temperature limits. If the temperature is too high or too low, the substance can spoil or set, or lose its flowing properties and become incapable of being pumped or discharged. Insulation is therefore a major factor in the functionality of procedural processes.

It also has the following purposes:

- Reduces heat losses
- Guarantees protection against contact by minimising the surface temperature
- Reduces cooling of the stored substance, so it remains fluid and does not set
- Prevents the vessel from freezing (with additional tracers)
- Prevents heating of the stored substance (for example, through solar radiation)

The vessels used in the different industrial processes are so varied that the examples of use cannot fully take into account the particular circumstances of each case.

Determine whether the products and construction described are suitable for the corresponding application in each individual case. If in doubt, consult the RTI Sales Team.

The applicable standards and regulations must also be observed. A few examples follow:

- DIN 4140 (Insulation works on industrial plants and building services installations)
- AGI Q05 (Construction of industrial plants)
- AGI Q101 (Insulation works on power plant components)
- CINI-Manual: "Insulation in industry"

Before starting the insulation works, ensure that all preparatory work on the object has been completed. Refer to Chapter 1.1 for details.


Insulation systems for vessels

An insulation system for a vessel generally consists of the following components:

- Insulation
- Support construction and a spacer
- Water vapour retarder with cold insulation systems
- Cladding

The actual operating temperature (above or below ambient) is essential for the design of the insulation work.

The following chapters concentrate on hot insulation.

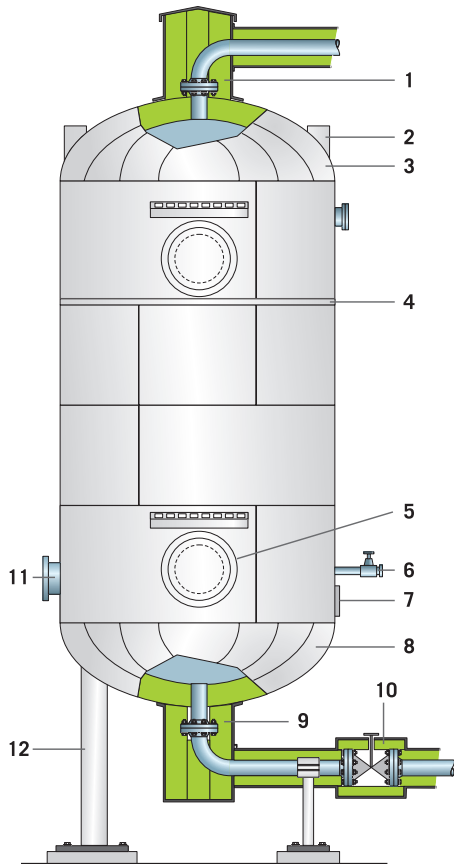

1. Vessel inlet - 2. Crane hooks - 3. Vessel head - 4. Expansion joint - 5. Manhole - 6. Tapping point (e.g. for sampling) - 7. Identification board - 8. Vessel base - 9. Vessel outlet - 10. Fitting insulation - 11. Flange - 12. Vessel leg

Selection and installation of the insulation

Selecting the appropriate insulation depends on the operating method, the installation temperature, the dimensions and the location of the vessel.

Typical insulation materials are Rockwool Duraflex, and board insulation like Rockwool Flexiboard and Multiboard.

Since vessels are often located outdoors, it is important to select insulation with a low thermal conductivity and excellent water repellent properties. The insulation is usually fastened to the cylindrical vessels with steel straps. These should be made from stainless steel and should be closed with butterfly nuts or quick release fasteners. The strap measurements and intervals for cylindrical objects shown in the table on the next page have proved useful in many projects.

Minimum radius Rockwool Technical Insulation slabs								
Product	Insulation thickness (mm)							
	25	40	50	60	70	80	100	120
Rockwool Flexiboard	400	500	700	900	1100	1300	1800	2000
Rockwool Multiboard	400	500	700	1000	1200	1500	1900	2400
Rockwool 233	500	700	1000	1500	2000	2500	2500	2800

1.3 Insulation of vessels

Selection and installation of the insulation

External insulation diameter	Internal insulation layer strap measurement	External or single layer insulation strap measurement	Distance between the straps
200 tot 1800 mm	13 x 0.5 mm	16 x 0.5 mm	250 mm
> 1800 mm	16 x 0.5 mm	19 x 0.5 mm	250 mm

In a wide variety of applications, these values can only be used as reference values. In each individual case, determine whether different strap measurements and intervals should be used.

If the insulation is assembled in multiple layers, the joints of the individual insulation layers must be staggered (so called masonry bond).


For temperatures up to 300 °C, Rockwool Duraflex for horizontal applications, Rockwool Multiboards or ProRox WM 70 - wired mats are usually used to insulate vessels with flat vertical walls. In this case, the insulation is attached with welding pins and spring plates. On flat surfaces, attach the wired mats using minimum six pins per m², and minimum ten pins per m² on the underneath. Observe the following when pinning the insulation:

- With insulation thicknesses ≤ 120 mm, use pins with a minimum diameter of 4 mm .
- With insulation thicknesses ranging from 130 to 230 mm, use pins with a minimum diameter of 5 mm .
- With insulation thicknesses ≥ 240 mm, use pins with a minimum diameter of 6 mm.
- If the cladding rests directly on the insulation without a gap between the two, the pins must be 10 mm shorter than the insulation thickness.
- Fasten each insulation layer with straps and clips.

With wired mats, all the lengthwise and crosswise joints must be sewn or wired together, or joined with six mat hooks per metre. If the insulation is assembled in multiple layers, the joints of the individual insulation layers must be staggered.


The following illustrations show a number of typical methods of insulating vessels.

Insulation of a crane hook

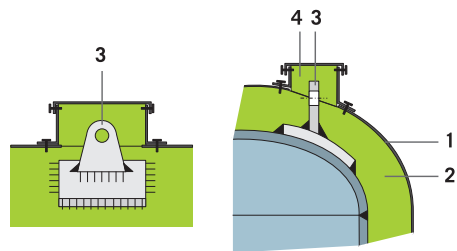


1. Cladding - 2. Insulation: ProRox WM 70 – Wired Mats -
3. Crane hooks - 4. Insulation covering for the crane hook

Insulation of a vessel base

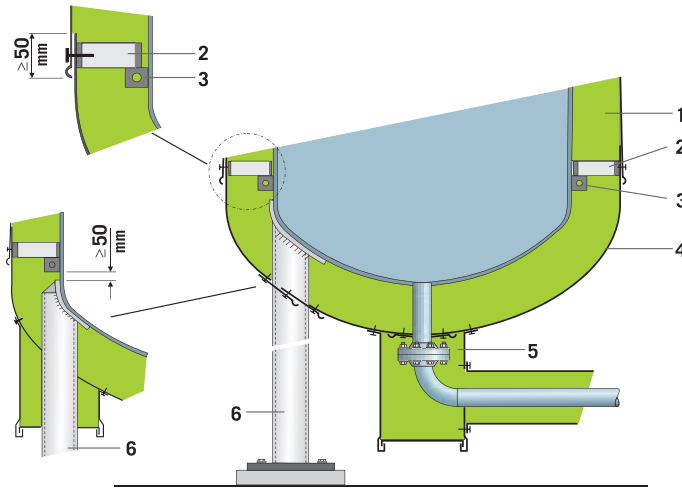

- 1. Insulation: e.g. ProRox WM wired mats
- 2. Support construction
- 3. Mounting support
- 4. Conical column head
- 5. Vessel outlet
- 6. Vessel leg

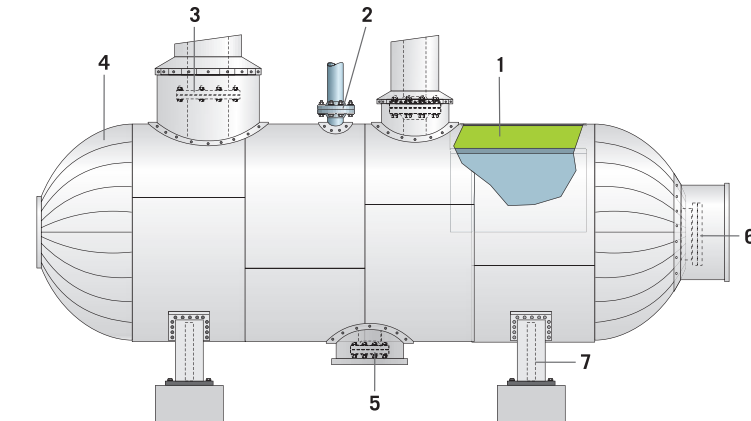


- 1. Insulation: Rockwool Duraflex
- 2. Flange inlet for safety valve
- 3. Vessel filling nozzles
- 4. Conical head
- 5. Vessel drawdown
- 6. Conical head with manhole
- 7. Vessel leg


1.3 Insulation of vessels

Selection and installation of the insulation


Insulation of a conical head

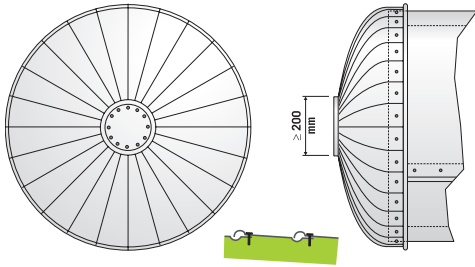

Insulation of a conical head with a manhole

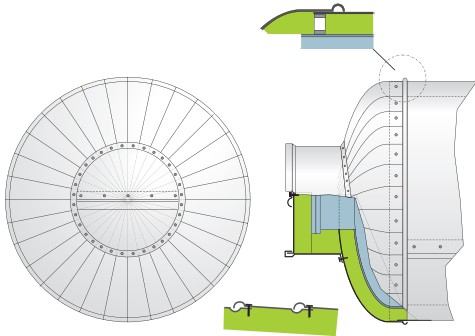

Insulation of vessel outlet

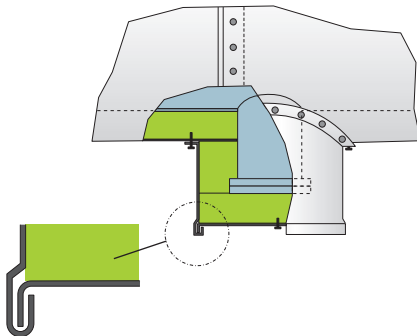

Support constructions and spacers

The application of support constructions and spacers on vessels is essential. The objective of support constructions is to bear the weight of the insulation system and to bear the weight above mounting supports on the object to be insulated. The spacers keep the cladding of the insulation at a predetermined distance. On vertical pipes, the substructures often assume the function of the support construction and spacer. The design specifications are illustrated in Chapter 1.4. The corresponding requirements for support constructions and spacers can be found in CINI and the AGI guidelines Q153 and 154.

Before commencing the insulation works, fit mounting supports to the vessels to which the support constructions are fitted. The shape, construction and measurements of mounting supports for support constructions must enable the insulation to be fitted during assembly. Use the design loads specified in DIN guidelines 1055-4 and 1055-5 to dimension the mounting supports and the support constructions and spacers.

Cladding

The cladding of vessels protects the insulation against mechanical influences and the weather. There is a wide range of different flat and profiled sheets available. See Chapter 3.2 for an overview. Flat sheets are primarily used to clad smaller vessels. With large-scale insulation systems, flat sheets can only bear small, static loads exerted by the wind. It is therefore essential to reduce the distance between the support structures. The result will be a higher number of support structures and thermal bridges. On large surfaces, flat sheets are more likely to buckle or dent, leading to optical damages, than profiled sheets. To improve the stability and optical characteristic, the sheets can be canted diagonally (cambered).

Preferably use profiled sheets for vessels with a large surface area. They offer structural advantages and can accommodate expansions that are perpendicular to the direction of the swage. The disadvantage is that pipe protrusions are more complex from a structural perspective. Using profiled sheets is only recommended with cladding with a low number of protrusions. Design profiled sheet casings so that rainfall is deflected safely.

Cladding in moist or corrosive environments

To guarantee the functionality of a technical insulation, it is important to protect it against atmospheric influences and prevent the ingress of moisture into the insulation. Moisture in the insulation system increases thermal conductivity, thereby reducing the effectiveness of the thermal protection. It also represents a high risk of corrosion to the component. In certain applications, the cladding system is also expected to offer chemical resistance, as well as being resistant to cleaning methods such as steam blasting. Alongside the insulation and construction, selecting a suitable cladding system is very important as it forms the basis for a long service life, low maintenance costs and low heat loss of a technical insulation.

Rockwool Technical Insulation has therefore developed an innovative cladding system for technical insulation: Rocktight.

Rocktight – for durable protection

Rockwool Rocktight is a fibre glass reinforced polyester mat, which hardens when exposed to ultraviolet (UV) light. The material contains resins, glass fibres and a special filling agent and is protected against UV rays by foils on both sides.

Rocktight is soft and flexible when unprocessed. The polyester then hardens when exposed to ultraviolet (UV) light. Once hardened, Rocktight is waterproof and forms a mechanical protection for the insulation. Please see Chapter 1.2. for more details about processing Rocktight.



1. System solutions

1.4 Insulation of columns

Columns are pillar-shaped vessels, which are mainly used in the (petro) chemical industry for distillation or the extraction of substances. They often form the key elements in chemical or petrochemical plants. The processes in columns often only operate at certain temperatures. The insulation of columns plays an important role in their functionality.

- Reduces heat losses
- Guarantees protection against contact by minimising the surface temperature
- Reduces the cooling of the stored substance, so it remains fluid and does not set
- Ensures the column remains at the necessary process temperatures
- Prevents heating of the stored substance (for example, through solar radiation)

The columns used in the different industrial processes are so varied that the examples of use below cannot fully take into account the particular circumstances of the construction-related factors.

Determine whether the products and construction described are suitable for the corresponding application in each individual case. If any doubt, consult the RTI Sales Team.

The applicable standards and regulations must be observed. A few examples follow:

- DIN 4140 (Insulation works on industrial plants and building services installations)
- AGI Q101 (Insulation works on power plant components)
- CINI-Manual: "Insulation in industry"


Before starting the insulation works, ensure that all preparatory work on the object has been completed. Refer to Chapter 1.1 for details.

Insulation systems for columns

An insulation system for vessels and columns generally comprises the following components:

- Insulation
- Support construction and a spacer
- Water vapour retarder in the case of cold insulation systems
- Cladding

The temperature of the columns, in particular, has a significant impact on the optimal insulation system. This chapter focuses on the insulation of **hot columns**.

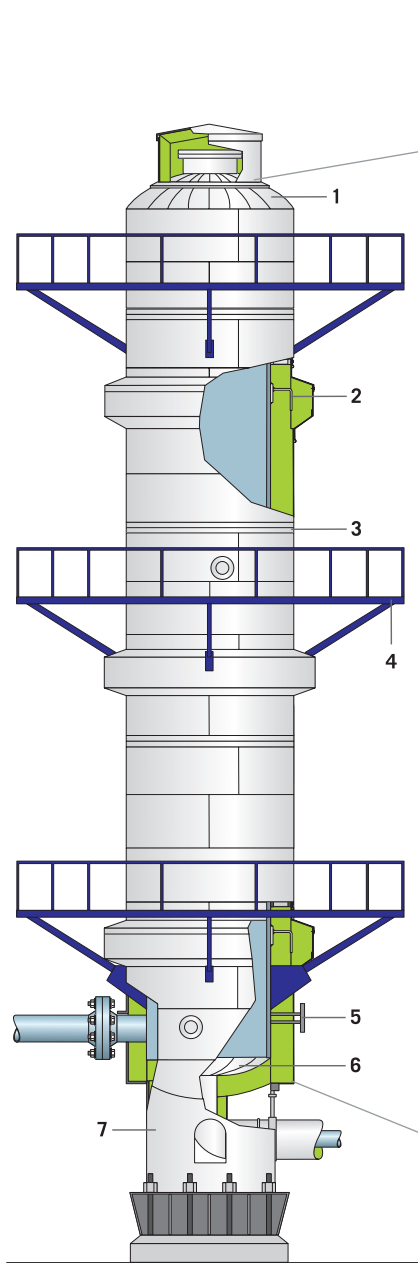

- 1. Column head - 2. Reinforcement ring - 3. Expansion joint
- 4. Working platform - 5. Identification board - 6. Column base - 7. Column skirt

Selection and installation of the insulation

Selecting the appropriate insulation depends on the operating method, the installation temperature, the dimensions and the location of the vessel or column.

Insulation materials like Rockwool Duraflex or ProRox WM 70 wired mat are primarily used for the insulation of columns.

Since columns are often located outdoors, it is important to select insulation with a low thermal conductivity and excellent water repellent properties. The insulation is usually fastened to the columns with steel straps. These should be made from stainless steel and should be closed with butterfly nuts or quick release fasteners. The strap measurements and intervals for cylindrical objects shown in the table on the next page have proved useful in many projects.


1.4 Insulation of columns

Selection and installation of the insulation

External insulation diameter	Internal insulation layer strap measurement	External or single layer insulation strap measurement	Distance between the straps
200 tot 1800 mm	13 x 0.5 mm	16 x 0.5 mm	250 mm
> 1800 mm	16 x 0.5 mm	19 x 0.5 mm	250 mm


In a wide variety of applications, these values can only be used as reference values. In each individual case, determine whether different strap measurements and intervals should be used. If the insulation is assembled in multiple layers, the joints of the individual insulation layers must be staggered. The following illustrations show a number of typical methods of insulating columns.

Insulation of a reinforcement ring

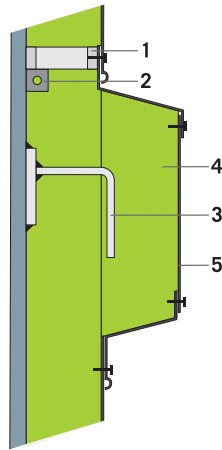


- 1. Support construction - 2. Mounting support -
- 3. Reinforcement ring - 4. Insulation: e.g. Rockwool Duraflex
- 5. Cladding

Insulation of conical column head

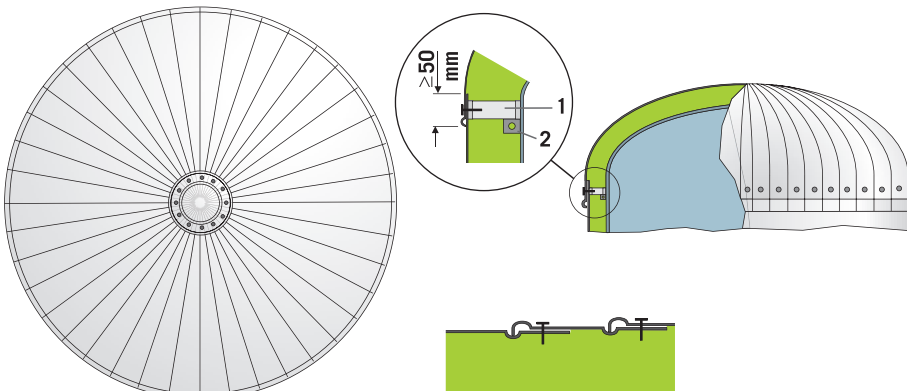

- 1. Supporting construction - 2. Mounting support

Insulation of a column base

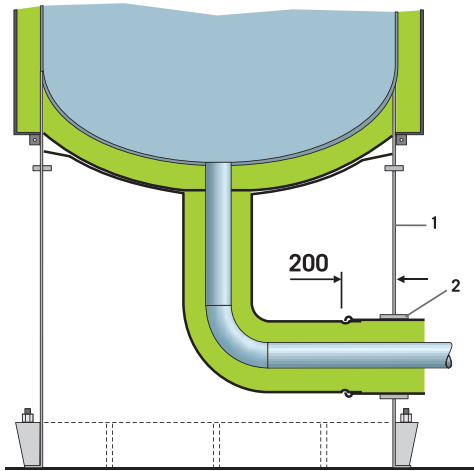


1. Skirt: Column support frame - 2. Sliding cover

Fire protection in column skirts


The fire protection quality of a column primarily depends on the fire resistance of the column support frame. The RTI Conlit Systems offer proven fire protection solutions for column support skirts. If you have any questions, please consult the RTI Sales team.

Insulation of manhole on the column head, vertical connection

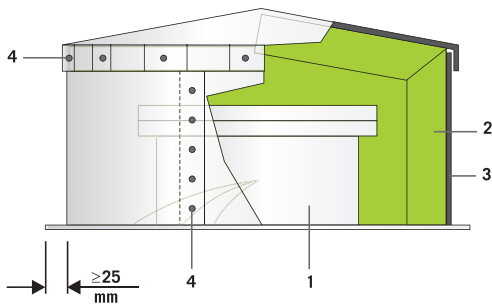

1. Manhole - 2. Insulation - 3. Cladding - 4. Sheet-metal screw


Insulation of manhole, horizontal connection

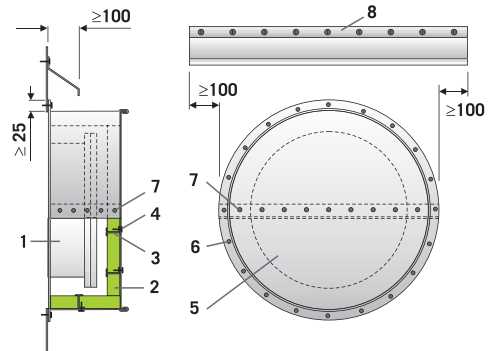

1.4 Insulation of columns

Selection and installation of the insulation

Various methods for pipe penetrations

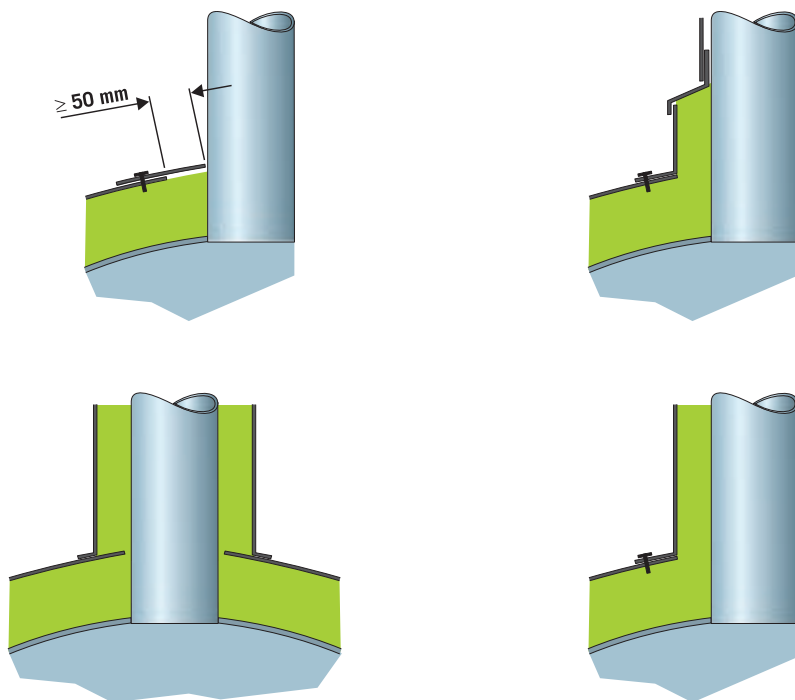


Support constructions and spacers



The application of support constructions and spacers on columns is essential. The objective of support constructions is to bear the weight of the insulation system and to bear the weight above mounting supports on the object to be insulated. The spacers keep the cladding of the insulation at a predetermined distance. On columns, which are always perpendicular, the substructures often assume the functions of the support construction and spacer.

The corresponding requirements for support constructions and spacers can be found in AGI guidelines Q153 and Q154.

Before commencing the insulation works, fit mounting supports to the column to which the support constructions are fitted. The shape, construction and measurements of mounting supports for support constructions must enable the insulation to be fitted during assembly. Use the design loads specified in DIN guidelines 1055-4 and 1055-5 to dimension the mounting supports and the support constructions and spacers.

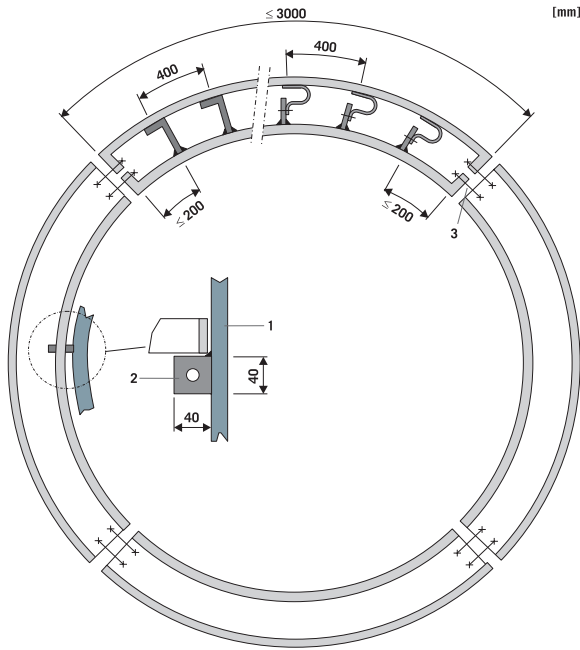


[mm]

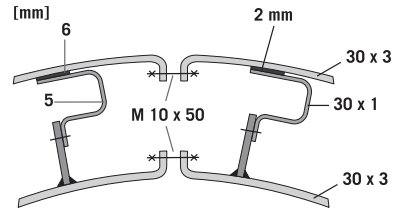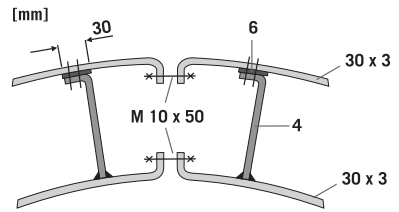


- 1. Object wall - 2. Mounting support - 3. Metric bolting -
- 4. Bar - 5. Omega clamp - 6. Thermal separating layer

Ladder support cleats

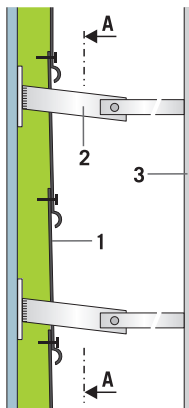

side view

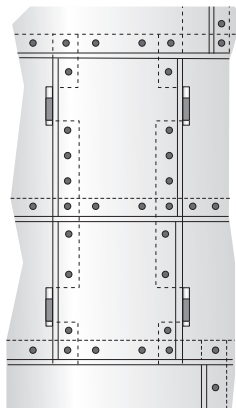

front view

Cladding

The cladding of columns protects the insulation against mechanical influences and the weather. There is a wide range of different flat and profiled sheets available. See section 3.2.2 'Cladding materials' for an overview. Further details are also provided in Chapter 1.3 "Insulation of vessels".

Rocktight – for durable protection

The Rockwool Rocktight cladding system has proven its value in moist and corrosive environments. See Chapters 1.2 and 1.3 for more details.

1. System solutions

1.5 Insulation of storage tanks

The availability of raw materials, fuels and the storage of end products is critical in almost all fields of industry. Generally, large tanks are used for raw materials, fuels and end products. Small tanks or vessels (see chapter 1.3) are used to temporarily store (semi) products. To conserve the substance and ensure the stability and safety of the production process, it is important to keep the temperature inside the tank between certain temperature limits.

Therefore the industrie sets high standards for the conditioning temperature of storage tanks. We give some examples:

- In the food industry, a milk cooling tank is a large storage tank used to cool and hold milk at a cold temperature until it can be packed and transported to the end-users.
- Storage facilities for liquefied gasses such as LNG, operate at very low temperatures up to $-168\text{ }^{\circ}\text{C}$. Avoid evaporation or expansion of the liquefied gas, as this can result into safety problems.
- In the petrochemical industry, many storage facilities operate at high temperatures of $30\text{ }^{\circ}\text{C}$ – $220\text{ }^{\circ}\text{C}$ to avoid fluids, such as bitumen, spoiling or setting - which could result in problems with pumping or discharging from the tank.

Conclusion: Therefore, insulation of storage tanks is a major factor in the functionality of storage facilities. It also serves the following purposes:

- **Costs savings:** Insulation significantly reduces the heat and the so-called breathing losses of the substance. The pay-back time for the hot insulation is, even at lower temperatures ($30\text{ }^{\circ}\text{C}$), usually less than 1 year, whereas the lifetime of the insulation may be many years.
- **Environment:** In addition to the cost savings achieved, reduced heat losses will also lead to lower

CO_2 emission. Reduced breathing losses of hazardous substances prevents damage to our environment.

- **Process control:** Insulation will prevent tanks from freezing or being heated by solar radiation. It will also reduce the cooling of the stored substance, preventing it from setting and remaining in a solid form. In both cases additional heating or cooling may be applicable.
- **Safety:** A fire resistant insulation reduces the risk of a fire outside the tank igniting a flammable medium. It is also protection against contact by minimising the surface (contact) temperature of the tank



Properly designed insulation work mainly depends on the isometrics and location of the storage tank, type of fluid and the purpose of the insulation. Even though the following examples of use are restricted to **hot thermal** insulation for outdoor application, the types of storage tanks used are so varied that the examples cannot fully take into account the particular circumstances of each case. Determine whether the products and construction described are suitable for the corresponding application in each individual case. If in doubt, consult the RTI Sales Team.

The applicable standards and regulations must also be observed. A few examples follow:

- DIN 4140 (Insulation works on industrial plants and building services installations)
- AGI Q05 (Construction of industrial plants)
- AGI Q101 (Insulation works on power plant components)
- CINI-Manual: “Insulation in industry”

Insulation selection


Storage tanks are located outdoors, so it is important to select a material with a low thermal conductivity and excellent water repellent properties. Rockwool flexible Board insulation, such as Rockwool Multiboard, is mainly used to insulate tank walls. Applying a less water repellent, non pressure-resistant insulation like Wired Mats is not generally recommended. If foot traffic can occur, a pressure-resistant slab such as Rockwool CRS is applied for the insulation of the tank roof. If applying a product which is resistant to foot traffic is impossible, apply a support structure, where needed, to protect the insulation boards. For temperatures above 100 °C applying the insulation in at least 2 layers (so called masonry bond) is recommended.

1.5 Insulation of storage tanks

Insulation of tank roofs

Insulating a tank is not easy. Corrosion of the tank roof can occur if the insulation is not properly installed and maintained. Therefore, many companies tend not to insulate the tank roof.

A common assumption is that the still air above the hot fluid acts as insulation of the tank roof. This assumption is, however, not entirely correct. Due to the difference in temperature between the hot fluid and the non-insulated tank roof there is fairly strong convection, which results into considerable heat losses. Tank roof insulation is feasible if the proper insulation material and mounting and fixing methods are applied.

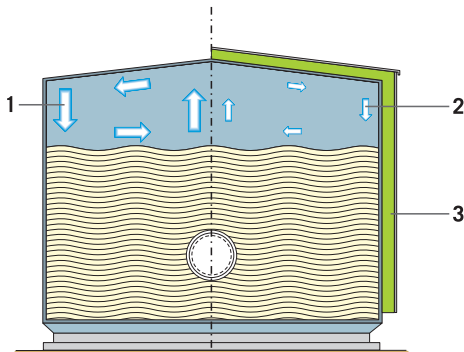


1. No insulation: strong convection - 2. Insulation: reduced convection - 3. Insulation: e.g. Rockwool Multiboard

Construction

Before starting the insulation works, ensure that all preparatory work on the object has been completed. Refer to Chapter 1.1 for details. Outdoor storage tanks are continuously exposed to the environment. Wind causes both pressure and delamination, which can easily result in damage to the insulation protection – usually aluminum sheeting. Consequently, the aluminum sheeting is blown away and rain water can leak into the insulation. Water accumulation can cause corrosion resulting in severe corrosion of the tank, leakage of the substance inside etc. Correct precautions are necessary to ensure the quality and life-time of the insulation.

Many systems can cope with the demands. The appropriate system will greatly depend on the diameter, temperature tank, the surrounding environment and the possibilities to use scaffolding/rope access when mounting the insulation. In addition, the plant owner may have specific requirements. Determine whether the products and construction described are suitable for the corresponding application in each individual case. If in doubt, consult the RTI Sales Team.

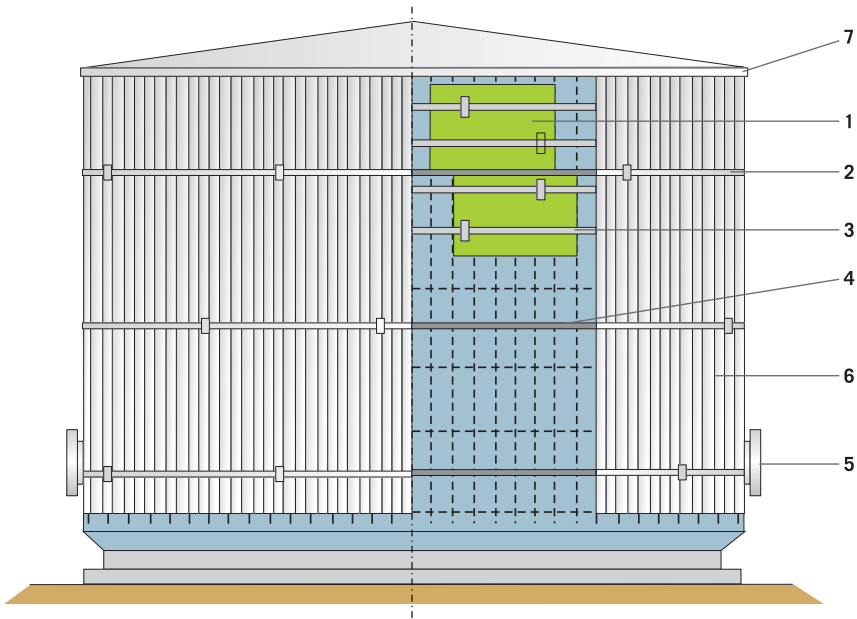

1. Insulation: e.g. Rockwool Multiboards - 2. Stainless steel bands (weather proofing) - 3. Stainless steel bands - 4. Support ring - 5. Protrusion - 6. Cladding - 7. Roof/wall connection



Cladding

A metal cladding is generally applied for the tank wall and roof. Thanks to its light weight, low costs and ease of installation, aluminium is commonly applied as cladding. In special circumstances (fire rating, corrosive environment etc) other materials such as stainless steel or Rockwool Rocktight may be used. Please note the comments under 1.2.6 and watertight covering in this section.


Support rings

With vertical applications, the weight of the insulation can damage the insulation layer below. To avoid damaging the insulation, fit horizontal support rings is higher than


1.5 Insulation of storage tanks

Support rings

4 metres. The distance between the support rings should not exceed 3 metres. The construction should be built so that leakage water can be expelled from the insulation.

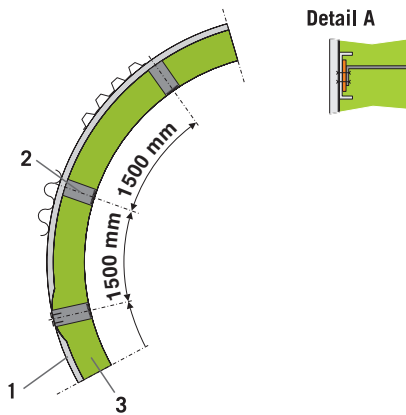

1. Tank wall - 2. Spacer - 3. Insulation: e.g. Rockwool Multiboard




1. Horizontal support ring - 2. Spacer - 3. Fixing

Expansion

Large storage tanks expand due to changes in temperature and if the substance stored is filled or discharged (so called “bulging”). These factors can increase/decrease the tank diameter. Example: The diameter of a storage tank - Ø 20 m, Avg T 220 °C - will increase approx. 60 mm. This consequently increases the tank circumference by approx. 180 mm. To avoid

stress/tension on the insulation protection (aluminium sheeting) selecting a flexible insulation material such as

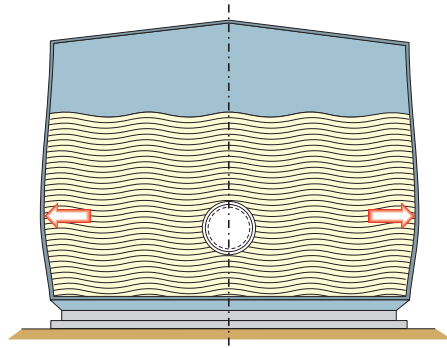


Rockwool Multiboard is important. For high temperatures, anticipate further expansion by fitting profiled sheeting.

Ladders and manholes

The necessary space requirements for the insulation must be taken into account when designing and planning the installation. The distance between the ladder and the tanks should be large enough to make installing insulation afterwards possible. Insulate manholes so they can still be used frequently without damaging the insulation.

Tank wall and tank base connection

When a tank is filled, stress may occur at the welded seam between the wall and base of the tank. For inspection purposes the first 50 cm of the tank wall should not be insulated. The first support ring is usually welded above this level and constructed so that leakage water can be expelled from the insulation.

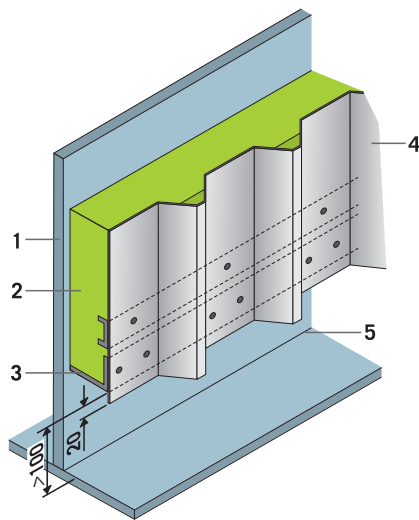


- 1. Tank wall - 2. Insulation: e.g. Rockwool Multiboard -
- 3. Support ring - 4. Cladding - 5. Welded seam

Tank wall and tank roof connection


A rainwater shield is fitted at the seam between the tank wall and tank roof to prevent leakage into the tank wall insulation. Weld the safety guard / railing on this rainwater shield.

Connection tank wall - tank roof

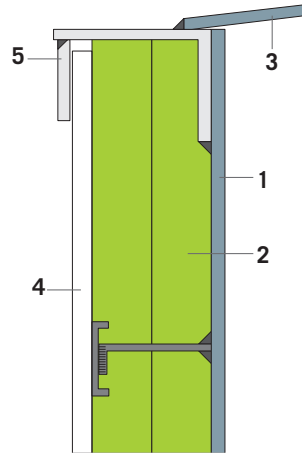

- 1. Tank wall - 2. Insulation: Rockwool Multiboard -
- 3. Tank roof - 4. Cladding (aluminium) - 5. Deflector

Connection tank wall - tank roof with railing

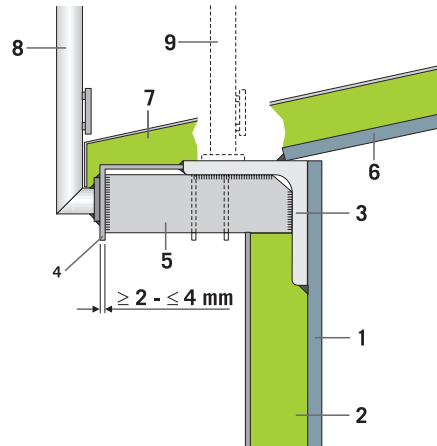


- 1. Tank wall - 2. Insulation: e.g. Rockwool Multiboard -
- 3. L-profile - 4. Rain deflector - 5. Support strip -
- 6. Tank roof - 7. Insulation: e.g. Rockwool CRS - 8. Railing -
- 9. Not insulated roof

1.5 Insulation of storage tanks

Protrusions within tank walls

Protrusions within the tank wall insulation may lead to leakage of rainwater or pollution with chemical substances. Keep the number of protrusions to a minimum. Insulate any remaining protrusions as indicated below.

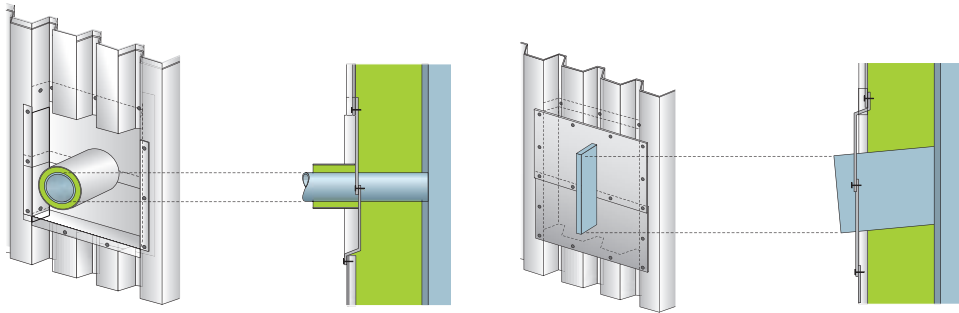


Finishing of tank roofs


Similar to tank wall insulation, many constructions are possible for tank roof insulation. The appropriate system greatly depends on the tank diameter and the nature of the seam with the tank wall. In addition, the plant owner may have specific requirements. The insulation is generally clad with aluminium sheeting, “rivetted” or in radial segments. As tank roofs are vulnerable to delamination, screws may be damaged (pulled loose).

If welding the roof is not possible, the steel radial segments in the centre of the roof can be hooked together in a ring around the perimeter of the roof. Turnbuckles are used to keep the radials correctly tensioned.


In many cases, the most critical aspect of tank insulation is preventing the leakage of rainwater inside the insulation. Water accumulation can cause corrosion resulting in severe corrosion of the tank. Correct precautions are necessary to ensure the quality and life-time of the insulation

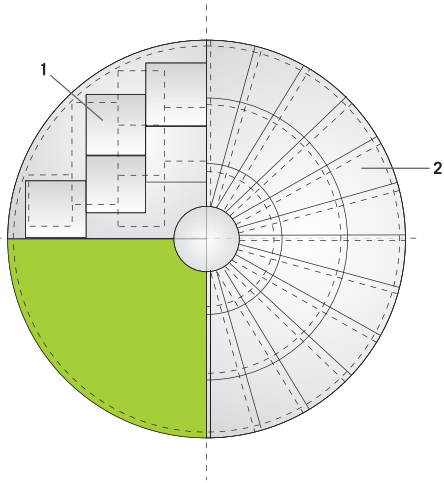


1. Finishing with aluminium cladding - 2. Finishing with steel radial segments

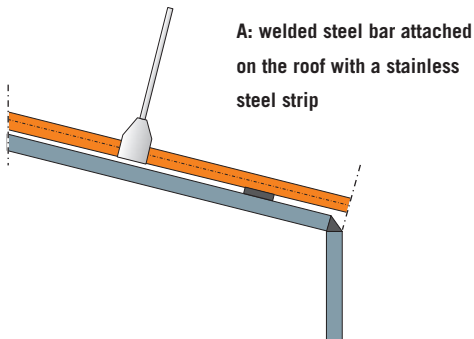

A: welded steel bar attached on the roof with a stainless steel strip

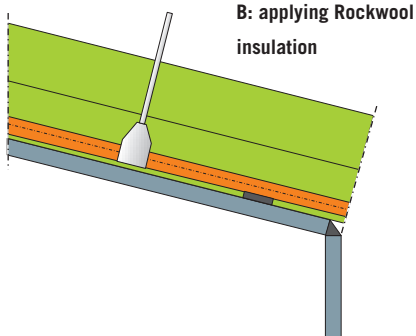

B: applying Rockwool insulation

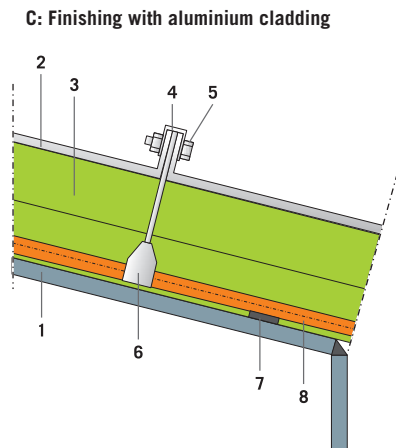


C: Finishing with aluminium cladding

1. Tank roof - 2. Cladding - 3. Insulation: Rockwool CRS - 4. Aluminium finishing strip - 5. Bolts and rivets (stainless steel) - 6. Strip (stainless steel) - 7. Weld - 8. Welded steel bar

1.5 Insulation of storage tanks

Protrusions within tank roofs

Protrusions within the tank roof insulation may lead to leakage of rainwater or pollution with chemical substances due to overflowing of the tank. Keep the number of protrusions in the tank roof to a minimum. If this is not possible, apply the construction stated below.

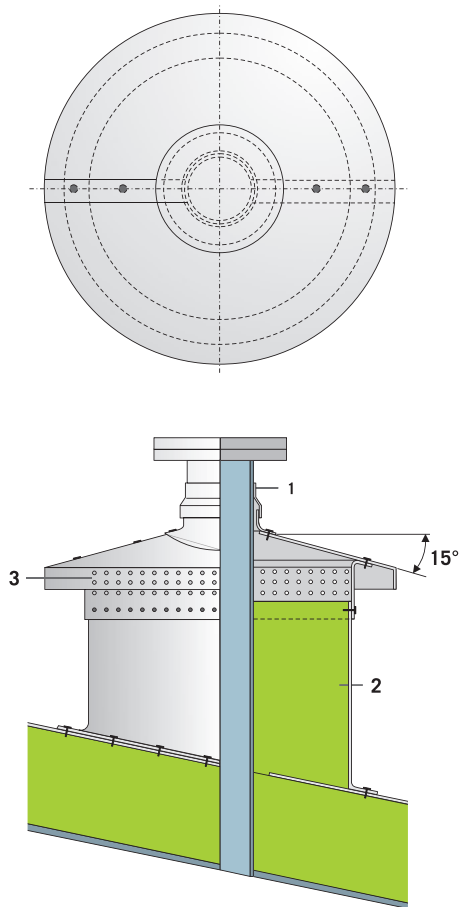

1. Sealing tape - 2. Insulation: e.g. Rockwool Duraflex -
3. Perforated sheet (ventilation)

Foot traffic

Tank roofs are subject to foot traffic. To ensure the insulation system is resistant to foot traffic, apply a pressure-resistant slab such as Rockwool CRS. If the radius of the tank roof is too large to allow the use of a rigid board, use a flexible slab such as Rockwool Multiboard in combination with a (local) metal support construction. The walkways need to be clearly marked.

Watertight covering

Conventional systems for tank roof insulation are often sensitive to weather damage (water, wind, etc.) and the effect of chemicals. The costs of maintenance, and the consequently lower operational safety, are often higher than the (energy) cost-savings that are realized by the insulation. For this reason, many tank roofs, especially in the lower temperature ranges, are not insulated.

- Rocktight is applied directly on Rockwool tank roof insulation on site. As direct cladding supports are no longer needed, it fits seamlessly to all parts of the tank and has an unequalled hardness and mechanical strength (e.g. can be walked upon).
- In situations exposed to high wind stresses, a special cable construction can be applied. This will hold the insulation in place under the most extreme weather conditions.
- An anti-slip coating is available that can easily be applied to Rocktight.
- The absence of cladding supports virtually eliminates any risk of corrosion under the insulation.
- This ensures perfect protection to the insulation and storage tank, which guarantees the durability of the insulation.

For more information please contact our RTI-staff.



Rocktight – for durable protection

Rockwool Rocktight is a fibreglass reinforced polyester mat positioned between two sheets of foil.

The material contains resins, glass fibres and a special filling agent. It is soft and flexible when unprocessed. It can be cut or timed in any shape and easily mounted onto the insulation in this state.

The polyester then hardens when exposed to ultraviolet (UV) light. Once hardened, Rocktight is absolutely watertight and forms a mechanical protection for the insulation.

1. System solutions

1.6 Insulation of boilers

Hot water boilers and boilers for the production of water vapour under high pressures are considered to be steam boilers. As a generic term, boiler is used to denote steam generators and hot water installations.

Insulating boilers has the following purposes:

- Reduces heat losses and increases the efficiency of the boiler
- Guarantees protection against contact by minimising the surface temperature
- Prevents heating of the compartment air in the boiler house, which guarantees an acceptable working

The design and functionality of the boilers on the market is so varied that the examples of use cannot fully take into account the particular circumstances of each case. Determine whether the products and construction described are suitable for the corresponding application in each individual case. In if doubt, consult the RTI Sales Team.

The applicable standards and regulations must also be observed. A few examples follow:

- DIN 4140 (Insulation works on industrial plants and building services installations)
- AGI Q101 (Insulation works on power plant components)
- CINI-Manual: "Insulation in industry"


1.6.1 Insulation of fire tube boilers

Fire tube boilers are often used in small and medium-sized industrial plants, where small and medium-sized mixtures of hot water or water vapour are required at low pressures. These boilers are used in the technical building appliances of large complexes, such as hotels, hospitals etc.

The fire tube boiler consists of a horizontally positioned cylindrical casing body with diameters of up to four metres. The interior generally contains a corrugated flame tube, where a fuel, which is usually oil or gas, is burnt. At the end of the boiler are so called reversing chambers, where the flue gas is reversed and pumped back through the boiler. Depending on the design, the boiler will have one or more gas flues, connected at the rear or the front base through the reversing chamber. The chamber surrounding the gas flues and the fire-tube is filled with the water to be heated.



Fire tube boiler

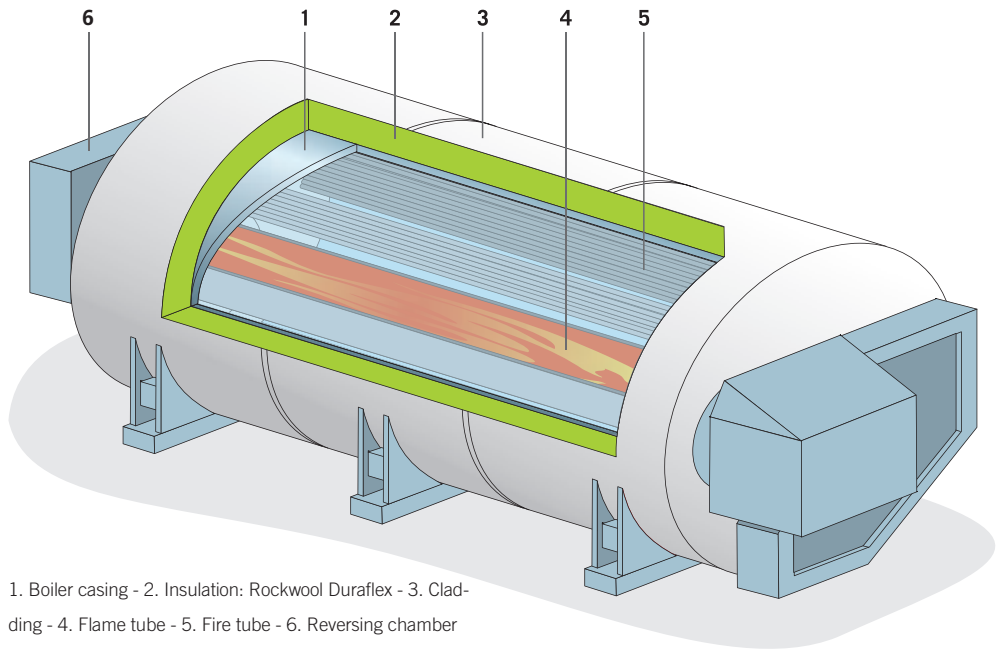

1. Boiler casing - 2. Insulation: Rockwool Duraflex - 3. Cladding - 4. Flame tube - 5. Fire tube - 6. Reversing chamber


Applying load bearing mats such as Rockwool Duraflex is a proven solution in the insulation of flame tube-smoke tube boilers. These mats are easily mounted onto the horizontal, cylindrical boiler surface and are easily fastened to the boilers with metal straps. Metal spacers, which always create thermal bridges, can be omitted. Due to the compression resistance of at least 10 kPa, the cladding can be mounted directly onto the Duraflex insulation. Alternatively, if the sheet cladding is fitted so closely that it can adopt this function, the fastening straps can be omitted. The insulation is characterised by a consistent rigidity and surface. Due to the lack of spacers, it guarantees an

even surface temperature without temperature peaks (so called hot spots), which pose a hazard in the form of skin burns. The balanced surface temperature profile also accounts for the thermography of a flame fire tube boiler shown on this page. Wired mats are generally used to insulate the area of reversing chambers and are secured with pins and spring clips.

1.6 Insulation of boilers

1.6.1 Insulation of fire tube boilers

The thermography of a flame tube-smoke tube boiler, which is insulated with Rockwool Duraflex. (Source LOOS INTERNATIONAL, Loos Deutschland GmbH) The areas insulated with Rockwool Duraflex show an even temperature distribution without visibly, increased hot spots. The right image shows the position of the thermographic camera. Reading point Sp1 has a temperature of 21.7 °C; reading point Sp2 is 21.2 °C and reading point Sp3 is 22.8 °C.

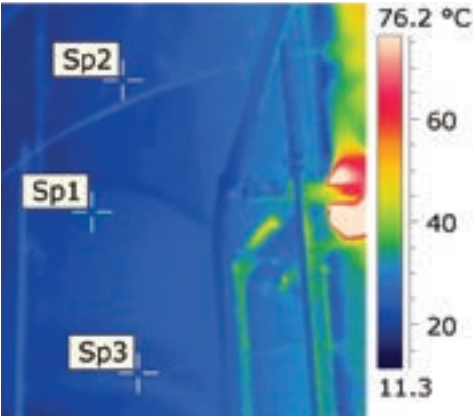

Insulation works on a fire tube boiler with Rockwool Duraflex



1.6.2 Supercritical steam generators

In the modern energy and heat economy, super critical steam generators, which burn fossil fuels such as mineral coal, brown coal and anthracite etc. are used to generate steam to operate steam turbines. In current utility steam boilers, up to 3,600 t steam is generated per hour under pressures of 300 bar and steam temperatures of 620 °C. The most common type is the Benson boiler, that is operated by forced circulation (with boiler feed pumps). In contrast to fire tube boilers, the water or vapour is not located in the vessel, but in pipes, which are fitted in gas-tight, welded tube-fin constructions and form the walls of the boiler. Generally constructed as single-pass or two-pass boilers, these boilers reach levels of up to 160 m, depending on the fuel used. The bottom contains the furnace, where finely ground fuel is burned. The flue gases flow through the boiler and heat the water in the pipes, thereby causing it to evaporate. The boiler casing is suspended on a frame and can compensate for any thermal expansions that occur during operation (vertical and horizontal expansions). These types of expansions must be considered during the design of the insulation system. The diagram on the right shows the most important technical components in the insulation of a boiler.

Buckstays


So-called buckstays are fitted horizontally at regular intervals around the boiler. Buckstays are reinforcement elements, which prevent the boiler from bulging. A distinction is made between hot buckstays, which are located inside the insulation, and cold buckstays, which are located outside the insulation sections.

Dead spaces

Dead spaces are located in front of the boiler wall or boiler roof, where installation components such as collectors, distributors or pipes are fitted. The dead spaces are located inside the insulation.

Handles

Handles are reinforcement elements, which are fitted vertically between the buckstays and bear the vertical loads exerted on the buckstays on the boiler wall. Handles can be located inside and outside the insulation sections.

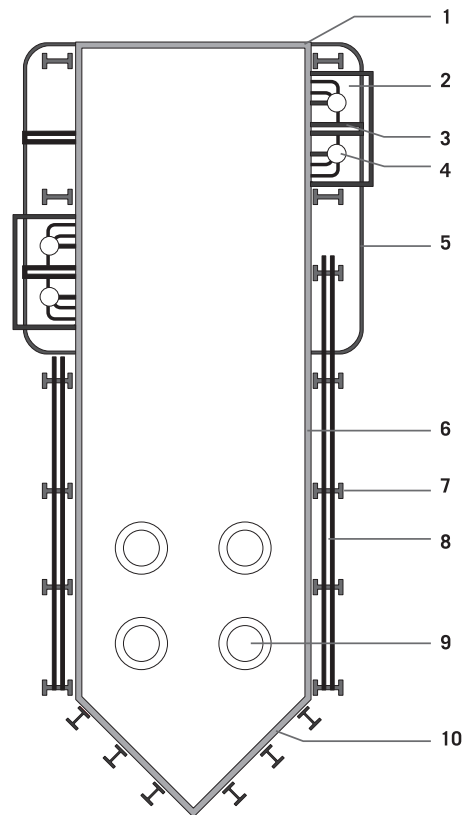

1. Boiler roof - 2. Dead space - 3. Cross bar - 4. Collector -
5. Boiler support tube - 6. Boiler wall - 7. Buckstay -
8. Handles - 9. Burner port - 10. Boiler funnel

1.6 Insulation of boilers

1.6.2 Supercritical steam generators

Installation of the insulation system for utility steam generators


The following product characteristics are important when selecting a suitable insulation system for utility steam generators:

- The insulations used must be non combustible.
- The maximum service temperature of the insulation must be higher than the operating temperature of the installation component to be insulated
- The thermal conductivity must be specified as a function of the temperature.
- The (longitudinal) air flow resistance must be as high as possible. High flow resistances reduce convection in the insulation.

In addition to protection against contact and the maximum permissible surface temperatures of 60 °C, industrial parameters such as efficiency factors must be considered during the design of the insulation thickness. The AGI guideline Q101, "Insulation works on power plant components" recommends that the insulation layer thicknesses for power plant components is designed for a maximum heat flow rate density of 150 W/m². In view of rising energy prices and the socio political target of CO₂-emission reductions, this generally recommended value is, however, subject to critical analysis. From an economic and environmental perspective, a design parameter of well below 150 W/m² is often sensible. Rockwool wired mats have proven invaluable in the insulation of utility steam generators over the years. They are flexible and can be easily mounted onto the various geometries or surface structures. Rockwool wired mats are non combustible, have high maximum service temperatures and exhibit a low degree of thermal conductivity across the entire temperature range.

The insulation is assembled in multiple layers, comprising two to three layers of insulation. The ProRox WM wired mats with a maximum service temperature of 680 °C are a tried and tested solution as a first insulating layer in upper temperature ranges, as are often encountered in dead spaces. The further layers of insulation are constructed with ProRox WM 80 or WM 70 wired mats, depending on the temperature of the adjacent layer. In accordance with AGI guideline Q101, galvanised wire netting and galvanised stitching wire in wired mats can only be heated up to a temperature of 400 °C. With temperatures above 400 °C, austenitic stainless steel wire netting and stitching wire must be used. To reduce the convection in the insulation of vertical constructions such as boilers, only use insulations that exhibit an air flow resistance of ≥ 50 kPa s/m².

Diagram of a boiler insulation system with wired mats

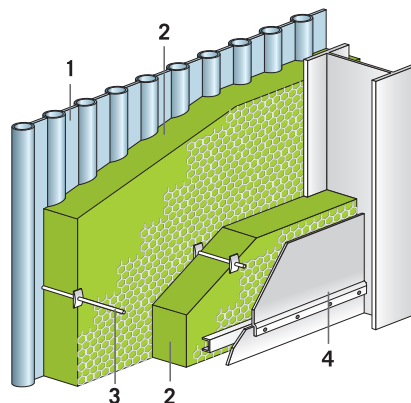

1. Tubed wall - 2. ProRox WM wired mats - 3. Fastening pins with spring plates - 4. Cladding

Before starting the insulation works, ensure that all preparatory work on the object has been completed. Refer to Chapter 1.1 for details.


The wired mats are fastened to flat surfaces with at least six pins per m², and on the underside with at least ten pins per m². The pins are either welded directly onto the surface of the object or are screwed into nuts. With finned walls (tube-fin walls), the pins cannot be fixed to the pipes, but must be welded onto the bars between the pipes. Observe the following when pinning the insulation:

- With insulation thicknesses ≤ 120 mm, use pins with a minimum diameter of 4 mm.
- With insulation thicknesses ranging from 130 to 230 mm, use pins with a minimum diameter of 5 mm.
- With insulation thicknesses ≥ 240 mm use pins with a minimum diameter of 6 mm.
- If the cladding rests directly on the insulation without a gap between the two, the pins must be 10 mm shorter than the insulation thickness.
- Fasten each insulation layer with clips.

With wired mats, all the lengthwise and crosswise joints must be sewn or wired together, or joined with six mat hooks per metre. If the insulation is assembled in multiple layers, the joints of the individual insulation layers must be staggered.

The following illustrations show a number of typical methods of insulating vessels.

Diagram of a boiler insulation system with wired mats with a gap between the insulation and sheet cladding

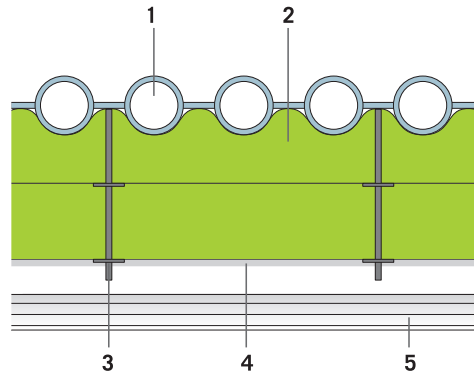


1. Finned pipe - 2. Insulation: ProRox WM wired mats - 3. Fastening pins with spring plates - 4. Aluminium foil if necessary - 5. Metal cladding (e.g. profiled sheet)

1.6 Insulation of boilers

1.6.2 Supercritical steam generators

Diagram of a wired mats boiler insulation system with no gap between the insulation and sheet cladding

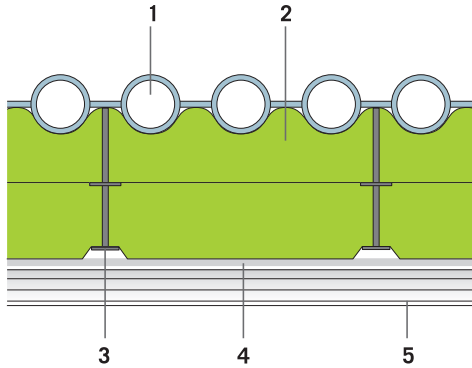

1. Tube wall - 2. Insulation: ProRox WM wired mats –
3. spring plates - 4. Aluminium foil if required - 5. Cladding (e.g. profiled sheet)

Convection in the insulation


With vertical insulation constructions in particular, where cavities can form on the heated side between the object and the insulation, there is an increased risk of heat losses – caused by convection in the insulation. This risk equally applies to finned walls, as an insulation that follows the contours of the object, in which the cavities in the area of the bars are sealed, cannot always be secured. Take the following measures to prevent convection:

- Construct vertical barriers at intervals of 5 to 8 m.
- Only use insulations with a longitudinal flow resistance of $\geq 50 \text{ kPa s/m}^2$.
- Fitting an aluminium foil between the individual insulation layers and/or on the exterior is recommended.

Barriers

The following diagrams show two designs for vertical barriers. Depending on the temperature or structural requirements, the barrier can be manufactured from sheet metal ($\geq 0.5 \text{ mm}$) or aluminium foil ($\geq 80 \mu\text{m}$).

The barrier must be fastened to the object on the heated side and must reach to the cladding on the cold side. Fill interstices with loose rock wool. Where the insulation is constructed in multiple layers, cascade the barriers.

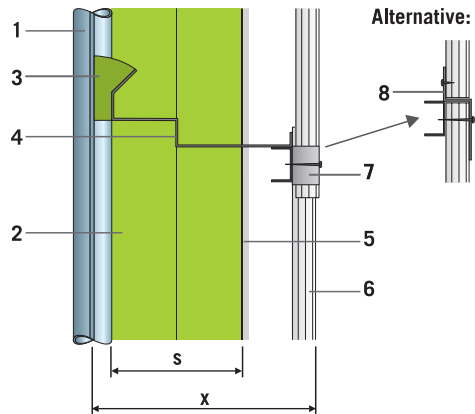


1. Boiler wall - 2. Insulation: ProRox WM wired mats - 3. Fill with loose rock wool - 4. Convection barrier sheet - 5. Aluminium foil if required - 6. Metal cladding - 7. MF profile filling - 8. Z-profile separating sheet

Insulation of the buckstays

Buckstays that are exposed to heat are insulated and fitted with a casing. An example follows.


Buckstays exposed to heat on a boiler wall

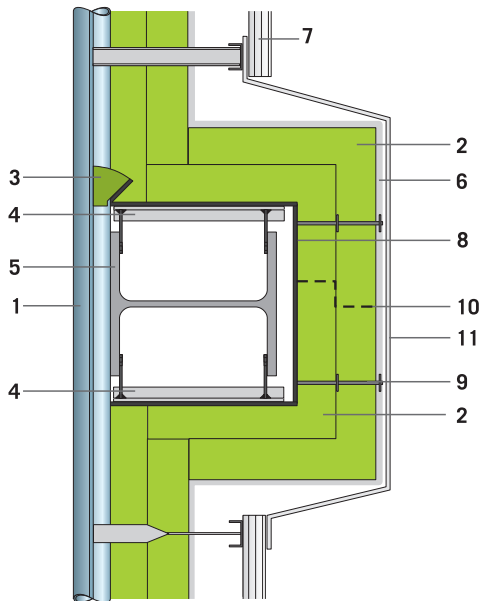

1. Boiler wall - 2. Insulation: ProRox WM wired mats - 3. Fill up with loose rock wool - 4. Support construction -
5. Buckstay exposed to heat - 6. Aluminium foil if required -
7. Cladding/Preformed sheet - 8. Internal buckstay cover, made from black sheet - 9. Mat pins with clips -
10. Aluminium foil barrier - 11. Flat sheet cladding

Buckstays that are exposed to cold are generally not insulated and not cladded. An example follows.

Buckstays exposed to cold on a boiler wall

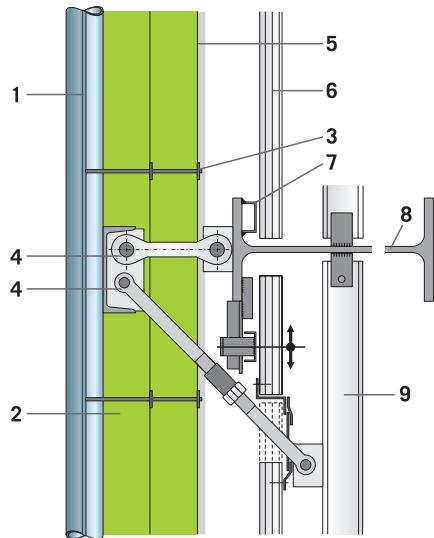

1. Boiler wall - Insulation: ProRox WM wired mats - 3. Mat pins with clips - 4. Buckstay deflectors - 5. Aluminium foil if required - 6. Metal cladding/profiled sheet - 7. Substructure -
8. Cold buckstay - 9. Boiler handle


1.7 Insulation of flue gas ducts

1.6.2 Supercritical steam generators

Insulation of dead spaces

Dead spaces located in front of the boiler wall or roof containing installation components, are enclosed with cladding, to which the insulation is then mounted. Use a non-scaling sheet with a minimum thickness of one mm. Fasten the sheets to appropriate, structurally measured substructures so that the thermal expansions can be accommodated. The insulation is secured to the dead space sheeting with pins as described above. An example of dead space insulation follows.

Dead space for boiler wall collector

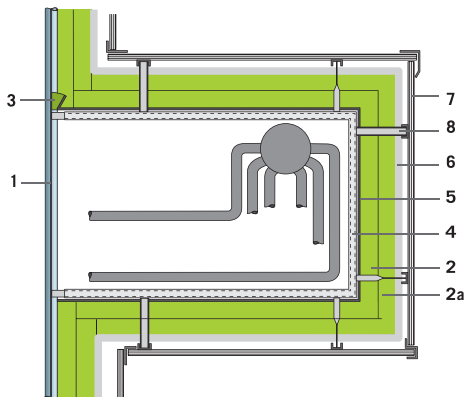

1. Boiler wall - 2. Insulation: ProRox WM wired mats -
3. Fill up with loose rock wool - 4. Support construction -
5. Dead space sheeting - 6. Aluminium foil if required -
7. Metal cladding/Preformed sheets - 8. Support construction and spacer

Support construction and spacer

There are various options available to attach support constructions and spacers to boilers. They can be mounted directly onto the boiler, to auxiliary constructions, to buckstays, cross bars or handles. When selecting the support construction and spacer and the corresponding attachment option, a design matching must take place between the insulator and the plant manufacturer. With power plant components with temperatures above 350 °C, use high temperature or fireproof steel.

Cladding

With power plant components with large surface areas, such as utility steam generators, profiled sheets are used as cladding material for structural, economic and design reasons. The open spans, overlaps and connections correspond to the profile. Refer to the instructions of the relevant profiled sheet manufacturer.

When selecting a suitable cladding material, consider the following parameters: corrosion, temperature resistance, type of construction and architectural design. The contractor and customer should consult about this matter.

Galvanised steel sheeting is generally used for the insulation of utility steam generators, which are usually located inside buildings.

1. System solutions

1.7 Insulation of flue gas ducts

Burning fossil fuels produces flue gases, which are guided through flue gas ducts through the various cleaning stages, such as denitrification (DENOX) desulfurization (DESOX) and dust removal (EN), discharged into the atmosphere. Large sections of flue gas ducts are often located outdoors. They are subject to an extent to both internal and external extreme conditions. The effects of external atmospheric influences, such as wind and rain, as well as varying ambient temperatures on the flue gas duct, can lead to intense cooling of the flue gases internally, and therefore to the accumulation of sulphuric acids, which facilitate corrosion.

Insulation systems on flue gas ducts have the following purposes:

- Reduce heat losses in the flue gas, thereby preventing sub-dew point (acid or water dew point) conditions in the flue gas on the interior surfaces of the flue gas duct. This also minimises the corrosion risk. This also applies to areas with structural thermal bridges, such as support constructions, reinforcements etc.
- Reduce the heat losses in flue gas channels of heat recovery systems
- Personal protection
- Adherence to technical specifications with regard to noise

Designs are so varied in terms of their size and geometry, as well as the materials and layers used, that the examples of use below cannot fully take into account the particular circumstances of the construction-related factors.

Determine whether the products and construction described are suitable for the corresponding application in each individual case. If in doubt, consult the RTI Sales Team.

Furthermore, the applicable standards and regulations must be observed. A few examples follow:

- DIN 4140 (Insulation works on industrial plants and building services installations)
- AGI Q101 (Insulation works on power plant components)
- CINI manual: Industrial insulation

1.7.1 Installation of the insulation systems for flue gas ducts

Rockwool wired mats have been a proven solution for rectangular flue gas ducts for many years. They are flexible and can fit onto different geometries and surface structures. Rockwool wired mats are non-flammable, have high maximum service temperatures and exhibit a low thermal conductivity across the total temperature range.

Secure the wired mats to the **rectangular ducts** with welding pins and spring clips. Before the welding pins are fitted, a bonding procedure should be determined by the plant manufacturer and insulator, which does not damage any corrosion coating present on the inside and outside of the flue gas duct. For example, it may be advisable to fit the welding pins before constructing the corrosion coating.

The wired mats must be secured to flat surfaces with at least six pins per m², and on the undersides with at least ten pins per m².

Observe the following when pinning the insulation:

- With insulation thicknesses ≤ 120 mm, use pins with a minimum diameter of 4 mm .
- With insulation thicknesses ranging from 130 to 230 mm, use pins with a minimum diameter of 5 mm.

1.7.1 Installation of the insulation systems for flue gas ducts

- With insulation thicknesses ≥ 240 mm use pins with a minimum diameter of 6 mm.
- If the cladding rests directly on the insulation without a gap between the two, the pins must be 10 mm shorter than the insulation thickness.
- Fasten each insulation layer with clips.

With wired mats, all the lengthwise and crosswise joints must be sewn or wired together, or joined with six mat hooks per metre. If the insulation is assembled in multiple layers, the joints of the individual insulation layers must be staggered.

To reduce convection in the insulation, fitting barriers is recommended, for example made from steel, at intervals of 5 to 8 m when working on large vertical surfaces. The barrier must be effective across the entire section of insulation up to the cladding.

The recommended insulation for **round flue gas ducts**, where temperatures are below 300 °C, is load-bearing mats Rockwool Duraflex. These are mounted directly onto the flue gas duct and are fastened with straps. A fastening with welding pins and spring clips is generally not required in this instance.

Insulation of reinforcement elements

Large flue gas ducts are fitted with reinforcement profiles to stabilise the duct. These can consist of double T-girders, hollow sections or reinforcing ribs and form potential thermal bridges. This may cause the following problems:

- The thermal bridges cause an increased heat flow and lead to a temperature decrease on the inside wall of the ducts.

- Temperature variations between the inner and exterior lead to stress in the profiles. If the tensile forces become too great, this can lead to deformations and breaking of the welding.

Preventing temperature drops on the inside wall

To prevent a drop in temperature on the inside wall in the area of reinforcement profiles, they must always be insulated. The insulation thickness required depends on factors such as the size and geometry of the profiles, the temperature level and rate of flow within the flue gas duct and the operating method. Complex calculations may be required to determine the insulation thickness. These are usually established by the plant manufacturer, who is aware of the installation parameters. When starting up the installation, a brief drop in temperature below the dew point of the flue gas is unavoidable on the inside wall of the duct.


Reduction of stress due to temperature in the reinforcement profiles

The operating method of the installation influences the problem of stress in the reinforcement profiles caused by temperature.

Less critical is the **steady operation**, where the flue gas temperature does not change with the passage of time. Generally, stresses due to temperature are not critical if the implementation principles outlined in the AGI guideline Q101 are observed:

- The insulation thickness across the reinforcement elements should be of the same thickness as the insulation on the flue gas duct.
- In the case of ducts with reinforcing ribs up to a height of 100 mm, the thickness of the insulation layer across the ribs must measure at least one third of the insulation thickness required for the duct.

Insulation of reinforcing ribs

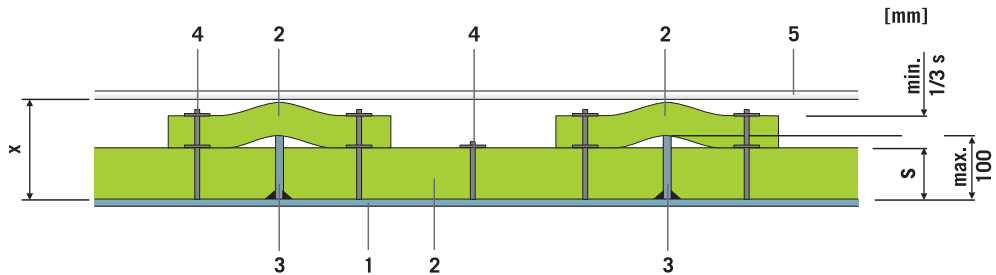

1. Duct wall - 2. Insulation: ProRox WM Wired mat -
3. Reinforcing ribs - 4. Welding pins with clips -
5. Metal cladding

In the case of **non-steady operation**, for example, when starting up the installation causes fluctuating flue gas temperatures, measures must be taken if necessary to allow even heating of the reinforcement profiles. The temperatures on the duct wall, as well as on the inside of the reinforcement element, increase rapidly when the installation is started up, whilst the outside of the profile remains cold at first and only heats up after a longer delay. This leads to temperature differences, which can cause undue stressing of the component. The extent of the temperature differences depends on numerous parameters. A few examples follow:


- The operating speed influences the speed at which temperature of the flue gas increases and the temperature difference in the reinforcement element.
- High temperature differences occur in the case of large profiles.
- The shape of the reinforcement profiles influences an even temperature distribution. Thick walled profiles, for example, do not warm up as evenly as thin walls.
- The different thermal conductivities of the materials used and the heat transfer rates lead to an uneven temperature distribution.

1.7 Insulation of flue gas ducts

1.7.1 Installation of the insulation systems for flue gas ducts

To reduce the temperature differences, the insulation must be structurally designed to enable as much heat as possible to be transported by means of radiation and convection from the duct wall to the external flange of the reinforcement profiles. The following shows the design details for a profile insulation system.


Insulation of reinforcing ribs

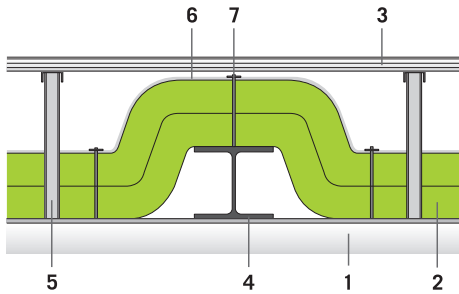

- 1. Duct wall - 2. Insulation: ProRox WM wired mats - 3. Metal cladding: corrugated sheet - 4. Reinforcing element - 5. Supporting construction and spacer - 6. Aluminium foil (optional) - 7. Welding pins/clips

This type of design is generally recommended for profiles measuring up to ≤ 240 mm in height.

Insulation of reinforcing element with cavity and covering sheet

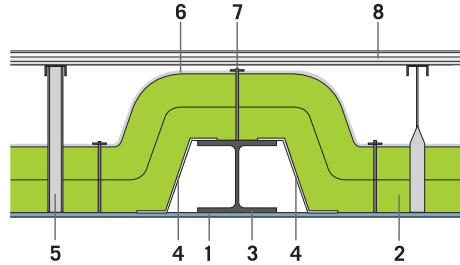

- 1. Duct wall - 2. Insulation: ProRox WM wired mats - 3. Reinforcing element - 4. Covering sheet - 5. Support construction and spacer - 6. Aluminium foil (optional) - 7. Welding pins/clips - 8. Metal cladding: corrugated sheet

In the case of profiles measuring above 240 mm in height, a covering sheet should also be installed. The heat transfer from the duct wall to the external flange is therefore not impeded and the cavities do not need to be insulated.

The profile insulation described leads to increased heat losses through convection in the case of vertical steel girders. As a result, barriers – for example in the form of sheets welded into the reinforcement elements – must be fitted at intervals of approximately 3 to 5 m to reduce convection.

1.7.2 Cladding of flue gas ducts

Due to their size and the associated high demands placed upon the flexural rigidity of cladding, flue gas ducts are encased with profiled sheets such as trapezoidal sheets. Flat sheets, which are generally cambered, can also be used. The claddings are secured to the flue gas duct using substructures.

With ducts located outdoors with flue gas temperatures of $< 120\text{ }^{\circ}\text{C}$, an air space of at least 15 mm should be left between the cladding and insulation. On clear nights, especially, there is a risk that thermal radiation in space (the small surface of the “flue gas duct” radiates on an endlessly large surface “space”), will cause the surface temperature of the cladding to fall below the dew point temperature of the ambient air. The atmospheric humidity from the ambient air can then condense on the inside of the cladding. Therefore, the insulation and cladding must not be allowed to touch. To drain the water, drill drainage or ventilation holes at the lowest point on the underside.


With round flue gas ducts, which are constructed with the spacer free insulation Rockwool Duraflex, corrugated straps or bubble wrap are inserted between the insulation and sheet cladding as a spacer.

If the duct is located outside, the upper surface of the cladding should have a gap of $\geq 3\%$. The following pages show two examples for the cladding of a flue gas duct with a pent or gabled roof.

1.7 Insulation of flue gas ducts


1.7.2 Cladding of flue gas ducts

Duct located outdoors with a cladding constructed as a pent roof

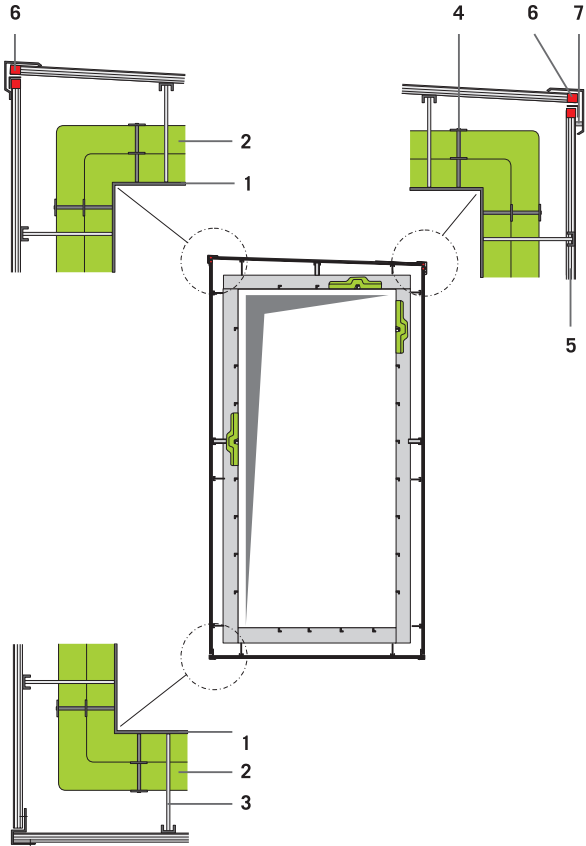

- 1. Duct wall - 2. Insulation: ProRox WM wired mat -
- 3. Support construction and spacer - 4. Welding pins/ clips - 5. Metal cladding: corrugated sheet - 6. Extension (trapezoid) - 7. Z-shaped spacer

Duct located outdoors with a cladding constructed as a saddle roof

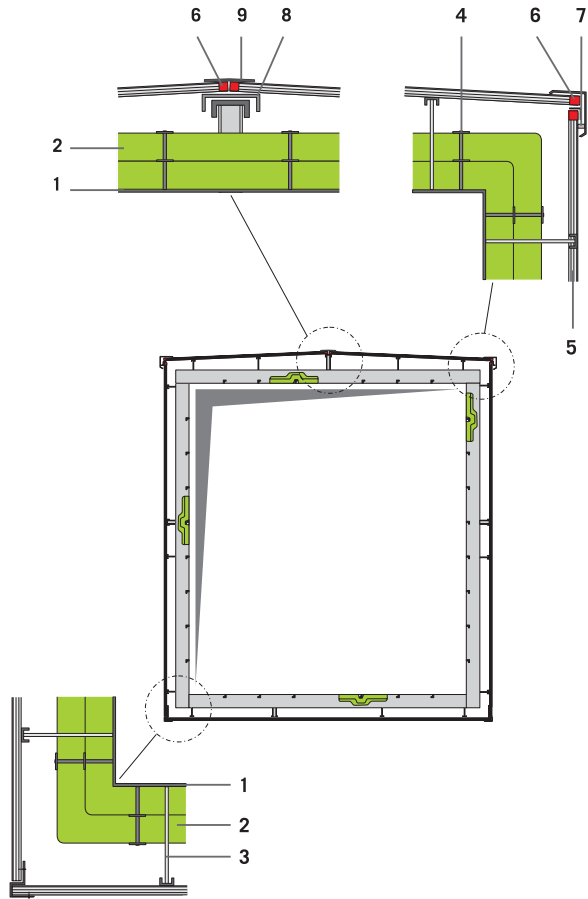

1. Duct wall - 2. Insulation: ProRox WM wired mat -
3. Support construction and spacer - 4. Welding pins/clips -
5. Metal cladding: corrugated sheet - 6. Extension (trapezoid) -
7. Z-shaped spacer - 8. Support construction - 9. Ridge

1.7 Insulation of flue gas ducts

1.7.3 Acoustic insulation of flue gas ducts

The thermal insulation of flue gas ducts influences the propagation of airborne noise and structure-borne noise. The effects of this depend on many factors, such as the frequency, the noise pressure level and the structure. The following structural measures influence the acoustic properties of an insulation system:

- Changing the insulation layer thickness and/or the apparent density of the insulation
- Changing the clear distance between the flue gas duct and the cladding
- Acoustic decoupling of the cladding from the flue gas duct using elastic elements within the support construction and spacer (e.g. omega clamp, rubber elements, steel wool pads)
- Increasing the basic weight of the cladding through the choice of material or sheet thickness
- Internal coating of the cladding with sound-deadening materials
- Construction of the insulation in multiple layers, with at least two separate insulating layers and cladding

1. System solutions

1.8 Cold boxes

Many industrial applications use gases such as oxygen, nitrogen and argon. These gases are obtained using cryogenic gas separation technology, whereby air is condensed and converted into a liquid. Afterwards, the various elements can be separated using fractional distillation.

So-called air separation plants are characterised by an extremely low temperature of as low as approximately -200°C. In addition to the risk of water and ice forming at this cryogenic temperature, there is also the risk of pure oxygen condensing against the cold parts of the system. The presence of oil and grease may be enough to cause the high concentration of oxygen to spontaneously combust. This is obviously an extremely hazardous situation. The presence of oil and grease must therefore be avoided at all times. It is vitally important to well insulate all cold parts of the system, such as vessels and pipes. Strict specifications regarding the insulation are therefore essential. A frequently applied standard for the insulation of air separation plants is the AGI Q 118 standard “insulation work on air separation plants”. This standard describes in detail the various parts of the installation and the insulation to be applied. The construction method naturally depends on the application. The following instructions are limited to the insulation of so-called cold boxes.



Cold boxes

An important component in gas separation plants are the so-called “cold boxes”. Cold boxes are (pressure) vessels that hold a gas or liquid at a very low temperature. The distinctive feature of cold boxes is the double-wall construction, which allows the insulation to be fitted between the inner and outer walls. The cold box is sealed after the insulation has been fitted, so the insulation can no longer come into contact with, for example, water, snow, dust and contaminants.

Choice of insulation

The choice of insulation material depends on a variety of parameters, including the user requirement, standards (e.g. AGI Q118), the operating temperature and the accessibility of the installation. In many cases, mineral wool fibres are used (e.g. Rockwool Granulate), which contain a very low proportion of organic substances- the so-called “Linde Quality”. This can be easily injected into the vessel and has a very long lifespan. The material is easily removed for inspection purposes.

Fitting the insulation

In compliance with the AGI Q118 standard, the fibres are fitted manually or using an injection technique. The hollow spaces in the installation must be free of water and other liquids and contaminants. All filling openings (and non-filling openings) must be sealed. An optimum result is achieved by pulling the packaged, loose fibres apart before injecting or shaking them into the vessel. The Rockwool Granulate must be injected or shaken into the unit in even layers. If necessary, the wool can then be tamped to achieve the required density. To avoid damage to the installation, manually filling certain parts of the installation may be advisable. The ultimate density of the fitted wool depends on how it is fitted.

1.8 Cold boxes

Fitting the insulation

Densities of at least 150 kg/m^3 are feasible. The official requirement according to the AGI Q118 standard is 160 to 200 kg/m^3 . The procedure is outlined step by step as follows:

1. Create a trial set up by filling a 60 x 60 x 60 cm crate with an evenly distributed layer of loose wool, with a thickness of 300 - 400 mm. Then have a man of average weight compact this layer by treading on it. Repeat this process until the box is full. Calculating the quantity of wool used (in kg) afterwards allows the feasible density to be determined. This also gives a good idea of the tamping method required in order to achieve an effective filling density.
2. Before starting to fill the cold box, fill the installation with air to create a slight overpressure. This will make any possible leaks, which can occur during the tamping process, audible.
3. The cold box is filled with an evenly distributed layer of Rockwool granulate, with a thickness of 300 mm - 400 mm. Tamp down this layer until a density is reached that corresponds to the density in step 1.
4. Repeat step 3 until the cold box is completely filled. Check the filling density by regularly calculating the number of kilograms used in relation to the filled volume. The pressure required to achieve a certain density depends on the procedure that has been followed.

Note

As Rockwool Granulate may settle after a while or the shape of the cold box may alter due to temperature fluctuations, take into account that the unit will need to be refilled.



2. Theory

Table of contents

2.1	Norms & Standards	90
2.1.1	Overview of different norms & standards	90
2.1.2	Insulation specification	90
	a) CINI Guideline	91
	b) PIP - guidelines	92
	c) ASTM standards	93
	d) European standardisation (CEN)	94
	e) DIN standards & guidelines	95
	f) AGI guidelines	95
	g) BFA WKSB guidelines	97
	h) FESI guidelines	97
	i) ISO standards	98
	j) VDI 2055 guideline	98
	k) British Standard (BS)	99
	l) Norme Française (NF)	100
	m) Document Technique Unifié (DTU)	102
2.1.3	Relevant guidelines & standards for the technical insulation industry in Germany	103
2.1.4	Relevant guidelines & standards for the technical insulation industry within the Benelux	110
2.2	Product properties & test methods	110
2.2.1	Fire behaviour	110
2.2.2	Thermal conductivity	112
2.2.3	Maximum service temperature	115
2.2.4	Water Leachable chloride content	118
2.2.5	Water repellency	119
2.2.6	Water vapour transmission	121
2.2.7	Air flow resistance	121
2.2.8	Compression resistance	121
2.2.9	Density	121
2.3	Bases for thermal calculations	122

2. Theory

2.1 Norms & Standards

2.1.1 Overview of different norms & standards

There are numerous standards, guidelines and specifications for the planning, design and construction of technical insulation systems. These regulations must be observed to guarantee the functionality, economic operation and safety of a technical installation, as well as a long service life.

Industrial plants are built and maintained according to a range of requirements, detailed in numerous technical standards that cover all design and equipment requirements.

An overview of the commonly used standards, guidelines and specifications is mentioned below.

Society standards

Published standards from an accredited standards developer. Common examples are ASTM, European Standard (EN), DIN. Often related to product performance.

Industrial guidelines for insulation

In many cases, industrial guidelines are established to ease and to reduce the development & maintenance time and effort of specifications sharing best practices. They contain detailed technical requirements for design, material selection/approval. These specifications often refer to society standards and industrial guidelines. Typical examples in industrial insulation are DIN 4140, AGI Q101, PIP, CINI.

Internal plant owner or contractor specifications

Detailed technical requirements for design, procurement, construction, and related maintenance based on a company's experience (so called best practices), e.g.:

- Shell : DEP
- British Petroleum : BPS
- Mobil standards : MS
- Exxon standards : ES

These specifications often refer to industrial guidelines and society standards

General-specific or site standards

General project or maintenance standards for common materials and equipment adopted by owners and contractors. Often, national, country-specific standards & guidelines are observed, e.g.:

- Saudi Operation Specification: SOS
- Petroleum Development Oman: POD

2.1.2 Insulation specification

The insulation specification is part of the plant owner or contractors specification. It generally contains:

- Guidelines for preparation prior to the insulation work
- Material specifications
- Mounting instructions per application

The insulation specification also often includes the guidelines for corrosion protection. Similar to other specifications, the insulation specification often refers to society standards and/or industrial guidelines.

The detailed lay-out per specification will depend on the type of application, the plant owner, contractor and country specific requirements.

A more detailed explanation of the most common standards, guidelines and specifications is given in the following documents.

- a) CINI guideline
- b) PIP guideline

- c) ASTM standards
- d) European standardization
- e) DIN standards & guidelines
- f) AGI guidelines
- g) BFA WKSJ guidelines
- h) FESI guidelines
- i) ISO standards
- j) VDI 2055 guideline
- k) British Standard (BS)
- l) Norme Française (NF)
- m) Document Technique Unifié (DTU)

The wide variety per country, application and plant owner means these documents cannot convey the entire content and so cannot claim to be complete. For specific applications, please contact our RTI-sales team for advice.

a) CINI Guideline

CINI is a Dutch association, in which various companies active in the technical insulation of industrial plants have united to develop uniform material and design guidelines. When compiling these standards, CINI works closely with many decision makers from within the insulation sector.

The CINI Standards are guidelines, yet they do not constitute national standards. Nevertheless, the CINI standards are often adopted by operators and design engineers in the Benelux countries, as well as by international companies operating in the petrochemical industry, for example, Shell. They are often used by operators and design engineers as guidelines on tendering procedures for insulation works. The CINI standards also are grouped into material standards and design rules. The validation of the material properties is based on ASTM and AGI guidelines.

2.1 Norms & Standards

2.1.2 Insulation specification

Insulation materials (Material standards)	CINI 2.2.01	Stone wool boards: Rockwool (RW) slabs for the thermal insulation of equipment
	CINI 2.2.02	Wired mats: Rockwool (RW) wire mesh blankets for the thermal insulation of large diameter pipes, flat walls and equipment
	CINI 2.2.03	Pipe sections: Rockwool sections and prefabricated elbows for the thermal insulation of pipes
	CINI 2.2.04	Loose wool: Loose rock wool without binder for the thermal insulation of valve boxes and the specification stuffing of insulation mattresses
	CINI 2.2.05	Lamella mats: Rockwool lamella mats for the thermal insulation of air ducts, pipe bundles and equipment
	CINI 2.2.06	Aluminium faced pipe sections: Rockwool sections with reinforced pure aluminium foil facing for the thermal insulation of pipes
Cladding (Material standards)	CINI 3.1.02	Aluminised steel sheeting: Aluminised steel cladding for the finishing of insulation
	CINI 3.1.03	Alu-zinc coated steel sheet: Alu-zinc steel cladding for the finishing of insulation
	CINI 3.1.04	Galvanised steel sheet: Continuous hot dip (Sendzimir) galvanised steel cladding for the finishing of insulation
	CINI 3.1.05	Austenitic stainless steel: Stainless steel cladding for the finishing of insulation
	CINI 3.1.11	GRP: Weather resistant UV-curing glass fibre-reinforced polyester (GRP)
Processing guidelines	CINI 1.3.10	General processing guidelines: Installation instructions for the thermal insulation of hot pipelines and equipment (insulated with mineral wool)
	CINI 4.1.00a	Pipes: (Overview) piping insulation details
	CINI 4.2.00	Columns: (Overview) insulation/finishing details overview columns
	CINI 4.3.00	Vessels: (Overview) insulation/finishing detail overview vertical vessels
	CINI 4.4.00	Heat exchangers: (Overview) insulation/finishing details overview horizontal heat exchangers
	CINI 4.5.00	Vessels: (Overview) insulation/finishing details for tanks (operating temperature from 20°C to 180°C)
	CINI 7.2.01	Corrosion protection: Corrosion protection under insulation

b) PIP - guidelines

Process Industry Practices (PIP) is a consortium of mainly US-based process industry owners and engineering construction contractors who serve the industry. PIP was organised in 1993 and is a separately funded initiative of the Construction Industry Initiative (CII) and the University of Texas at Austin. PIP publishes documents called Practices. These Practices reflect a harmonisation of company engineering

standards in many engineering disciplines. Specific Practices include design, selection and specification, and installation information. Some of the best practices are mentioned below.

- INIH1000 - Hot Insulation Installation Details
- INSH1000 - Hot Service Insulation Materials and Installation Specification

More information is available via www.pip.org

c) ASTM standards

ASTM International (ASTM), originally known as the American Society for Testing and Materials, is an international organisation that develops and publishes voluntary standards for a wide range of materials, products, systems and services. ASTM is older than other organisations for standardisation, such as BSI (1901) and DIN (1917), however it differs from these in that it is not a national standard-setting body. This role is performed in the USA by the ANSI Institute. Nevertheless, ASTM plays a predominant role in the specification of standards in the USA and for many international projects – particularly in the Middle East, Asia and South-America.

The ASTM standards are grouped into materials standards and validation standards for product properties. International tenders for the insulation of industrial plants often refer to relevant ASTM standards.

The ASTM annual book of standards comprises 77 volumes. The corresponding standards for insulation are incorporated into ASTM Volume 04.06 “Thermal insulation; Building and environmental acoustics”.

A relevant extract is shown below.

More information is available via www.astm.org

Materials	ASTM C592	Wired mats: “Standard specification for mineral fiber blanket insulation and blanket-type insulation (Metal-mesh covered) (Industrial type)”
	ASTM C547	Pipe sections: “Rockwool sections. For the thermal insulation of pipes. Standard specification for mineral fiber pipe insulation”
	ASTM C612	Slabs: “Rockwool (RW) slabs for thermal insulation of equipment. Standard specification for mineral fibre block and board thermal insulation”
Product properties	ASTM C335	Testing of the thermal conductivity (pipe sections): “Standard test method for steady-state heat transfer properties of pipe insulation”
	ASTM C177	Testing of the thermal conductivity (slabs): “Standard test method for steady-state heat flux measurements and thermal transmission properties by means of the guarded hot plate apparatus test method”
	ASTM C411	Testing of the maximum service temperature: “Standard test method for hot-surface performance of high-temperature thermal insulation”
	ASTM E84	Testing of the flame propagation on surfaces: “Standard test method for Surface Burning characteristics of Building Materials”
	ASTM C795	“Thermal insulation for use in contact with austenitic stainless steel”
	ASTM C692	“Evaluating the influence of thermal insulations on external stress corrosion cracking tendency of austenitic stainless steel”
	ASTM C871	“Chemical analysis of thermal insulation materials for leachable chloride, fluoride, silicate plus sodium ions”
	ASTM C1104/ C1104M	“Determining the water vapor sorption of unfaced mineral fiber insulation”
Thermal calculations	ASTM C680	Standard practice for estimate of the heat gain or loss and the surface temperatures of insulated flat, cylindrical, and spherical systems by use of computer programs

2.1 Norms & Standards

2.1.2 Insulation specification

d) European standardisation (CEN)

In order to remove technical barriers to trade, the European Union decided to develop uniform European product standards. These product standards describe the product properties, as well as the methods of testing for these properties. The minimum requirements for certain product properties still remain a national responsibility and are laid down in each individual country. The EU issues orders in the form of mandates to CEN (the European Committee for Standardisation), which the CEN uses to develop relevant standards. The majority of orders have now been commissioned and initial harmonised standards, such as the insulation standards for structural engineering (DIN EN 13262), have been published. The European product standards

for technical insulation are currently being compiled. For Rockwool, this product standard is the prEN 14303 “Thermal insulation products for building equipment and industrial installations – Factory-made mineral wool (MW) products – specification”. The official implementation of this standard is expected to take place in 2009. Following ratification, a European standard must be adopted as it stands by the national standardisation organisations as a national standard. Deviating national standards must be retracted. Each European standard adopted is published in each EU country with a national prefix, e.g. in Germany: DIN-EN-XXXX; in United Kingdom (British Standard): BS-EN-XXX. The (as of yet) unratified standards are denoted with the letters “pr” (for proof) e.g. prEN-XXXX.

Product properties, test standards

Product property	Standard	Description
Thermal conductivity (Piping)	EN ISO 8497	Heat insulation – Determination of steady-state thermal transmission properties of thermal insulation for circular pipes
Thermal conductivity (Boards)	EN 12667	Thermal performance of building materials and products – Determination of thermal resistance by means of guarded hot plate and heat flow meter methods - Products of high or medium thermal resistance
Water vapour diffusion resistance coefficient	EN 12086	Thermal insulating products for building applications – Determination of water vapour transmission properties
AS quality	EN 13468 Replaces AGI guideline Q135	Thermal insulation products for building equipment and industrial installations – Determination of trace quantities of water-soluble chloride, fluoride, silicate, sodium ions and pH
Hydrophobic treatment	EN 13472 Replaces AGI guideline Q136	Thermal insulating products for building equipment and industrial installations – Determination of short-term water absorption by partial immersion of preformed pipe insulation
Maximum service temperature	EN 14706 (for flat products) EN 14707 (for piping)	Thermal insulating products for building equipment and industrial installations – Determination of maximum service temperature Thermal insulating products for building equipment and industrial installations – Determination of maximum service temperature for preformed pipe insulation
Compression resistance	EN 826	Thermal insulating products for building applications – Determination of compression behaviour
Air flow resistance	EN 29053 Determination of airflow resistance	Acoustics; Materials for acoustical applications; Determination of airflow resistance (ISO 9053:1991)

e) DIN standards & Guidelines

Deutsches Institut für Normung e.V. (DIN; in English, the German Institute for Standardization) is the German national organisation for standardisation and is that country's ISO member body.

DIN is a registered association (e.V.), founded in 1917, originally as Normenausschuss der deutschen Industrie (NADI, Standardization Committee of German Industry). In 1926, the NADI was renamed Deutscher Normenausschuss (DNA, German Standardization Committee) in order to indicate that standardisation covered many fields, not just industrial products. In 1975 the DNA was finally renamed DIN. Since 1975, it has been recognised by the German government as the national standards body and represents German interests at international and European level.

The acronym DIN is often wrongly expanded as Deutsche Industrienorm (German industry standard). This is largely due to the historic origin of the DIN as NADI. The NADI indeed published their standards as DI-Norm (Deutsche Industrienorm, German industry standard).

Designation

The designation of DIN standards shows its origin.

- DIN # is used for German standards with primarily domestic significance or designed as a first step toward international status.
- E DIN # is a draft standard and DIN V # is a preliminary standard.
- DIN EN # is used for the German edition of European standards.
- DIN ISO # is used for the German edition of ISO standards.
- DIN EN ISO # is used if the standard has also been adopted as a European standard.

DIN standards for the validation of insulation materials can be found under European standards. DIN 4140 "Insulation work on industrial installations...." gives guidelines for the validation of insulation material, mounting and fixing. This standard applies to insulation works on industrial plants. These are production and distribution plants for the industry and for technical building appliances, (e.g. appliances, vessels, columns, tanks, steam generators, pipes, heating and ventilation systems, air conditioning units, refrigeration units and hot water installations). With requirements relating to fire protection, the relevant standards or national technical approvals must be observed. This standard does not apply to insulation works performed on building shells, interior walls and inserted ceilings, neither in the shipbuilding and vehicle manufacturing industry, nor within the control area of power plants.

f) AGI

"Arbeitsgemeinschaft Industriebau e.V.". (AGI) is a German association of manufacturers, engineering companies and universities. AGI was founded in 1958 to establish a common platform to exchange best practices within Industry.

These practices, which are summarised in the AGI guidelines (so called "Arbeitsblätter") are established in cooperation with the German DIN, VDI and CEN members for insulation. The most relevant standard for insulation work is shown on the next page.

More information is available via www.agi-online.de.

2.1 Norms & Standards

2.1.2 Insulation specification

Material standards and design guidelines	Field of application/scope
AGI Q02: Insulation works on industrial installations – Terms	The terms used in the AGI Q working documents are defined in this working document.
AGI Q03: Construction of thermal and cold insulation systems – Insulation works of industrial plants	This working document applies to insulation works performed on industrial installations. The working document classifies works into thermal insulation works for operating temperatures above the ambient temperature and cold insulation works for operating temperatures below the ambient temperature.
AGI Q05: Construction of industrial plants – Bases, design, requirements with regard to the interfaces of plant components and insulation	This working document has been compiled for planners and designers who have to design the industrial plants, including the essential thermal or cold insulation. It examines, in particular, the interfaces between plant construction and insulation.
AGI Q101: Insulation works on power plant components – Construction	Working document Q 101 applies to insulation works performed on power plant components such as steam generators and flue gas cleaning systems, pipe systems and steel flues
AGI Q103: Insulation works on industrial plants – Electrical tracing	This working document applies to insulation works performed on industrial plants with electrical tracing.
AGI Q104: Insulation works on industrial plants – Tracing systems with heat transfer media	This working document applies to insulation works performed on industrial installations, which are heated and/or cooled by means of heat transfer and/or refrigerant media, for example in tracing pipes or half pipe sections.
AGI Q132: Rockwool as insulation for industrial plants	This working document applies to rock wool insulation, which is used for thermal, cold and acoustic insulation of technical industrial plants and technical building appliances.
AGI Q151: Insulation works – Protecting thermal and cold insulation systems on industrial plants against corrosion	This working document applies to corrosion protection coating systems for the surfaces of industrial plants, such as appliances, columns and pipes, which are insulated against heat and cold loss. Since the DIN EN ISO 12944 standard provides no explanations with regard to protecting insulation systems against corrosion, this working document should be considered as a supplement to standard DIN EN ISO 12944. This working document does not apply in respect of adhesive primers.
AGI Q152: Insulation works on industrial plants – Protection against moisture penetration	This AGI working document applies to objects where the insulation must be protected against moisture and, above all, against the ingress of liquids, (e.g. water, heat transfer oil).
AGI Q153: Insulation works on industrial plants – Mounting supports for support constructions	AGI working document Q 153 applies to the design and construction of mounting supports. They transfer the loads of the insulation onto the support constructions on the object.
AGI Q154: Insulation works on industrial plants – support constructions	AGI working document Q 154 applies to the construction of support constructions.

g) BFA WKSB

'Deutsche Bauindustrie' is a German branch organization within the building & construction industry. Part of this organization is the so called Bundes Fach Abteilungen ((BFA) - 'technical departments') who are specialized in the technological developments and lobby activities within a specific area of technical expertise. One of them, the so called "BFA WKSB" (Bundes Fach Abteilung Wärme-, Kälte-, Schall-und Brand Schutz), represents the branche members' interests in industrial insulation, acoustic insulation and fire proofing in buildings. As well as lobbying towards the various organizations and the German government, they recommend best practices and provisions as stated in the so called technical letters. These practices are established in cooperation with DIN, AGI, CEN, FESI and testing bodies like FIW. The most important technical letters for hot insulation are shown below.

Technical Letter	Field of application/scope
1	Problems of thermal stress in metal reinforcements of large-dimensional object with elevated service temperatures
3	Prevention of metal corrosion
4	System for measurement and recording for industrial insulation cladding.
5	Problems with the warranty of specified surface temperatures
6	High profitability through ecologically based insulation thicknesses
9	Methods of measuring
10	Measuring point for thermal insulation
11	Moisture in insulation systems

More information is available via www.bauindustrie.de

h) FESI

FESI, Fédération Européenne des Syndicats d'Entreprises d'Isolation is the European Federation of Associations of Insulation Companies. FESI was founded in 1970 and is the independent European Federation representing the insulation contracting sector. FESI promotes insulation as one of the best, the most cost effective and sustainable manners to save energy. FESI represents the insulation associations from 16 European countries whose members are active in insulation for industry, commercial building sectors, ship insulation, soundproofing, fire protection and others. The most important FESI documents (guidelines, recommendations) are shown below.

Document	Description
04	Working Manual: System for measurement and recording for industrial insulation cladding (English translation of BFA WKSB letter no. 4 and 2).
05	Problems associated with the warranty of specified surface temperature. (English translation of BFA WKBS, technical letter no. 5)
06	"High profitability through ecologically based insulation thicknesses. (English translation of BFA WKBS, technical letter no. 6)
09	"Principles of metal corrosion". (English translation of BFA WKBS, technical letter no. 3 and 2)
A1	A industrial Acoustics – B Building acoustics – Code of Guarantee
11	"Problems of thermal stress in metal reinforcements of large-dimensional objects with elevated service temperatures" (English translation BFA WKSB technical letter Nr. 1, 2.)
A2	Basics of Acoustics
A3	"Product characteristics " Acoustic insulation, absorption, attenuation

More information is available via www.fesi.eu

2.1 Norms & Standards

2.1.2 Insulation specification

i) ISO

The International Organization for Standardization (Organisation internationale de normalisation), widely known as ISO, is an international-standard-setting body composed of representatives from various national standards organizations. Founded on 23 February 1947, the organisation promulgates world-wide proprietary industrial and commercial standards. It is headquartered in Geneva, Switzerland.[1]. While ISO defines itself as a non-governmental organization, its ability to set standards that often become law, either through treaties or national standards, makes it more powerful than most non-governmental organizations. In practice, ISO acts as a consortium with strong links to governments. Most of the ISO standards for insulation focus on the testing of material properties and are embedded in, for instance, EN standards.

More information is available via www.iso.org

j) VDI 2055

Verein Deutscher Ingenieure (VDI) (English: Association of German Engineers) is an organisation of engineers and natural scientists. Established in 1856, today the VDI is the largest engineering association in Western Europe. The role of the VDI in Germany is comparable to that of the American Society of Civil Engineers (ASCE) in the United States. The VDI is not a union. The association promotes the advancement of technology and represents the interests of engineers and of engineering businesses in Germany.

VDI 2055 is the most important guideline for technical insulation. The scope of the guideline includes heat and cold insulation of technical industrial plants and technical building equipment, such as pipes, ducts, vessels, appliances, machines and cold stores. The minimum insulation thicknesses for heat distribution

and warm water pipes in technical building equipment with respect to Germany, are laid down in the regulations concerning energy-saving heat insulation and energy-savings in buildings (EnEV Energy Saving Ordinance). The considerations expressed in this guideline may lead to other insulation thicknesses. With regard to heat insulation in the construction industry, both the EnEV and DIN standard 4108. Legal requirements must be observed with regard to the fire performance of insulation and the fire resistance classes of insulation, such as federal state building regulations [Landesbauordnungen] and the piping system guidelines of the federal states [Leitungsanlagen-Richtlinien der Bundesländer].

The VDI guideline 2055 also serves as a benchmark for **thermo technical calculations** and measuring systems in relation to industrial and building services installations and for guarantees and conditions of supply with regard to those installations. The guideline covers in detail the calculation of heat flow rates, the design of the insulation thickness according to operational and economic aspects, the technical warranty certificate and the technical conditions in respect of delivery quantities and services. Furthermore, the guideline examines measuring systems and testing methods (for quality assurance).

The VDI 2055 consists of:

- Part 1: Bases for calculation
- Part 2: Measuring, testing and certification of insulation materials
- Part 3: Conditions of supply and purchasing of insulation systems

k) British standard

British Standards are produced by BSI British Standards, a division of BSI Group that is incorporated under a Royal Charter and is formally designated as the National Standards Body (NSB) for the UK. The standards produced are titled British Standard XXXX[-P]:YYYY where XXXX is the number of the standard, P is the number of the part of the standard (where the standard is split into multiple parts) and YYYY is the year in which the standard came into effect. British Standards currently has over 27,000 active standards. Products are commonly specified as meeting a particular British Standard, and in general this can be done without any certification or independent testing. The standard simply provides a shorthand method of claiming that certain specifications are met,

while encouraging manufacturers to adhere to a common method for such a specification.

The following table provides an overview of the standards and regulations that must be taken observed when insulating industrial plants with Rockwool insulation. On the one hand, they are grouped according to product and material standards, which establish the different insulation properties, and on the other hand, according to validation and design rules.

Standard	Description
BS 5970: Code of practice for thermal insulation of pipework and equipment in the temperature range of -100 °C to +870 °C	This important code of practice describes aspects of thermal insulation for pipe work and equipment in the temperature range -100 °C to +870 °C. It includes detailed methods of installing thermal insulation, general performance requirements and calculation methods.
BS 5422: Method for specifying thermal insulating materials for pipes, tanks, vessels, ductwork and equipment operating within the temperature range -40 °C to +700 °C	This British Standard describes a method for specifying requirements for thermal insulating materials on pipes, tanks, vessels, ductwork and equipment for certain defined applications and conditions within the temperature range -40 degrees C to +700 degrees C. It gives the recommended thickness and performance of thermal insulation material for various applications, and details thermal calculation procedures.
BS 1710 Specification for identification of pipelines and services	Colours for identifying pipes conveying fluids in liquid or gaseous condition in land installations and on board ships. Colour specifications in accordance with BS 4800.
BS 5803-Part 1: Specification for man-made mineral wool thermal insulation mats	Physical and chemical requirements and dimensions for wired mats.
BS 3958-Part 4: Thermal insulating materials. Bonded preformed man-made mineral fibre pipe sections	Physical and chemical requirements, dimensions and finishes for pipe sections generally for use at elevated temperatures."
BS 3958-Part 3: Thermal insulating materials. Metal mesh faced man-made mineral fibre mattresses	Specifies composition, moisture content, physical and chemical requirements for mineral fibre mattresses, faced on one or both sides with flexible metal mesh.
BS 3958- Part 5: Thermal insulating materials. Specification for bonded man-made mineral fibre slabs	Composition, moisture content, physical and chemical requirements, and standard sizes. Products are divided into four groups according to thermal conductivity and temperature range

2.1 Norms & Standards

2.1.2 Insulation specification

Test methods

BS 476-4 "Fire test on building materials"	Part 4, Non combustibility test for materials Part 6, Methods of test for fire propagation of products Part 7, Method for classification of the surface spread of flame products
BS 874 "Methods for determining thermal insulating properties. Tests for thermal conductivity and related properties. Unguarded hot-plate method"	Determination of steady-state thermal conductivity of homogeneous insulating solids of medium conductivity
BS 2972 Methods of testing inorganic thermal insulation materials	This standard covers the test methods for the determination of the actual product performance. Section 6: Maximum Service Temperature Section 11: Water repellency

I) NF (Norme Française) mark

The NF mark is an official French quality mark, issued by the Association Française de Normalisation (French Association for Standardization, AFNOR), which certifies compliance with the French national standards. The use of the NF mark has been entrusted to AFNOR Certification (a subsidiary of the AFNOR Group).

The NF quality mark is not a trademark as such, but is a collective certification mark. It carries undisputable proof that a product satisfies the safety and/or quality specifications defined within the corresponding certification standard.

This standard consists of:

- French, European or international standards
- Supplementary specifications regarding the product or service and the quality system in place in the company as comprised in the certification rules, specific to each product or service.

The certification standards are drawn up in collaboration with all relevant stakeholders: manufacturers or service providers, trade organisations, consumers, public authorities and technical bodies. Compliance with French standards is mandatory in France for all supply or construction contracts for public authorities (government contract).

More information is available via www.afnor.org

General	NF EN ISO 7345 July 1996	Thermal insulation – Physical quantities and definitions
	NF EN ISO 9251 July 1996	Thermal insulation – Heat transfer conditions and properties of materials - Vocabulary
	NF EN ISO 9288 July 1996	Thermal insulation – Heat transfer by radiation – Physical quantities and definitions
	NF EN ISO 8497 December 1996	Thermal insulation – Determination of steady-state thermal transmission properties of thermal insulation for circular pipes
	NF EN ISO 9229 September 2007	Thermal insulation – Vocabulary
	NF EN ISO 12241 October 1998	Thermal insulation for building equipment and industrial installations - Calculation rules Classification index P 50-730
Property	NF EN ISO 13787 August 2003	Thermal insulation products for building equipment and industrial installations - Determination of declared thermal conductivity
	NF EN 12667 July 2001	Thermal performance of building materials and products – Determination of thermal resistance by means of guarded hot plate and heat flow meter methods – Products of high and medium thermal resistance
	NF EN 8497 September 1996	Thermal insulation - Determination of steady-state thermal transmission properties of thermal insulation for circular pipes (ISO 8497:1994)
	NF EN 12939 March 2001	Thermal performance of building materials and products – Determination of thermal resistance by means of guarded hot plate and heat flow meter methods – Thick products of high and medium thermal resistance
	NF EN 14303 October 2005	Thermal insulation products for building equipment and industrial installations - Factory made mineral wool (MW) products – Specification
Test standard	NF EN 1609 July 1997	Thermal insulating products for building applications - Determination of short term water absorption by partial immersion
	NF EN 13472 December 2002	Thermal insulating products for building equipment and industrial installations – Determination of short term water absorption by partial immersion of preformed pipe insulation
	NF ISO 2528 September 2001	Sheet materials – Determination of water vapour transmission rate – Gravimetric (dish) method
	NF EN 12086 November 1997	Thermal insulating products for building applications – Determination of water vapour transmission properties
	NF EN 12087 November 1997	Thermal insulating products for building applications - Determination of long term water absorption by immersion
	NF EN 12087/A1 January 2007	Thermal insulating products for building applications - Determination of long term water absorption by immersion
	NF EN 14706 February 2006	Thermal insulating products for building equipment and industrial installations - Determination of maximum service temperature
	NF EN 14707/IN1 March 2008	Thermal insulation products for building equipment and industrial installations - Determination of maximum service temperature for preformed pipe insulation
	NF EN 14707+A1 March 2008	Thermal insulation products for building equipment and industrial installations - Determination of maximum service temperature for preformed pipe insulation
NF EN 1602 July 1997	Thermal insulating products for building applications – Determination of the apparent density	

2.1 Norms & Standards

2.1.2 Insulation specification

Test standard	NF EN 1602 July 1997	Thermal insulating products for building applications – Determination of the apparent density
	NF EN 826 September 1996	Thermal insulating products for building applications – Determination of the apparent density
	NF EN 13468 September 2002	Thermal insulation products for building equipment and industrial installations - Determination of trace quantities of water soluble chloride, fluoride, silicate, sodium ions and pH
Insulating materials	NF EN 13162 February 2009	Thermal insulation products for buildings – Factory made mineral wool (MW) products – Specification
	NF P75-101 October 1983	Thermal insulation for building purposes – Definition
Assembly	NF E86-303 May 1989	Insulation work – Thermal insulation of circuits, appliances and accessories from -80 °C to +650 °C - Part 1-1: contract bill of technical clauses - Part 1-2: general criteria for selection of materials - Part 2: contract bill of special clauses (Commercial reference for standards NF DTU 45.2 P1-1, P1-2 and P2)
	NF EN 12213	Cryogenic vessels – Methods for performance evaluation of thermal insulation
	March 1999	Cryogenic vessels – Methods for performance evaluation of thermal insulation
Covering	XP P 34-301	Steel sheet and strip either coil coated or organic film counter-glued or colaminated for building purposes
	NF EN 485	Aluminium and aluminium alloys – Sheet, strip and plate - Part 1 - 4
	NF EN 10088-2	Stainless steels – Technical delivery conditions for sheets and strips of corrosion resist- ant steels for general purposes. Part 1-5

* Please consult the other parts for further details regarding corrosion protection of steel structures.

m) Unified Technical Document (Document Technique Unifié, DTU)

Object and scope of the DTUs

A DTU comprises a list of contractual technical stipulations applicable to construction work contracts. The specific documents included in the works contract, in accordance with the specifications for each individual project, must specify all of the required provisions that are not outlined within the DTU, or all those deemed relevant for inclusion by the contracting parties, as a complement to or in deviation from those specified in the DTU.

In particular, the DTUs are generally unable to suggest technical provisions for performing work on buildings constructed using outdated techniques.

The establishment of technical clauses for contracts of this type results from a reflection on the part of those parties who are responsible for designing and implementing the work. Where it proves to be pertinent, these clauses are based on the content of the DTU, as well as on all knowledge acquired in practice in relation to these outdated techniques.

The DTUs refer to construction products or procedures for the execution of works, the ability of which to satisfy the technical provisions of the DTUs is known through experience.

Where this document refers to that effect to a Technical Evaluation or Technical Application Document, or to a product certification, the contractor may suggest products to the contracting authority that benefit from current testing methods in other Member States of the European Economic Area, which they deem to be comparable and which are certified by accredited organisations, by the organisations that are signatories to 'E.A.' agreements, or in the absence thereof, which evidence their compliance with the EN 45011 standard. The contractor must then supply the contracting authority with the evidence needed in order to evaluate the comparability.

The conditions under which the contracting authority shall accept such an equivalent are defined within the Contract Bill of Special Clauses of this DTU.

More information is available via www.afnor.org

2.1.3 Relevant guidelines & standards for the technical insulation industry in Germany

The German system of standards and regulations is primarily composed of the following constituents: DIN (German Institute for Standardisation) standards, VDI (Association of German Engineers) guidelines, AGI (German Working Group for Industrial Construction) working documents, VDI quality assurance, and RAL (German Institute for Quality Assurance and Certification) quality marks. Furthermore, there are additional regulations for special fields of application, such as working standards on the part of the operator, which must be observed. Most of the standards, regulations and guidelines are adapted within the local project specifications.

The following table shows an overview of the standards and regulations that must be observed when insulating industrial plants with Rockwool insulation. On the one hand, they are grouped according to product and material standards, which establish the different insulation properties, and on the other hand, according to validation and design rules.

2.1 Norms & Standards

2.1.3 Relevant guidelines & standards for the technical insulation industry in Germany

Material standards and design guidelines	Field of application/scope
AGI Q02: Insulation works on industrial installations – Terms	The terms used in the AGI Q working documents are defined in this working document.
AGI Q03: Construction of thermal and cold insulation systems – Insulation works of industrial plants	This working document applies to insulation works performed on industrial installations. The working document classifies works into thermal insulation works for operating temperatures above the ambient temperature and cold insulation works for operating temperatures below the ambient temperature.
AGI Q05: Construction of industrial plants – Bases, design, requirements with regard to the interfaces of plant components and insulation	This working document has been compiled for planners and designers that have to design the industrial plants, including the essential thermal or cold insulation. In examines in particular the interfaces between plant construction and insulation.
AGI Q101: Insulation works on power plant components – Construction	Working document Q 101 applies to insulation works performed on power plant components such as steam generators and flue gas cleaning systems, pipe systems and steel flues
AGI Q103: Insulation works on industrial plants – Electrical tracing	This working document applies to insulation works performed on industrial plants with electrical tracing.
AGI Q104: Insulation works on industrial plants – Tracing systems with heat transfer media	This working document applies to insulation works performed on industrial installations, which are heated and/or cooled by means of heat transfer and/or refrigerant media, for example in tracing pipes or half pipe sections.
AGI Q132: Rock wool as insulation for industrial plants	This working document applies to rock wool insulation, which is used for thermal, cold and acoustic insulation of technical industrial plants and technical building appliances.
AGI Q151: Insulation works – Protecting thermal and cold insulation systems on industrial plants against corrosion	This working document applies to corrosion protection coating systems for the surfaces of industrial plants, such as appliances, columns and pipes, which are insulated against heat and cold loss. Since the DIN EN ISO 12944 standard provides no explanations with regard to protecting insulation systems against corrosion, this working document should be considered as a supplement to standard DIN EN ISO 12944. This working document does not apply in respect of adhesive primers.
AGI Q152: Insulation works on industrial plants – Protection against moisture penetration	This AGI working document applies to objects where the insulation must be protected against moisture and, above all, against the ingress of liquids, (e.g. water, heat transfer oil).
AGI Q153: Insulation works on industrial plants – Mounting supports for support constructions	AGI working document Q 153 applies to the design and construction of mounting supports. They transfer the loads of the insulation onto the support constructions on the object.
AGI Q154: Insulation works on industrial plants – support constructions	AGI working document Q 154 applies to the construction of support constructions.

<p>DIN 4140: Insulation works on technical industrial plants and technical building appliances – Construction of thermal and cold insulation systems</p>	<p>This standard applies to insulation works on industrial plants. These are production and distribution plants for the industry and for technical building appliances, (e.g. appliances, vessels, columns, tanks, steam generators, pipes, heating and ventilation systems, air conditioning units, refrigeration units and hot water installations). In the event of requirements with regard to fire protection, the relevant standards or national technical approvals must be taken into account. This standard does not apply to insulation works performed on building shells, interior walls and inserted ceilings, neither in the shipbuilding and vehicle manufacturing industry, nor within the control area of power plants.</p>
<p>VDI 2055: Thermal and cold insulation of technical industrial plants and technical building equipment</p>	<p>The scope of the guideline includes heat and cold insulation of technical industrial plants and technical building equipment, such as pipes, ducts, vessels, appliances, machines and cold stores. The minimum insulation thicknesses for heat distribution and warm water pipes in technical building equipment are laid down with respect to Germany in the regulations concerning energy-saving heat insulation and energy-saving plant engineering in buildings (Energy Saving Ordinance) [Energieeinsparverordnung, EnEV]. The considerations expressed in this guideline may give rise to other insulation thicknesses. With regard to heat insulation in the construction industry, both the Energy Saving Ordinance and DIN standard 4108. Legal requirements must be taken into consideration with regard to the fire performance of insulation and the fire resistance classes of insulation, such as federal state building regulations [Landesbauordnungen] and the piping system guidelines of the federal states [Leitungsanlagen-Richtlinien der Bundesländer].</p> <p>The VDI guideline 2055 serves as a benchmark for thermo technical calculations and measuring systems in relation to industrial and building services installations and for guarantees and conditions of supply with regard to those installations. The guideline covers in detail the calculation of heat flow rates, the design of the insulation thickness according to operational and economic aspects, the technical warranty certificate and the technical conditions in respect of delivery quantities and services. Furthermore, the guideline examines measuring systems and testing methods (for quality assurance purposes also). The VDI 2055 guideline consists of 3 parts: Part 1: Bases for calculation Part 2: Measuring, testing and certification of insulation materials Part 3: Conditions of supply and purchasing of insulation systems Following the completion of the official draft of Part 1, the final editorial draft is being compiled. The final version is expected to be published in the second quarter of 2008.</p>

2.1 Norms & Standards

2.1.3 Relevant guidelines & standards for the technical insulation industry in Germany

The following table cites a number of important test standards for the product properties of insulation materials.

a) Test standards (Germany)

Building material class (Fire performance)	DIN 4102-1	Fire performance of building materials and building components – Part 1: Building materials, terms, requirements and tests
Melting point	DIN 4102-17	Fire performance of building materials and building components – Part 17: Melting point of rock wool insulations
Thermal conductivity (Piping)	DIN EN ISO 8497	Heat insulation – Determination of steady-state thermal transmission properties of thermal insulation for circular pipes
Thermal conductivity (Boards)	DIN EN 12667	Thermal performance of building materials and products – Determination of thermal resistance by means of guarded hot plate and heat flow meter methods - Products of high or medium thermal resistance
Water vapour diffusion resistance coefficient	DIN EN 12086	Thermal insulating products for building applications – Determination of water vapour transmission properties
AS quality	DIN EN 13468 Replaces AGI Q135	Thermal insulation products for building equipment and industrial installations – Determination of trace quantities of water-soluble chloride, fluoride, silicate, sodium ions and pH
Hydrophobic treatment	DIN EN 13472 Replaces AGI Q136	Thermal insulating products for building equipment and industrial installations – Determination of short-term water absorption by partial immersion of preformed pipe insulation
Maximum service temperature	DIN EN 14706 (for flat products)	Thermal insulating products for building equipment and industrial installations – Determination of maximum service temperature
	DIN EN 14707 (for piping)	Thermal insulating products for building equipment and industrial installations – Determination of maximum service temperature for preformed pipe insulation
Absence of silicon	According to VW test 3.10.7	This test procedure verifies whether the insulation is free from paint wetting impairment substances (e.g. silicon)
Compression resistance	DIN EN 826	Thermal insulating products for building applications – Determination of compression behaviour
Air flow resistance	DIN EN 29053 Determination of airflow resistance	Acoustics; Materials for acoustical applications; Determination of airflow resistance (ISO 9053:1991)

b) Insulation code number according to AGI Q132

AGI guideline Q132 lays down the material properties and the requirements that are imposed on rock wool insulation for industrial installations. The insulation materials are denoted with a ten-figure code number (so called “Dämmstoffkennziffer”), consisting of five pairs of digits. In this case, the first pair of digits “10”

represents rock wool. The further pairs of digits represent the:

- Delivery form
- Thermal conductivity group
- Maximum service temperature group
- Apparent density group


Rock wool insulation		Delivery form		Thermal conductivity		Maximum service temperature		Nominal apparent density	
Group	Type	Group	Form	Group	Delivery form	Group	°C	Group	kg/m ³
10	Rock Wool	01	Wired mats	01	Limit curve 1	10	100	02	20
		02	Lamella mats	02	Limit curve 2	12	120	03	30
		03	Lamella mats load-bearing	03	Limit curve 3	14	140	04	40
		04	(Pipe) sections	04	Limit curve 4	16	160	05	50
		05	(Pipe) elbows	05	Limit curve 5	•	•	06	60
		06	Felts			•	•	07	70
		07	Mats			•	•	08	80
		08	Slabs			72	720	09	90
		09	Segments			74	740	10	100
		10	Loose wool			76	760	11	110
								12	120
								13	130
								18	180
								99	*

* The digits 99 apply only to (pipe) sections.

2.1 Norms & Standards

2.1.3 Relevant guidelines & standards for the technical insulation industry in Germany

Using Rockwool wired mat with a density of 80kg/m^3 as an example results in the following insulation code:

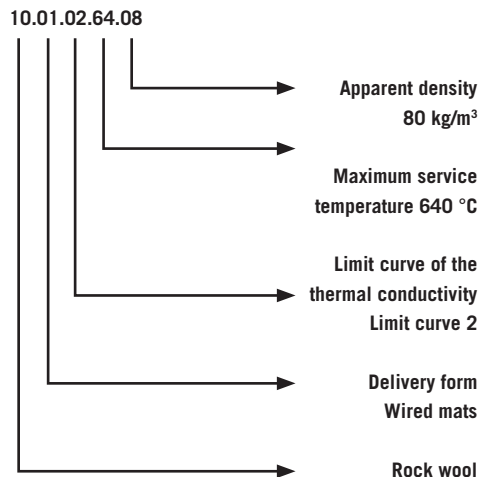

c) European standardisation

In order to remove technical barriers to trade, the European Union decided to develop uniform European product standards. These product standards describe the product properties, as well as the methods of testing for these properties. The minimum requirements for certain product properties still remain a national responsibility and are laid down in each individual country. The EU issues orders in the form of mandates to CEN (the European Committee for Standardisation), which the CEN uses to develop relevant standards. The majority of orders have now been commissioned and initial harmonised standards, such as the insulation standards for structural engineering (DIN EN 13262), have been published. The European product standards for technical insulation are currently being compiled. For rock wool, this product standard is the prEN 14303

“Thermal insulation products for building equipment and industrial installations – Factory-made mineral wool (MW) products – specification”. The official implementation of this standard is expected to take place in 2009. Following ratification, a European standard must be adopted as it stands by the national standardisation organisations as a national standard. Deviating national standards must be retracted.

Each European standard adopted is published in each EU country with a national prefix, e.g. in Germany: DIN-EN-XXXX; in England (British Standard): BS-EN-XXX. The (as of yet) unratified standards are denoted with the letter “pr” (for proof) e.g. prEN-14303.

d) Quality Assurance

It is essential that, in addition to the design quality, the product properties guaranteed by the insulation manufacturer, for example, the thermal conductivity or temperature resistance, are adhered to during processing in order to guarantee the faultless operation of a thermal or cold insulation constructed according to operational and economic criteria. Well-known insulation manufacturers guarantee this through extensive internal and external quality control. The VDI 2055 guideline “Thermal and cold insulation of industrial installations and building equipment” regulates this voluntary quality assurance.

The VDI 2055 quality assurance of insulation products is classified as a quality control, consisting of an external and internal quality control, as well as a certification of insulation materials for industrial installations. The property values specified on the product data sheets, prospectuses or price lists of the manufacturer, such as the thermal conductivity or maximum service temperature for example, form the basis for the quality control. As a result, a user or producer

of VDI 2055 quality assured insulation products can safely assume that even publicised property values are subject to a quality control. When the product conforms to the properties specified by the manufacturer in the product data sheets, the certification body grants the manufacturer the right to use the certification mark “Checked in accordance with VDI 2055”.

The following text outlines the product properties that must, at the very least, be controlled in the case of a mineral wool insulation product, in order for the VDI 2055 inspection mark to be granted:

- Thermal conductivity as a curve ($\lambda = f(t)$ or $f(tm)$)
- Dimensions (length, width, depth)
- Apparent density
- Maximum service temperature

In addition, the following product properties are usually controlled externally:

- Fire performance
- Hydrophobic properties
- Water-soluble chloride content (AS quality)

Internal quality control

The manufacturer takes samples during production and tests for the relevant product properties. For properties such as thermal conductivity, indirect measurement methods can also be used. The manufacturer must have a quality management procedure in place, which instigates the measures required to rectify the defect in the event of deviations from the reference values.

External quality control

For the purposes of external quality control in accordance with VDI 2055, the manufacturer must enter into a supervision contract with a leading testing body, such as the FIW (Research Institute for thermal insulation materials).

The external quality control is made up of the following elements:

- Auditing of the internal quality control
- Verification of the labelling of the products
- Product testing

Certification

Upon correct implementation of the internal and external quality control of insulation products manufactured according to VDI 2055, DIN CERTCO developed a certificate with regard to conformity to VDI 2055, to the data sheets of the VDI AG “Quality Control” and to the technical data of the manufacturer.

e) RAL quality mark

Rockwool stone wool insulation products bear the RAL quality mark. They are therefore subject, in addition to the stringent criteria of the quality assessment and test specifications of the Mineral Wool Quality Community [Gütegemeinschaft Mineralwolle e. V.], to continuous inspections, which guarantee compliance with the criteria of the German legislation governing hazardous substances and with the EU directive. In accordance with both the German and European standards, bio-soluble Rockwool stone wool offers outstanding thermal, cold, acoustic and fire protection whilst meeting a high safety standard.

f) No prohibition on manufacture and usage

The German federal government has laid down criteria for the appraisal of mineral wool insulation products in the Ordinance on Hazardous Substances [*Gefahrstoffverordnung*] and the Chemicals Prohibition Ordinance [*Chemikalien-Verbotsverordnung*]. Products not meeting these criteria cannot be manufactured and used in Germany. Rockwool stone wool insulation products fulfil these requirements. The prohibition on manufacture and usage does not apply to Rockwool

2.1 Norms & Standards

2.1.3 Relevant guidelines & standards for the technical insulation industry in Germany

stone wool insulation products. Rockwool mineral wool insulation products are also not considered to be a probable cause of cancer in accordance with the criteria of EU directive 97/69/EG.

2.1.4 Relevant guidelines & standards for the technical insulation industry within the Benelux

The local system of standards and regulations in the Netherlands and Belgium focuses primarily on building construction. The Dutch CINI manual is adopted as a general guideline for mounting and fixing by the majority of industry owners and construction engineers. Product testing often refers to AGI, DIN and European standards. Refer to the previous chapters for more information.

2.2 Product properties & test methods

The requirements for technical insulation are high and varied. Piping, boilers, storage tank require insulation materials with particular properties. Although the application and type of products may vary, the basic definition of all product properties is the same.

2.2.1 Fire behaviour

2.2.2 Thermal conductivity

2.2.3 Maximum service temperature

2.2.4 Water leachable chloride content

2.2.5 Water repellency

2.2.6 Water vapour transmission

2.2.7 Longitudinal air flow resistance

2.2.8 Compression resistance

2.2.9 Density

The relevant standards, guidelines and project specifications are explained in 2.1. The following text outlines the most important product properties of mineral wool insulation products for insulation of technical installations.

2.2.1 Fire behaviour

a) Introduction

The fire load in a building or technical installation is increased considerably by flammable/combustible insulation materials. Non-combustible insulation materials such as mineral wool, with a melting point higher than 1000 °C, on the other hand, not only have a positive impact on the fire load, but also constitute a certain form of fire protection for the insulation installations.

Often one confuses fire resistance with reaction to fire.

Fire resistance indicates how well a building component, for instance, can hold back the fire and prevent it

from spreading from one room to another – for a stated period of time. Does it function as a fire shield or not? Fire resistance is an extremely important characteristic. For example, a vessel containing flammable liquids. Serious accidents/explosions can occur if a vessel is not protected against fire from the outside.

Reaction to fire indicates the smoke development and combustibility / flammability if the insulation is exposed to fire.

b) CEN standards

A distinction is generally made between non-combustible and combustible building materials. The insulation materials are exposed to fire. The flammability and smoke development and droplets of melted insulation are observed and rated.

The classification of insulation materials depends on the relevant fire standards. In the second half of the 20th century, almost every country in Europe developed their own national system for fire testing and classification of building materials in particular. The European Community has developed a new set of **CEN standards**. The “Reaction to fire” classes test three properties: spread of fire, smoke intensity and burning droplets.

Spread of Fire

The building components are classified in class A1, A2, B, C, D, E and F. Additional classifications provide information on products tending to produce smoke and burning droplets or particles.

- Class A1 products are non combustible. They will not cause any sustained flaming in the non combustibility test.
- Class A2 product must not show any sustained flaming for more than 20 seconds in the non combustibility test. The A2 products have to be tested for fire contribution, smoke intensity and

burning droplets.

- Class B product flaming must not spread more than 150 mm in 60 seconds, when evaluated by a small flame test. Class B products have to be tested for fire contribution, smoke intensity and burning droplets
- Class C product contributes to flashover after 10 min.
- Class D product contributes to flashover after 2 min.
- Class E product for less than two minutes.
- Class F is not tested.

Smoke intensity

Smoke intensity is only tested in the classes from A2 to D. There are 3 intensity levels; s1, s2 and s3. Smoke intensity is vital for people trapped in a burning building. The major cause of death in these circumstances is smoke inhalation.

Burning droplets

Burning droplets are also tested on building materials in the classes A2 to E. There are three classes. No droplets (d0). Droplets that burn out in less than 10 seconds (d1) and droplets that burn for more than 10 seconds (d2).

Rockwool products

Due to its nature, mineral wool is non combustible. Therefore all plain products are classified as class A1.

c) Project specifications

Many industrial plant owners still refer to the “old” local standards or American (ASTM) Standards. Some of the most important examples are stated below.

For projects outside Europe, especially, many plant owners tend to use the American ASTM E84 or the Canadian equivalent UL723. Both standards solely focus on the surface burning characteristics (flame propagation across the surface of insulation materials).

2.2 Product properties & test methods

2.2.1 Fire behaviour

In Germany, the building material classes for insulation materials for technical insulation are classified according to DIN standard 4102-1. A distinction is made between non flammable building materials in class A1 and A2, and flammable building materials in classes B1 to B3.

- A1 non-flammable
- A2 non-flammable
- B1 flame resistant
- B2 normally inflammable
- B3 highly flammable (cannot be used in Germany)

Alongside the implementation of the European product standards for technical insulation, the “European building material classes”, the Euroclasses, are also being implemented. In that case, the products are classified in accordance with the standard DIN EN 13501-1 “Fire classification of building products and building elements – Part 1: Classification using test class data from reaction to fire tests” in combination with the specifications of the European product standard.

Other local (often building) standards may apply occasionally. e.g.:

- NEN 6064: Netherlands
- NFP 92507(class MO) France
- BS 476: United Kingdom

The RTI Sales Team can advise designers and manufacturers of installations who are faced with such requirements. Many of the Rockwool insulation materials are tested and/or certified in accordance with several local and international standards for reaction to fire.

2.2.2 Thermal conductivity

The heat-insulating effect of insulation materials is specified in terms of the thermal conductivity “ λ ”. λ is conveyed in the physical unit W/(m·K). It indicates the quantity of heat “Q” that, in “t” amount of time and at a temperature difference of “ ΔT ”, flows across the thickness “l” through the surface “A”.


$$\lambda = \frac{Q \cdot l}{A \cdot t \cdot \Delta T} = \frac{[J] \cdot [m]}{[m^2] \cdot [s] \cdot [K]} = \frac{J}{m \cdot s \cdot K} = \frac{W}{m \cdot K}$$

The unit of thermal conductivity is shown in terms of J/(m·s·K) or W/(m·K). The thermal conductivity depends on the temperature, the apparent density and the structure of the insulation and is made up of the following parts:


- Thermal conduction of the dormant air in spaces between the fibres
- Thermal radiation
- Thermal conduction through the fibres
- Convection

The fundamental dependencies of these heat transporters upon temperature and apparent density in the case of mineral wool, are clarified in the graphs below. The individual parts cannot be recorded using measurement techniques and together form the thermal conductivity of an insulation material.

Fundamental dependency of the thermal conductivity upon the apparent density at a certain temperature

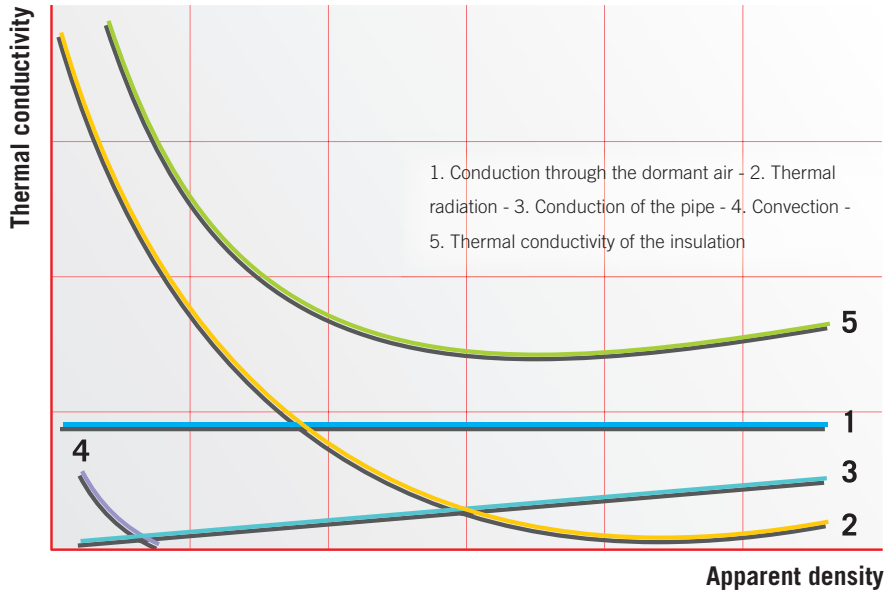

Fundamental dependency of the thermal conductivity upon the temperature for a certain apparent density

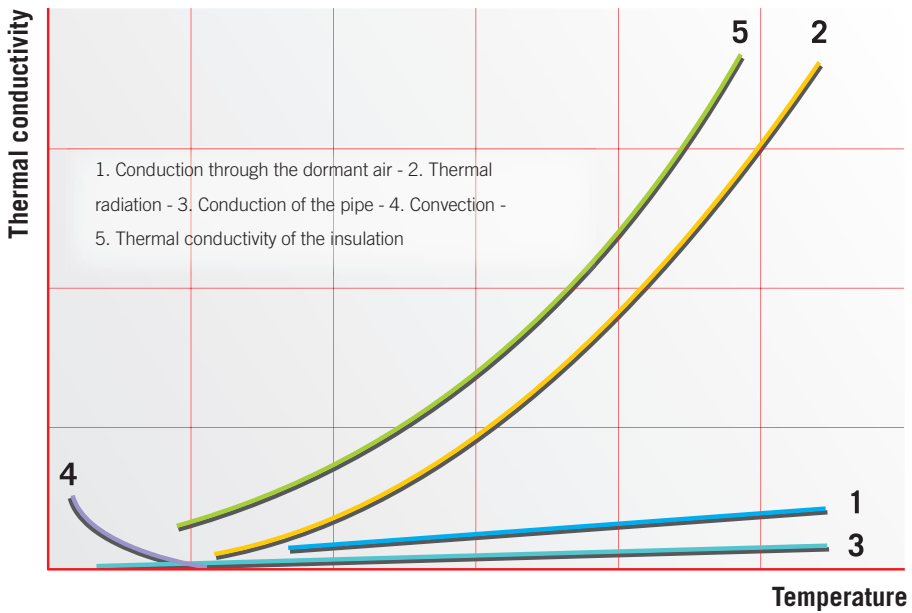


2.2 Product properties & test methods

2.2.2 Thermal conductivity

Thermal conductivities for technical insulation can be measured according to the test methods below.

Guarded hot plate apparatus test method


The thermal conductivity of flat products, slabs and wired mats can be measured with the **guarded hot plate apparatus** according to EN12677, ASTM C177 or BS874.

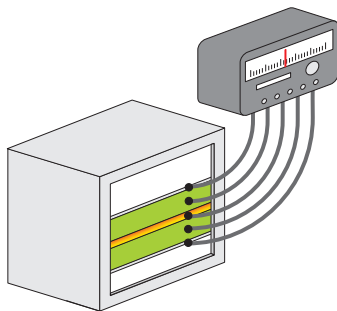

The core components of the apparatus usually consist of two cold-surface units and a guarded hot-surface unit. The insulation material to be measured is sandwiched between these units. The thermal conductivity is calculated at the mean temperature between the hot and the cold side and expressed at the hot face temperature.

Hot pipe apparatus test method

The thermal conductivity of pipe sections and flexible mats can be measured with the hot pipe apparatus according to EN ISO 8497 or ASTM C335.

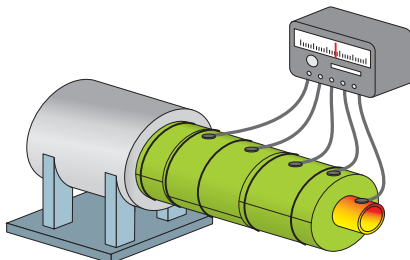

The core consists of a hot pipe with a length of 3 metres. The thermal conductivity is calculated at the mean temperature between the hot and cold side and expressed at the mean temperature. The main difference is that the hot pipe apparatus test method includes the seams within the insulation. This explains why the measured values will be higher than the guarded hot plate apparatus test.

A distinction is drawn between the definition of thermal conductivity.

- **Laboratory thermal conductivity**

Thermal conductivity is measured under laboratory conditions with the guarded hot plate apparatus or hot pipe apparatus test method.

- **Nominal (or declared) thermal conductivity**

Thermal conductivity specified by the manufacturer, allowing for production related variations in quality and possible ageing, for example caused by gas exchange in closed cell insulation materials.

- **Practical thermal conductivity**

Declared thermal conductivity including the influence of joints, design uncertainties, temperature differences, convection, changes in density, moisture absorption and ageing. These effects are taken into consideration using supplementary factors.

- **Operational thermal conductivity**

Practical thermal conductivity, whereby the supplementary values for insulation related bridges, such as bearing and support structures are included in the value.

2.2.3 Maximum service temperature

The temperature at which an insulation material is used should be within the temperature range specified for the material, in order to provide satisfactory long-term service under conditions of use.

This temperature is defined as maximum service temperature. The following factors should be considered when selecting insulation materials to be used at elevated operating temperatures.

- Ability to withstand loads and vibrations
- Loss of compression strength after heating
- Linear shrinkage after heating
- Change in thickness after heating and loading
- Internal self-heating (exothermic reaction or punking) phenomena
- Type of finishing of the insulation
- Support structures for the insulation
- Support structures for the cladding

Important notice

The maximum service temperature of insulation materials can be tested in accordance with the test methods: EN 14706 and -7 (replaces AGI Q 132), ASTM C411 or BS2972. Each test standard has a different test method and its own criteria. ASTM C411 and BS2972 can be used to determine the maximum operating temperature at which an insulation material can be used, without its insulating capacity deteriorating. EN 14706 and -7 are used to classify insulation materials according to their behaviour at high temperatures based upon time-load exposure. Due to the effect of load during testing, the measure maximum service temperature in accordance with EN 14706 and -7 is lower than the other standards and therefore tends to reflect a more practical temperature limit for design performance.

ASTM C411

ASTM C411 is the standard test method for hot-surface performance of high-temperature thermal insulation. This standard covers the determination of the performance of mats, slabs and pipe sections when exposed to simulated hot-surface application conditions.

Mats and slabs are tested with the heating plate or pipe apparatus. The heating plate or pipe is uniformly heated to the declared maximum service temperature. Products are exposed to one sided heating.

ASTM C411 places no specific demands on the product performance after heating. Only the following results must be reported.

- Extent of cracking, other visible changes
- Any evidence of flaming, glowing, smouldering, smoking, etc.
- Decrease in thickness, warpage, delamination
- Sagging pipe (pipe insulation)

BS 2972

This standard specifies test methods for the various properties of inorganic thermal insulation materials. Section six “heat stability of this standard” is designed to determine the performance of insulation materials when exposed to heating for 24 hours in an oven or furnace at the designed temperature.

BS 2972 places no specific demands on the product performance after heating. Only the following results must be reported:

- Average percentage change of length, width, thickness and volume of specimens;
- Percentage change of mass of the specimens before and after the test
- Change in compression strength of the specimens before and after the test.

2.2 Product properties & test methods



2.2.3 Maximum service temperature

According to BS 3958 “standard specification for thermal insulation materials”, the insulation material shall maintain its general form and shall not suffer visible deterioration of fibrous structure when heated to the maximum service temperature.

EN14706 (replaces AGI Q132)

The maximum service temperature replaces the term classification temperature, which was still the customary term in the AGI G 132 of 1996. It is recorded in the laboratory under steady conditions, and takes into account the delivery form. The maximum service temperature for flat products is determined according to the EN 14706 standard and is determined according to the EN 14707 for pipe sections. During the test, the sample insulation material is loaded with 500 Pa pressure, which is equal to a load of approximately 0,5 kN/m².

The sample is then heated on one side at a heating rate of 5 K/min, until the target maximum service temperature is reached. The temperature is then maintained for 72 hours, before the insulation is allowed to cool down naturally to the ambient temperature. The deformation of the insulation is measured throughout the entire procedure. The deformation is not permitted to exceed 5 % throughout the entire testing process.

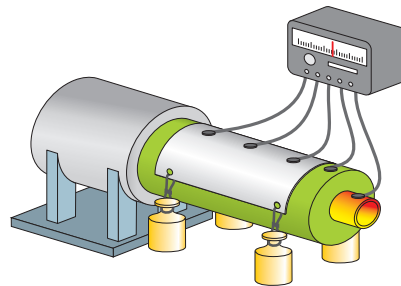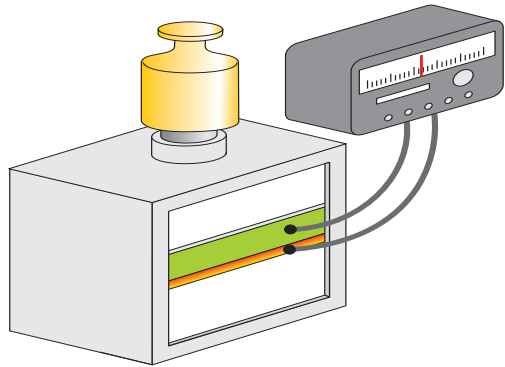

Application of maximum service temperature

The practical application of the test methods varies per country and plant owner. In case of special conditions, where the insulation is permanently exposed to high dynamic loads and temperatures (e.g. Power Plants), which cannot be included within the measurements, a considered insulation selection is required. This can be done based on expert judgement or by using the reduction factors (f_a) as defined in the German Standard AGI Q101 "Insulation works on power plant components". The calculated service temperature ('Obere Anwendungstemperatur') is generally below the maximum service temperature ("Anwendungsgrenz-

temperatur"). When selecting a suitable insulation material in terms of the maximum service temperature, the external influences affecting the insulation system must be considered, for example:

- Static loads (e.g. cladding)
- Dynamic loads (e.g. oscillations)
- Type of construction (with or without a spacer).

The table shown on the following page, showing general reduction ratios f_a for determining the working temperature, is taken from AGI Q101. In this respect, the maximum service temperature should be multiplied by f_a .

Reduction ratio (f_a) for determining the working temperature

Reduction ration (f_a)	Maximum service temperature	With spacer and support construction	Without spacer and support construction	With spacer and support construction + air space
Pipes \leq DN 500	400 °C	1.0	0.9	0.9
	580 °C	0.9	0.9	0.9
	710 °C	0.9	0.8	0.8
Pipes \geq DN 500	400 °C	0.9	0.8	0.9
	580 °C	0.9	0.8	0.9
	710 °C	0.9	0.8	0.9
Flue gas ducts, hot air ducts, steel chimneys, vessels, gas turbine ducts	400 °C	0.9	0.8	0.9
	580 °C	0.9	0.8	0.9
	710 °C	0.9	0.8	0.8
Boiler walls			0.8	
Within range of boiler roof			0.9	
Dead spaces			0.8	

2.2 Product properties & test methods

2.2.4 Water leachable chloride content

The corrosion resistance of steel is increased by the addition of alloying elements such as chromium, nickel and molybdenum. Since this alloying results in a so-called austenitic (face-centred cubic) atomic structure, these types of steel are also called austenitic steels. Despite their generally high resistance to corrosion, these steels tend to exhibit stress corrosion under certain conditions. Three boundary conditions must all be fulfilled in order for stress corrosion cracking to occur:

- The material must be susceptible to stress corrosion.
- Tensile stresses must be present in the component (for example, as a result of thermal elongations).
- There must be a specific attacking agent.

These specific attacking agents include, for example, chloride ions. An insulation material with an extremely low quantity of water-leachable chlorides must therefore be used to insulate objects made from austenitic stainless steel.

For this application, only those insulation materials that are manufactured with a low water leachable chloride content may be used. The classification criteria will depend on the used standard. In general, a distinction can be made between American ASTM standards and European EN standards.

AS-Quality (AGI Q135 – EN 13468)

The following acceptance criteria apply for insulation materials of AS-Quality. The average of six test samples must exhibit a water leachable chloride content of ≤ 10 mg/kg. The maximum value of individual measurements must not exceed 12 mg/kg.

ASTM C871

“Chemical analysis of thermal insulation materials for leachable chloride”. This standard covers the laboratory

procedures for the determination of the mentioned ions which accelerate stress corrosion of stainless steel. If the results of the chemical analysis for the leachable ions chloride, sodium and silicate fall in the acceptable area of the graph in ASTM C795 and also pass ASTM C692, the insulation material should not cause stress corrosion cracking.

ASTM C692


“Evaluating the Influence of Thermal Insulations on External Stress Corrosion Cracking Tendency of Austenitic Stainless Steel”.

This standard covers the procedures for the laboratory evaluation of thermal insulation materials that may actively contribute to external stress corrosion cracking (ESCC) of austenitic stainless steel due to soluble chlorides within the insulation. This corrosion test consists of using specimens of insulation to conduct distilled or deionized water by wicking or dripping to an outside surface, through the insulation, to a hot inner surface of stressed stainless steel for a period of 28 days. If leachable chlorides are present, they will concentrate on the hot surface by evaporation. At the conclusion of the 28-day test period, the stainless steel coupons are removed, cleaned and inspected for stress corrosion cracks. To pass the test no cracks may be found on the surface of the coupons.

ASTM C795

“Thermal Insulation for Use in Contact with Austenitic Stainless Steel”. This specification covers non-metallic thermal insulation for use in contact with austenitic stainless steel piping and equipment. In addition to meeting the requirements of this standard, the insulation materials must pass the preproduction test requirements of ASTM C692, for stress corrosion effects on austenitic stainless steel, and the confirming quality control, chemical requirements when tested

according to ASTM C871. ASTM C795 shows the results of ASTM C871 in a graph to illustrate a range of acceptable chloride concentrations in conjunction with sodium plus silicate concentrations (see graph illustration below).

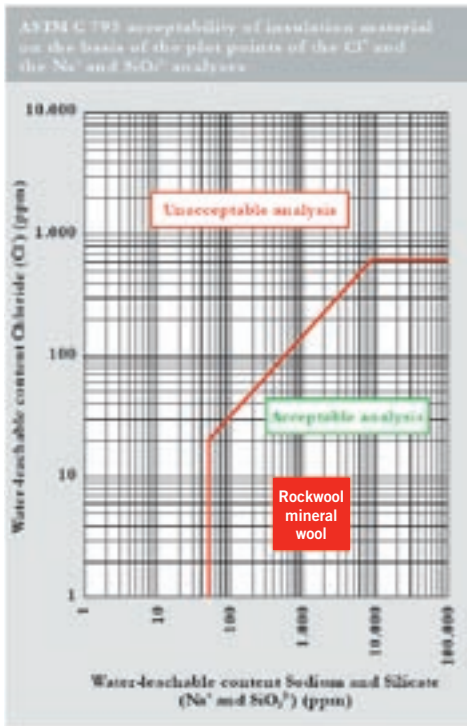

2.2.5 Water repellency


The thermal conductivity and therefore the insulating capacity of mineral wool insulation materials are considerably impaired by the penetration of moisture into the material. Wet insulation material can also contribute to corrosion. Therefore, insulation materials must be protected against moisture during storage, construction and after being fitted. To protect the material against the ingress of moisture, mineral wool insulation materials are offered with a hydrophobic treatment.

Hydrophobic treatment makes it difficult for water to penetrate into the insulation and repels water affecting the insulation from the outside. During the mineral wool manufacturing process, hydrophobic oil, which surrounds each fibre like a protective film, is added. This provides effective protection against moisture penetration across the entire insulation thickness. Hydrophobic treatment does not affect the water vapour diffusion transmission. The effectiveness of the hydrophobic treatment is temporary and depends on the level of moisture. It decreases when exposed to high temperatures. The primary objective of the hydrophobic treatment is to protect the insulation from short bursts of rainfall during installation, for example. In principle, even mineral wool insulation that has been hydrophobically treated must be protected against the ingress of moisture during transport, storage and application.

The water repellency of mineral wool insulation can be tested in accordance with several standards.

EN 1609 & EN 13472 Partial immersion

Tested in accordance with two mineral wool standards, i.e. the EN 1609 standard for slabs and the DIN EN 13472 standard for pipe insulating products. The maximum permissible water absorption in these testing procedures must not exceed 1 kg/m². Rockwool insulation products are hydrophobically treated and therefore fulfill these requirements.

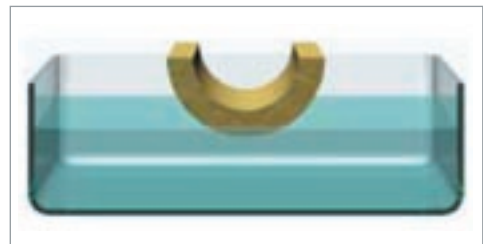

2.2 Product properties & test methods

2.2.5 Water repellency

BS 2972 Section 11 Total Immersion

“Determining the Water Absorption of Unfaced Mineral Fibre Insulation exposed to Total Immersion”


This standard covers the determination of the amount of water absorption by mineral fibre insulation. The test sample is immersed completely in tap water for two hours with the upper surface approximately 25 mm below the surface of the tap water. After the immersion period, the sample must be drained for 5 minutes. The water absorption is calculated using the weight difference before and after testing and is expressed in volume percentage.



BS 2972 Section 11 Partial Immersion

“Determining the Water Absorption of Unfaced Mineral Fibre Insulation exposed to Partial Immersion”

This standard covers the determination of the amount of water absorption by mineral fibre insulation. The test sample is immersed vertically with one 150 mm* 25 mm side 6 mm below the surface of tap water for 48 hours. After the immersion period the sample must be drained for 5 minutes. The water absorption is calculated using the weight difference before and after testing and is expressed in kilograms per square metre.

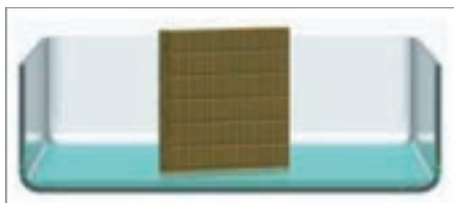

Note:

British Petroleum places specific demands on the water repellency of mineral wool products. In accordance with the BP172 standard, the samples are heated for 24 hours at 250 °C. The water repellency is tested afterwards in accordance with BS 2972 Section 11 Partial Immersion. Special water repellent grade (WRG) products are available on request.

ASTM C1104 / 1104M

“Determining the Water Vapor Sorption of Unfaced Mineral Fibre Insulation”

This standard covers the determination of the amount of water vapor sorbed by mineral fibre insulation exposed to a high-humidity atmosphere. The test samples are first dried in an oven and then transferred to an environmental chamber maintained at 49 °C and 95 % relative humidity for 96 hours. The water vapor sorption is calculated using the weight difference before and after testing and is expressed in weight percentage or volume percentage.



Caution with regard to paint shops

When using hydrophobically treated insulation materials in spraying plants, also ensure that the hydrophobic oil does not have any negative impact – e.g. by means of paint wetting impairment substances such as silicon oils – on the coating process. Rockwool stone wool insulation products are hydrophobically treated without silicon oils or silicon resins and therefore also fulfil the guidelines of the automotive industry, such as VW-Test 3.10.7. They may be used in paint shops.

2.2.6 Water vapour transmission

With installations constructed outdoors, the possibility of moisture penetrating the insulation system or being “built in” can never be ruled out. Therefore, it is important that insulation exhibits a high degree of water vapour permeability, which allows the water to escape from the installation once it has been started up through diffusion or evaporation processes. This will prevent a negative impact on the insulation properties.

2.2.7 Air flow resistance

The resistance that an insulation material offers against the flow of air is referred to as air flow resistance. It depends on the apparent density, the fibre dimensions, the fibre orientation and the proportion of non-fibrous elements. It determines the level of convection in the insulation and its acoustic-technical properties. The air flow resistance is expressed in terms of Pa s/m² and describes the relationship between the pressure difference and flow rate in an insulation material of one metre thickness.

One of the factors that influences convection in an insulation material is its flow resistance. This is important when insulation materials adjoin air spaces, such as finned walls in boilers, and there are no airtight roofs or intermediate layers (foils). When such thermal insulation materials are constructed vertically, the

longitudinal flow resistance should therefore measure at least 50 kPa s/m² in accordance with EN 29053.

2.2.8 Compression resistance

The resistance that an insulation system offers to external mechanical loads (wind loads, people, cladding loads) is influenced by factors including the pressure resistance of the insulation. The compressive stress of mineral wool is preferably specified at 10 % compression. The compressive strength is the ratio of the strength under a predetermined compression to the loaded surface of the test sample, as identified during a compression test in accordance with EN 826.

2.2.9 Density

The density of mineral wool products is the amount of fibres per cubic metre. Special care should be taken when comparing only the densities of insulation products. Density influences several product properties. It is however not a product property itself. A common assumption is that the higher the density, the more the compression resistance, maximum service temperature and thermal conductivity will improve. This is only correct to a certain extent. A few examples:

Binder content

During the manufacture of mineral wool products, a so called binder is added to glue/form the fibres into the desired shape. The binder content positively influences the compression strength, but due to its organic compounds has a negative effect on the maximum service temperature and fire resistance.

Thermal conductivity

For high temperatures it is often better to use high density (less radiation) mineral wool insulation. At temperatures below 150 °C, the conduction throughout the fibres will be more dominant, so using a lower density product is preferable.

2.2 Product properties & test methods

2.2.5 Water repellency

Fibre structure

The (vertical, horizontal,...) orientation of the fibres influences the longitudinal air flow resistance, compressive strength, and thermal conductivity. Generally, the more “vertical” fibres, the better the compressive strength and the higher the thermal conductivity will be.

Non-fibrous particles

Non-fibrous particles or shot content in mineral wool products have a negative influence on the thermal conductivity. For example, a mineral wool product with a density of 100 kg/m³ and 15 % shot content, ((tested in accordance with ASTM C 612 on a meshed netting (150 mm, 100 mesh)), would have the same thermal conductivity as a mineral wool product with a density of 140 kg/m³ and 40 % shot content. Rockwool products have a very low shot content. Due to the unique production process, Rockwool products achieve excellent thermal conductivity, even at low densities.

Insulation selection

Every mineral wool insulation product has specific characteristics. Insulation should therefore be based on the actual product performance, not on the density.

2.3 Bases for thermal calculations

The following section outlines a number of theoretical bases for heat transfer and basic approaches to thermo-technical calculations. Detailed calculation processes are outlined in the VDI 2055, and the EN 12241 standards, as well as in various international standards, such as ASTM C 680 and BS 5970. The calculation bases are similar in all the standards. In Europe, the VDI 2055 is the most widely used and accepted calculation basis.

The calculation of multiple-layer insulation constructions is to some extent quite complex, as iterative calculation processes need to be carried out. The procedures outlined below are therefore only suitable to obtain an approximate calculation of insulation constructions. The thermo-technical engineering program “**Rockassist**” offered by RTI can be used for detailed calculations.

Heat transfer

During a thermal transfer, thermal energy is transported as a result of a temperature drop. Thermal transfers can occur through conduction, convection or radiation.

- **Thermal conduction** is the transport of heat from one molecule to another, as a result of a drop in temperature. In solid substances, the average distance between the individual molecules remains the same. In liquids and gases however, the distance changes.
- In the case of **convection**, the thermal transfer takes place in liquids and gases through flow processes. A distinction is drawn between free convection, in which the movement occurs as a result of variations in density, and forced convection, in which the flow is generated by external influences such as the wind and by blowers.
- Thermal transfer through **radiation** takes place as a result of the exchange of electromagnetic radiation between two body surfaces, which have different temperatures and are separated by radiation permeable media, such as air.

Terms

Heat quantity Q

The heat quantity is the thermal energy that is supplied to or dissipates from a body. The unit used to designate the heat quantity is J.

Heat flow Q'

The heat flow Q' is the heat quantity flowing in a body or being transferred between two bodies per time unit. The unit used to designate the heat flow is W (1W = 1J/s).

Heat flow density q

The heat flow density q is the heat flow being applied to the unit of the surface that the heat is flowing through. The unit is expressed in W/m² for surfaces or in W/m for pipes, for example. In the field of insulation technology, the heat flow density refers to the surface of the insulation system.

Thermal conductivity λ

The heat-insulating effect of insulation materials is described in terms of the thermal conductivity λ. λ is specified in the physical unit of W(m K). It indicates the quantity of heat "Q&" that, in "t" amount of time and at a temperature difference of "λT", flows across the thickness "s" through the surface

$$\lambda = \frac{Q \cdot l}{A \cdot t \cdot \Delta T} = \frac{J \cdot m}{m^2 \cdot s \cdot K} = \frac{J}{m \cdot s \cdot K} = \left[\frac{W}{m \cdot K} \right]$$

The unit of the thermal conductivity is expressed in terms of J/(m s K) or W/(m K).

Thermal conductance Λ

The coefficient of thermal conductance "Λ" indicates, for a given layer, the heat flow density flowing vertically between the surfaces over an area of 1 m² at a temperature difference of 1 K. The unit used to express the coefficients of thermal conductance is W/(m² K).

$$\Lambda = \frac{\text{Thermal conductivity}}{\text{Applied insulation thickness}} = \frac{\lambda}{s} \quad \left[\frac{W}{(m^2 \cdot K)} \right]$$

Thermal resistance R

The thermal resistance "R" is the reciprocal of the

coefficients of thermal resistance. The unit used to express the thermal resistance is (m² K)/W.

$$R = \frac{\text{Applied insulation thickness}}{\text{Thermal conductivity}} = \frac{s}{\lambda} \left[\frac{(m^2 \cdot K)}{W} \right] \text{ for walls}$$

$$R_{\text{pipe}} = \frac{\ln\left(\frac{d_a}{d_i}\right)}{2 \cdot \pi \cdot \lambda} \left[\frac{(m \cdot K)}{W} \right] \text{ for pipe insulation}$$

Surface coefficient of heat transfer α

The surface coefficient of heat transfer "α" gives the heat flow density circulating at the surface of a body in a medium or vice versa, when the temperature difference between the body and the liquid or gaseous medium amounts to 1 K. The unit used to express surface coefficients of heat transfer is W/(m²K).

Heat transfer resistance 1/α

The heat transfer resistance "1/α" is the reciprocal of the surface coefficients of heat transfer. The unit used to express the heat transfer resistance is (m²K)/W.

Coefficient of thermal transmittance k

The coefficient of thermal transmittance "k" indicates the heat flow density "q" circulating through a body, when there is a temperature difference of 1 K between the two media, which are separated by the body. The coefficient of thermal transmittance includes the thermal resistance and heat transfer components. The unit used to express coefficients of thermal transmittance is W/(m² K).

Thermal transmission resistance 1/k

The thermal transmission resistance is the reciprocal of the coefficients of thermal transmittance. The unit used to express thermal transmission resistance is (m²K)/W.

2.3 Bases for thermal calculations

$$\frac{1}{k} = \text{Heat transfer resistance}_{\text{inside}} + \text{Heat transfer resistance}_{\text{inside}} + \text{Heat transfer resistance}_{\text{outside}}$$

$$\frac{1}{k_w} = \frac{1}{\alpha_i} + R_w + \frac{1}{\alpha_a} \left[\frac{\text{m}^2 \cdot \text{K}}{\text{W}} \right] \text{ for a wall}$$

$$\frac{1}{k_R} = \frac{1}{d_1 \cdot \pi \cdot \alpha_i} + R_R + \frac{1}{d_a \cdot \pi \cdot \alpha_a} \left[\frac{\text{m} \cdot \text{K}}{\text{W}} \right]$$

for pipe insulation

Calculation bases

The heat flow density through a flat wall constructed of multiple layers is calculated as follows:

$$q = k \cdot (\vartheta_M - \vartheta_L)$$

$$\frac{1}{k} = \frac{1}{\alpha_i} + \frac{s_1}{\lambda_1} + \frac{s_2}{\lambda_2} + \dots + \frac{s_n}{\lambda_n} + \frac{1}{\alpha_a}$$

$$q = \frac{(\vartheta_M - \vartheta_L)}{\frac{1}{\alpha_i} + \frac{s_1}{\lambda_1} + \frac{s_2}{\lambda_2} + \dots + \frac{s_n}{\lambda_n} + \frac{1}{\alpha_a}} \left[\frac{\text{W}}{\text{m}^2} \right]$$

The following symbols are used in this calculation:

q	Heat flow density	W/m^2
ϑ_M	Temperature of the medium in	$^{\circ}\text{C}$
ϑ_L	Ambient temperature in	$^{\circ}\text{C}$
α_i	Surface coefficient of heat transfer inside	$\text{W}/(\text{m}^2 \text{ K})$
α_a	Surface coefficient of heat transfer outside	$\text{W}/(\text{m}^2 \text{ K})$
$s_1 \dots s_n$	Thickness of the individual layers of insulation	m
$\lambda_1 \dots \lambda_n$	Thermal conductivity of the individual insulation layers	$\text{W}/(\text{m K})$
k	Coefficient of thermal transmittance	$\text{W}/(\text{m}^2 \text{ K})$

With multiple-layer hollow cylinder (pipe insulation), the heat flow density is calculated as follows:

$$q_R = k_R \cdot (\vartheta_M - \vartheta_L)$$

$$\frac{1}{k_R} = \frac{1}{d_1 \cdot \pi \cdot \alpha_i} + \frac{\ln\left(\frac{d_2}{d_1}\right)}{2 \cdot \pi \cdot \lambda_1} + \frac{\ln\left(\frac{d_3}{d_2}\right)}{2 \cdot \pi \cdot \lambda_2} + \dots + \frac{\ln\left(\frac{d_n}{d_{n-1}}\right)}{2 \cdot \pi \cdot \lambda_n} + \frac{1}{d_a \cdot \pi \cdot \alpha_a} \left[\frac{\text{m} \cdot \text{K}}{\text{W}} \right]$$

$$q_R = \frac{\pi \cdot (\vartheta_M - \vartheta_L)}{\frac{1}{d_1 \cdot \alpha_i} + \frac{\ln\left(\frac{d_2}{d_1}\right)}{2 \cdot \lambda_1} + \frac{\ln\left(\frac{d_3}{d_2}\right)}{2 \cdot \lambda_2} + \dots + \frac{\ln\left(\frac{d_n}{d_{n-1}}\right)}{2 \cdot \lambda_n} + \frac{1}{d_a \cdot \alpha_a}} \left[\frac{\text{W}}{\text{m}} \right]$$

The following symbols are used in this calculation:

q_R	Heat flow density per m pipe	W/m
ϑ_M	Temperature of the medium in	$^{\circ}\text{C}$
ϑ_L	Ambient temperature in	$^{\circ}\text{C}$
d_1	External diameter of pipe	m
d_a	External diameter of insulated pipe	m
α_i	Surface coefficient of heat transfer inside	$\text{W}/(\text{m}^2 \text{ K})$
α_a	Surface coefficient of heat transfer outside	$\text{W}/(\text{m}^2 \text{ K})$
$\lambda_1 \dots \lambda_n$	Thermal conductivity of the individual insulation layers	$\text{W}/(\text{m K})$
k	Coefficient of thermal transmittance	$\text{W}/(\text{m}^2 \text{ K})$
$s_1 \dots s_n$	Thickness of the individual layers of insulation	m

Hint

When performing thermo-technical calculations in insulation technology, the internal heat transfer does not generally need to be considered. This simplification is based on the assumption that the medium is the same temperature as the interior of the pipe. The following terms may therefore be omitted from the calculations shown above:

$\frac{1}{\alpha_i}$ remove from the denominator in the equation for the wall

$\frac{1}{d_i \cdot \alpha_i}$ remove from the denominator in the equation for pipe insulation

The surface temperatures ϑ_0 can be calculated as follows:

$$\vartheta_0 = \frac{k_W}{\alpha_a} \cdot (\vartheta_M - \vartheta_L) + \vartheta_L \quad ^\circ\text{C} \quad \text{for walls}$$

$$\vartheta_0 = \frac{(\vartheta_M - \vartheta_L)}{\alpha_a \cdot \left(\frac{1}{\alpha_i} + \frac{s_1}{\lambda_1} + \frac{s_2}{\lambda_2} + \dots + \frac{s_n}{\lambda_n} + \frac{1}{\alpha_a} \right)} + \vartheta_L \quad ^\circ\text{C}$$

$$\vartheta_0 = \frac{k_R}{\pi \cdot d_a \cdot \alpha_a} \cdot (\vartheta_M - \vartheta_L) + \vartheta_L \quad ^\circ\text{C} \quad \text{for pipe insulation products}$$

$$\vartheta_0 = \frac{(\vartheta_M - \vartheta_L)}{d_a \cdot \alpha_a \cdot \left(\frac{1}{d_i \cdot \alpha_i} + \frac{\ln\left(\frac{d_2}{d_1}\right)}{2 \cdot \lambda_1} + \frac{\ln\left(\frac{d_3}{d_2}\right)}{2 \cdot \lambda_2} + \dots + \frac{\ln\left(\frac{d_n}{d_{n-1}}\right)}{2 \cdot \lambda_n} + \frac{1}{d_a \cdot \alpha_a} \right)} + \vartheta_L \quad ^\circ\text{C}$$

Hint

The internal heat transfer can once again be disregarded (see hint above).

The characteristic of emitting heat from a surface (e.g. the external sheet cladding) into the surrounding medium, which is usually air, is described by means of the external surface coefficient of heat transfer "a". The surface coefficient of heat transfer is made up of the rate of convection and radiation.

$$\alpha_a = \alpha_k + \alpha_r$$

The following symbols used in this calculation:

α_k the rate of convection

α_r the rate of radiation

The rate of convection consists only of free convection

(air movement due solely to variations in density as a result of temperature), forced convection (blowers, wind) or of a mixture of free and forced convection.

The convection also depends on the geometry of the building component.

The rate of radiation depends on factors such as the material of the cladding (emission ratio ϵ), the surface temperature and the orientation of the object in relation to other components.

The calculation procedures are explained in the VDI 2055 and DIN EN 12241 standards. A detailed description will not be given at this point.

Use the following procedure to obtain an approximate estimate of the external surface coefficients of heat transfer α_a . It applies in respect of the following boundary conditions:

- Applicable only for free convection
- $\Delta\vartheta = \vartheta_0 - \vartheta_L \leq 60\text{K}$
- $\vartheta_m = 0,5 \cdot (\vartheta_0 - \vartheta_L) \approx 40^\circ\text{C}$
- $d_a \approx 0,5\text{m}$

The following applies for horizontal pipes:

$$\alpha_a = A + 0,05 \cdot \Delta\vartheta \quad \frac{\text{W}}{\text{m}^2 \cdot \text{K}}$$

The following applies for vertical pipes and walls:

$$\alpha_a = B + 0,09 \cdot \Delta\vartheta \quad \frac{\text{W}}{\text{m}^2 \cdot \text{K}}$$

ϑ_0 is the surface temperature of the cladding

ϑ_L is the ambient temperature

2.3 Bases for thermal calculations

The values for A and B have been compiled for a number of materials and surfaces in the table shown below.

Surface	A	B
Aluminium, rolled	2,5	2,7
Aluminium, oxidised	3,1	3,3
Galvanised sheet, bright	4,0	4,2
Galvanised sheet, tarnished	5,3	5,5
Austenitic steel	3,2	3,4
Alu-Zinc – sheet	3,4	3,6
Non-metallic surface	8,5	8,7

Supplementary values $\Delta\lambda$ Thermal bridges

In addition to the insulation thickness, the total heat loss from insulated objects depends on thermal bridges, which have a negative impact on the insulation system. A distinction is drawn between thermal bridges caused by the insulation and thermal bridges caused by the installation.

Thermal bridges caused by the insulation system include support constructions and spacers, whereas thermal bridges caused by the installation include pipe hangings and supports, flanges and brackets.

Allowances are made for these thermal bridges in the form of supplementary factors that are multiplied by the surface coefficients of heat transfer.

Table 3 of the VDI 2055 includes relevant supplementary values for thermal bridges caused by the insulation.

The thermo-technical engineering calculation program **“Rockassist”** can be used to calculate heat losses from objects whilst allowing for thermal bridges. Please visit the rockwool-rti.com website for consulting the Rockassist program on line.





3. Tables

Table of contents

3.1	Units, conversion factors and tables	130
3.1.1	Symbols, definitions and units	130
3.1.2	Mathematical symbols	131
3.1.3	SI pre-fixes	132
3.1.4	Greek alphabet	132
3.1.5	SI units	133
3.1.6	SI derived units with special names	133
3.1.7	Compound units derived from SI-units	135
3.1.8	Temperature scales and conversions	136
3.1.9	Conversion degrees Celcius and Fahrenheit	136
3.1.10	Imperial (Anglo-Saxon) units	137
3.1.11	Conversion of energy and heat scales	140
3.1.12	Conversion power scales	140
3.1.13	Conversion of pressure scales	141
3.1.14	Conversion of SI-units into Imperial units, pre-SI units and technical scales	141
3.2	Product properties insulation and cladding materials	142
3.2.1	Insulation materials	142
3.2.2	Cladding materials	142
3.3	Usage tables	145
3.3.1	Construction materials	145
3.3.2	Fluids which are commonly used in process industry	145
3.3.3	Gases which are commonly used in process industry	146
3.3.4	Conversion factors in relation to the heat of combustion	147
3.3.5	Specific enthalpy super heated steam in kJ/kg	148
3.3.6	Density super heated steam	149
3.3.7	Dew point table	150
3.3.8	Climate data	151
3.3.9	Guidelines average velocities in pipe work	155
3.3.10	Pipe diameter	155
3.3.11	Equivalent pipe length for flanges & valves	157
3.3.12	Minimum radius Rockwool slabs	158
3.3.13	Fire curve: ISO and hydrocarbon	159

3. Tables

3.1 Units, conversion factors and tables

3.1.1 Symbols, definitions and units

Symbol	Definition	Unit
A	Area	m ²
b	Length	m
C ₁₂	Radiation coefficient	W/(m ² · K ⁴)
c	Specific heat capacity	J/(kg · K)
c _p	Specific heat capacity at constant pressure	J/(kg · K)
d	Diameter	m
f	Correction factor	-
H	Height	m
h	Enthalpy	J/kg
k	Heat transfer coefficient	W/(m ² · K), W/K, W/(m · K)
k'	Total heat transfer coefficient	W/(m ² · K), W/K, W/(m · K)
l	Length	m
m	Mass	kg
ṁ	Massflow	kg/s, kg/h
n	Operation time	a
P	Pressure	Pa
Q	Heat energy	J
Q̇	Heat flow	W
q	Heat flow density	W/m ² oder W/m
R	Thermal resistance	m ² · K/W, m · K/W, K/W
R	Specific heat capacity	J/(kg · K)
s	Insulation thickness	m
t	Time	h or s
T	Temperature (Kelvin)	K
U	Circumference	m
w	Wind speed	m/s
α	Total heat transfer coefficient (incl. cold bridges)	W/(m ² · K)





Symbol	Definition	Unit
α	Linear expansion coefficient	K^{-1}
Λ	Thermal conductance	$W/(m^2 \cdot K)$
λ	Thermal conductivity	$W/(m \cdot K)$
ε	Emissivity	-
η	Yield, efficiency	-
ϑ (also t)	Temperature	$^{\circ}C$
μ	Water vapour resistance factor	-
μ	Water vapour resistance	-
ρ	Density	kg/m^3
φ	Relative humidity	-
Ξ	Air flow resistance	$Pa \cdot s/m^2$

3.1.2 Mathematical symbols

Mathematical symbols	
=	equal to
<	less than
\leq	less than or equal to
\ll	much less than
+	plus
∞	infinite
π	pi ≈ 3.14159
\approx	approximately
>	greater than
\geq	equal to or greater than
\gg	much greater than
Δ	Difference
Σ	Sum
ln	Logarithm base e
log	Logarithm base 10

3.1 Symbols and units

3.1.3 SI pre-fixes

Decimal parts and multiples of units are conveyed by means of prefixes and corresponding symbols. Several prefixes cannot be compounded.

Name	Symbol	Conversion factor
Atto	A	10^{-18}
Femto	F	10^{-15}
Piko	P	10^{-12}
Nano	n	10^{-9}
Mikro	μ	10^{-6}
Milli	m	10^{-3}
Centi	c	10^{-2}
Deci	d	10^{-1}
Deca	da	10^1
Hecto	h	10^2
Kilo	k	10^3
Mega	M	10^6
Giga	G	10^9
Tera	T	10^{12}
Peta	P	10^{15}
Exa	E	10^{18}

3.1.4 Greek alphabet

Greek alphabet							
A α	Alpha	H η	Eta	N ν	Nu	T τ	Tau
B β	Beta	Θ θ	Theta	Ξ ξ	Xi	Y υ	Ypsilon
Γ γ	Gamma	I ι	Iota	O \omicron	Omicron	Φ ϕ	Phi
Δ δ	Delta	K κ	Kappa	Π π	Pi	X χ	Chi
E ϵ	Epsilon	Λ λ	Lambda	P ρ	Rho	Ψ ψ	Psi
Z ζ	Zeta	M μ	Mu	Σ σ	Sigma	Ω ω	Omega

3.1.5 SI units

The International System of Units, also referred to as SI (Abbreviation for French: *Système International d'unités*), embodies the modern metric system and is the most widely used units system for physical units. The system was originally established in response to demands from the field of science and research, however it is now the prevalent units system for the economic, technological and trade industries. In the European Union (EU) and the majority of other states, the use of the SI units system in official and business transactions is prescribed by law; however there are many national exceptions to this rule.

SI Base units

The SI units system is composed of seven base units. In order to use the base units for applications involving different scales, certain prefixes such as Kilo or Milli are used. These are also used in conjunction with derived units and, to some extent, with units from other systems.

Basic unit	Symbol	Quantity	Unit
Length	l	Metre	m
Mass	m	Kilogramme	kg
Time	t	Seconde	s
Electric current	I	Ampere	A
Thermodynamic temperature	T	Kelvin	K
Amount of substance	n	Mol	mol
Luminous intensity	J	Candela	cd

3.1.6 SI derived units with special names

In addition to the base units, the International System of Units also includes derived units, which are made up of one or more of these base units by means of multiplication or division. The clearly defined product of powers of the base units are not referred to as a dimension of the physical size as such, but rather the system is formally structured in that way. It is possible for example to express areas in terms of metres square (m^2) or speeds in metres per second (m/s).

Some of these compounded units are assigned names and symbols, which can even be combined once again with all of the base units and derived units. The SI unit “force” for example, the Newton ($1\text{ N} = 1\text{ kg m/s}^2$), lends itself to express the unit “energy”, the Joule ($1\text{ J} = 1\text{ kg m}^2/\text{s}^2$), which is equal to the equation Newtons multiplied by metres. The following 22 derived units have their own name and unit symbol.

3.1 Symbols and units

3.1.6 SI derived units with special names

Name	Symbol	Quantity	Unit	Expression in terms of original SI Units
Plain angle	α, β, \dots	Radian	rad	$\frac{\text{m}}{\text{m}} \left(= \frac{360^\circ}{2\pi} \right)$
Solid angle	ω	Steradian	sr	$\frac{\text{m}^2}{\text{m}^2}$
Frequency	f	Hertz	Hz	$\frac{1}{\text{s}}$
Force, weight	F	Newton	N	$\frac{\text{kg} \cdot \text{m}}{\text{s}^2}$
Pressure, stress	p	Pascal	Pa	$\frac{\text{kg}}{\text{s}^2 \cdot \text{m}} = \frac{\text{N}}{\text{m}^2}$
Energy, work, heat	E, W	Joule	J	$\frac{\text{kg} \cdot \text{m}^2}{\text{s}^2} = \text{W} \cdot \text{s} = \text{N} \cdot \text{m}$
Power, radiant flux	P	Watt	W	$\frac{\text{kg} \cdot \text{m}^2}{\text{s}^3} = \text{N} \cdot \frac{\text{m}}{\text{s}} = \frac{\text{J}}{\text{s}} = \text{V} \cdot \text{A}$
Voltage, electrical potential difference	U	Volt	V	$\frac{\text{kg} \cdot \text{m}^2}{\text{s}^3 \cdot \text{A}} = \frac{\text{W}}{\text{A}} = \frac{\text{J}}{\text{C}}$
Electric charge or electric flux	Q	Coulomb	C	A · s
Magnetic flux	ϕ	Weber	Wb	$\frac{\text{kg} \cdot \text{m}^2}{\text{s}^2 \cdot \text{A}} = \text{V} \cdot \text{s}$
Electrical resistance	R	Ohm	Ω	$\frac{\text{kg} \cdot \text{m}^2}{\text{s}^3 \cdot \text{A}^2} = \frac{\text{V}}{\text{A}}$
Electrical conductance	G	Siemens	S	$\frac{\text{s}^3 \cdot \text{A}^2}{\text{kg} \cdot \text{m}^2} = \frac{1}{\Omega}$
Inductance	L	Henry	H	$\frac{\text{kg} \cdot \text{m}^2}{\text{s}^2 \cdot \text{A}^2} = \frac{\text{Wb}}{\text{A}}$
Electrical capacitance	C	Farad	F	$\frac{\text{A}^2 \cdot \text{s}^4}{\text{kg} \cdot \text{m}^2} = \frac{\text{C}}{\text{V}}$
Magnetic field	B	Tesla	T	$\frac{\text{kg}}{\text{s}^2 \cdot \text{A}} = \frac{\text{Wb}}{\text{m}^2}$
Celsius-temperature	ϑ (or t)	degrees Celsius	°C	0°C = 273,15 K 1°C = 274,15 K
Luminous flux	ϕ_v	Lumen	lm	cd · sr
Illuminance	E_v	Lux	lx	$\frac{\text{cd} \cdot \text{sr}}{\text{m}^2} = \frac{\text{lm}}{\text{m}^2}$
Radioactivity (decays per unit time)	A	Becquerel	Bq	$\frac{1}{\text{s}}$
Absorbed dose (of ionising radiation)	D	Gray	Gy	$\frac{\text{J}}{\text{kg}}$
Equivalent dose (of ionising radiation)	H	Sievert	Sv	$\frac{\text{J}}{\text{kg}}$
Catalytic activity	z	Katal	kat	$\frac{\text{mol}}{\text{s}}$

3.1.7 Compound units derived from SI-Units

Name	Quantity	Symbol	Definition (Units)
Volume	Litre	l, L	$1 \text{ l} = 1 \text{ dm}^3 = 1 \text{ L}$
Time	Minute	min	$1 \text{ min} = 60 \text{ s}$
	hour	h	$1 \text{ h} = 60 \text{ min} = 3600 \text{ s}$
	Day	d	$1 \text{ d} = 24 \text{ h} = 1440 \text{ min}$
	Year	yr	$1 \text{ year} = 365 \text{ d} = 8760 \text{ h}$
Mass	Tonnes	t	$1 \text{ t} = 1.000 \text{ kg}$
	Grammes	g	$1 \text{ g} = 0,001 \text{ kg}$
Pressure	Bar	bar	$1 \text{ bar} = 10^5 \text{ Pa} = 10^5 \text{ N/m}^2$

3.1 Symbols and units

3.1.8 Temperature scales and conversions

Temperature scale		Unit	Conversion formulas		
			Kelvin	Celsius	Fahrenheit
Kelvin	(T_K)	K		$T_K \approx 273 + T_C$	$T_K \approx 255 + 5/9 * T_F$
Celsius	(T_C)	°C	$T_C \approx T_K - 273$		$T_C \approx 5/9 * (T_F - 32)$
Fahrenheit	(T_F)	°F	$T_F \approx 9/5 T_K - 459$	$T_F \approx 9/5 * T_C + 32$	

3.1.9 Conversion degrees Celcius and Fahrenheit

The white columns show the temperature in degrees Celsius and the grey columns show the temperature values in degrees Fahrenheit. If you need to convert a temperature from Celsius to Fahrenheit, use the value

shown in the grey column. If you need to convert a temperature from Fahrenheit to Celsius, use the value shown in the white column..

°C	°F	°C	°F	°C	°F	°C	°F	°C	°F
-200	-328	-10	14	180	356	370	698	560	1040
-190	-310	0	32	190	374	380	716	570	1058
-180	-292	10	50	200	392	390	734	580	1076
-170	-274	20	68	210	410	400	752	590	1094
-160	-256	30	86	220	428	410	770	600	1112
-150	-238	40	104	230	446	420	788	610	1130
-140	-220	50	122	240	464	430	806	620	1148
-130	-202	60	140	250	482	440	824	630	1166
-120	-184	70	158	260	500	450	842	640	1184
-110	-166	80	176	270	518	460	860	650	1202
-100	-148	90	194	280	536	470	878	660	1220
-90	-130	100	212	290	554	480	896	670	1238
-80	-112	110	230	300	572	490	914	680	1256
-70	-94	120	248	310	590	500	932	690	1274
-60	-76	130	266	320	608	510	950	700	1292
-50	-58	140	284	330	626	520	968	710	1310
-40	-40	150	302	340	644	530	986	720	1328
-30	-22	160	320	350	662	540	1004	730	1346
-20	-4	170	338	360	680	550	1022	740	1364

3.1.10 Imperial (Anglo-Saxon) units

The Anglo-Saxon units (also referred to as Anglo-American measurement systems) are derived from old English systems and were also used in other Commonwealth states prior to the implementation of the metric

system. Nowadays, they are only still used in the USA and to some extent in Great Britain and in some of the Commonwealth states.

Imperial unit, conversion to SI-Units:

Length, distance

Imperial Units	Symbol	Conversion to SI-Units
1 inch	in.	2,539998 cm (UK) 2,540005 cm (USA)
1 foot	ft.	30,48 cm
1 yard	yd.	91,44 cm
1 mile		1,609 km
1 nautical mile		1,853 km

Area measurements

Imperial Units	Symbol	Conversion to SI-Units
1 square inch	(sq.in.)	6,45 cm ²
1 square foot	(sq.ft.)	929,03 cm ²
1 square yard	(sq.yd.)	0,836 m ²

3.1 Symbols and units

3.1.10 Imperial units

Overview Imperial units and conversion to SI-Units:

Standard measures of volume

Imperial Units	Symbol	SI-Units
1 cubic inch	(cu.in.)	16,39 cm ³
1 cubic foot	(cu.ft.)	28,32 dm ³
1 cubic yard	(cu.yd.)	0,7646 m ³

Specific measures of volume

Imperial Units	Symbol	SI-Units
1 gallon	(gal.)	4,546 dm ³ (UK) 3,787 dm ³ (USA)
1 barrel	(bbl.)	163,7 dm ³ (UK) 119,2 dm ³ (USA) 158,8 dm ³ (USA, oil)

Measures of weight and mass

Imperial Units	Symbol	SI-Units
1 gallon	(gal.)	28,35 g
1 barrel	(bbl.)	0,4536 kg

Density

Imperial Units	SI-Units
1 lb/cu.in. (= 1lb/in ³)	2,766*10 ⁴ kg/m ³
1 lb/cu.ft. (= 1 lb/ft ³)	16,02 kg/m ³

Overview Imperial units and conversion to SI-Units:**Force, weight**

Imperial Units	SI-Units
1 lbf (lb. Force)	4,448 N

Energy, work, heat

Imperial Units	SI-Units
1 BTU	1055,06 J

Power, capacity

Imperial Units	SI-Units
1 BTU/sec	1055,06 W
1 BTU/h	0,293 W
1 hp	745,7 W

Pressure, stress

Imperial Units	SI-Units
1 lbg/sq in.	6894,7 N/m ²
1 lbg/sq ft	47,88 N/m ²

Speed

Imperial Units	SI-Units
1 Knot intern. (kn.)	0,514 m/s 1,852 km/h
1 inch/second	0,0254 m/s 0,0914 km/h
1 foot/second (ft./s.)	0,3048 m/s 1,0973 km/h
1 yard/second (yd./s.)	0,9144 m/s 3,294 km/h
1 yard/minute (yd./min.)	0,01524 m/s 0,055 km/h
1 mile per hour (m.p.h.)	0,447 m/s 1,609 km/h

3.1 Symbols and units

3.1.11 Conversion of energy and heat scales

Unit	Joule (J)	Kilojoule (kJ)	Megajoule (MJ)	Kilowatt hours (kWh)	Kilocalorie (Kcal)	British Thermal Unit (BTU)
Joule (J)		0,001	10^{-6}	$2,78 \cdot 10^{-7}$	$2,39 \cdot 10^{-4}$	$9,479 \cdot 10^{-4}$
Kilojoule (kJ)	1000		0,001	$2,7810 \cdot 10^{-4}$	0,239	0,948
Megajoule (MJ)	10^6	1000		0,278	238,8	948
Kilowatt hours (kWh)	$3,6 \cdot 10^6$	3600	3,6		859,8	3412,3
Kilocalorie (Kcal)	4187	4,187	$4,19 \cdot 10^{-3}$	$1,2 \cdot 10^{-3}$		3,873
British Thermal Unit (BTU)	1055	1,055	$1,055 \cdot 10^{-3}$	$2,933 \cdot 10^{-4}$	0,252	

3.1.12 Conversion of power scales

Unit	Watt (W)	Kilowatt (kW)	Kilocalorie per second (kcal/s)	Horsepower (HP)	British Thermal Unit per second (BTU/s)	British Thermal Unit per hour (BTU/h)
Watt (W)		0,001	$2,39 \cdot 10^{-4}$	$1,36 \cdot 10^{-3}$	$0,948 \cdot 10^{-3}$	$3415,2 \cdot 10^{-3}$
Kilowatt (kW)	1000		0,239	1,36	0,948	3415,2
Kilocalorie per second (kcal/s)	4186,8	4,187		5,692	3,968	$1,429 \cdot 10^3$
Horse power (HP)	735,5	0,736	0,176		0,698	2551,9
British Thermal Unit per second (BTU/s)	1055,06	1,06	0,252	1,433		3600
British Thermal Unit per hour (BTU/h)	0,293	$2,93 \cdot 10^{-4}$	$7,000 \cdot 10^{-5}$	$3,981 \cdot 10^{-4}$	$2,777 \cdot 10^{-3}$	

3.1.13 Conversion of pressure scales

Unit	Pascal (Pa)	Bar	atm	lb/sq ft	lb/sq in.
Pascal (Pa)		10^{-5}	$9,869 \cdot 10^{-6}$	0,201	$1,450 \cdot 10^{-4}$
Bar	10^5		0,987	2088,5	13,50
atm	101325	1,013		2116,2	14,70
lb/sq ft.	47,88	$4,788 \cdot 10^{-4}$	$4,723 \cdot 10^{-4}$		$6,944 \cdot 10^{-3}$
lb/sq in.	6894,8	0,0689	0,0680	144,00	

3.1.14 Conversion of SI-Units into Imperial units, pre-SI units and technical scales

Symbol	Quantity	SI-Unit	Technical scales	Imperials units
Q	Heat, energy	J	kcal = 4186,8 J	1 BTU = 1055,06 J
Q	Energy, heat flux	W/m ²	$\frac{\text{kcal}}{\text{m}^2 \text{ h}} = 1,163 \frac{\text{W}}{\text{m}^2}$	$\frac{1 \text{ BTU}}{(\text{sq.ft.hr.})} = 3,1546 \frac{\text{W}}{\text{m}^2}$
λ	Thermal conductivity	W/(m K)	$\frac{\text{kcal}}{\text{m}^2 \text{ h}} = 1,163 \frac{\text{W}}{(\text{m K})}$	$\frac{1 \text{ BTU}}{(\text{ft.hr.}^\circ\text{F})} = 1,7307 \frac{\text{W}}{(\text{m K})}$ $\frac{1 \text{ BTU in}}{(\text{sq.ft.hr.}^\circ\text{F})} = 0,1442 \frac{\text{W}}{(\text{m K})}$ $\frac{1 \text{ BTU}}{(\text{in.hr.}^\circ\text{F})} = 20,7688 \frac{\text{W}}{(\text{m K})}$
R	Heat resistivity coefficient (R-value)	m ² K/W	$1 \text{ m}^2 \text{ h} \frac{\text{K}}{\text{kcal}} = 0,86 \text{ m}^2 \frac{\text{K}}{\text{W}}$	$\frac{1 \text{ sq.ft.hr.}^\circ\text{F}}{\text{BTU}} = 0,1761 \text{ m}^2 \frac{\text{K}}{\text{W}}$
α	Heat transfer coefficient	W/(m ² K)	$\frac{\text{kcal}}{(\text{m}^2 \text{ h K})} = 1,163 \frac{\text{W}}{(\text{m}^2 \text{ K})}$	$\frac{1 \text{ BTU}}{(\text{sq.ft.hr.}^\circ\text{F})} = 5,6783 \frac{\text{W}}{(\text{m}^2 \text{ K})}$
Cp	specific heat capacity	kJ/(kg K)	$\frac{\text{kcal}}{(\text{kg K})} = 4,1868 \frac{\text{kJ}}{\text{kg K}}$	$\frac{1 \text{ BTU}}{(\text{lb. }^\circ\text{F})} = 4,1868 \frac{\text{kJ}}{(\text{kg K})}$
C	Radiant coefficient	W/(m ² K ⁴)	$\frac{\text{kcal}}{(\text{m}^2 \text{ h K}^4)} = 1,63 \frac{\text{W}}{(\text{m}^2 \text{ K}^4)}$	$\frac{1 \text{ BTU}}{(\text{sq.ft.hr. }^\circ\text{R}^4)} = 33,1156 \frac{\text{kJ}}{(\text{m}^2 \text{ K}^4)}$

3. Tables

3.2 Product properties insulation and cladding materials

3.2.1 Insulation materials

The characteristic properties of the individual Rockwool products are described in Chapter 4. For special applications, such as high-temperature insulation systems, cold insulation products or an additional spacer, it may be necessary to use Rockwool products in connection with other insulation products. These may include, for example:

- CMS Calcium-Magnesium-Silicate fibres for high-temperature insulations
- Cellular glass as a spacer or as a support

In any case, it is important that the product properties and processing instructions are taken into consideration during the application of these products. Further product information can be found in the various standards and regulations, such as DIN 4140, CINI, VDI 2055 and various other AGI Guidelines for example.

3.2.2 Cladding materials

3.2.2.1 Application selector for claddings

Cladding material	Fire hazardous environment	Corrosive environment	Maximum surface (cladding) temperature		
			< 50 °C	< 60 °C	>60 °C
Aluminum	-	-			+
Alu-zinc steel	-	-			+
Galvanised steel	+	-			+
Stainless steel					
Aluminised steel	+	+			+
Painted steel or aluminum	-	-		+	
Glass-fibre reinforced polyester (e.g. Rocktight)	-	+			90°C
Mastics	-	-			80°C
Foils	-	-	+		

- not recommendable

+ suitable in general

The selection of material should be geared to each installation and/or environment.

3.2.2.2 Product properties and standards

Cladding material	Density (kg/m ³)	Linear expansion coefficient 10 ⁻⁶ K ⁻¹	Emissivity	Type of material	Standard(s)
Aluminium, bright	2700	23,8	0,05	Al Mg2 Mn 0,8 EN AW 5049	DIN EN 485-2 CINI 3.1.01 DIN EN 12258-1 DIN EN 13195-1
Aluminium, oxydised	2700	23,8	0,13	Al MG 3 EN AW 5745 AL 99,5 EN AW 1050	
Galvanised steel, bright	7800-7900	11,0	0,26	DX 51 D	CINI 3.1.03, DIN EN 10327
Galvanised steel, oxidised	7800-7900	11,0	0,44		
Stainless steel	7700 - 8100	16,0	0,15	1.4301, 1.451, 14571	CINI 3.1.05, EDIN EN 10028-7, EN 10088-3
Alu-zinc steel, bright	-	-	0,16		
Alu-zinc steel, oxidised	-	-	0,18		
Aluminised steel	7800-7900	11,0	-	DX 51 D	CINI 3.1.02, DIN EN 10327
Painted steel	-	-	0,90		see data sheet of the manufacturer
Glass fibre reinforced polyester (e.g. Rocktight)	-	-	0,90		see data sheet of the manufacturer or CINI 3.2.11

3.2.2.3 Thickness metal cladding in accordance with CINI

External diameter insulation (mm)	Sheet thickness in mm				
	Aluminium (CINI 3.1.01)	Aluminised steel (CINI 3.1.02)	Alu-zinc steel (CINI 3.1.03)	Galvanised steel (CINI 3.1.04)	Stainless steel (CINI 3.1.05)
< 140	0,6	0,56	0,5	0,5	0,5
130 - 300	0,8	0,8	0,8	0,8	0,8
> 300	1,0	0,8	0,8	0,8	0,8

3.2 Product properties insulation and cladding materials

3.2.2 Cladding materials

3.2.2.4 Thickness metal cladding in accordance with DIN 4140

External diameter insulation (mm)	Minimum sheet thickness			Overlap	
	Galvanised, Aluminised, Alu-zinc and painted steel	Stainless steel E DIN EN 10028-7 and DIN EN 10088-3	Aluminium	Longitudinal joint	Circumferential joint
up to 400	0,5	0,5	0,6	30	50
400 to 800	0,6	0,5	0,8	40	
800 to 1200	0,7	0,6	0,8	50	
1200 to 2000	0,8	0,6	1,0		
2000 to 6000	1,0	0,8	1,0		
> 6000	1,0	0,8	1,2		

^a Smaller sheet thicknesses are also possible in consultation with the customer.

^b With regard to pipes, the circumferential joint overlap can be omitted if the circumferential joints are joined by swage and counter swage. In the case of cladding with a large surface area and high wind loads, structural verifications may be required. In that instance, only those binding agents permitted by the building authorities may be used. The DIN 1055-4 applies in respect of the loading assumptions.

3. Tables

3.3 Usage tables

3.3.1 Construction materials

Material	Density kg/m ³	Thermal conductivity W/(mK) at 20 °C	Specific heat capacity kJ/(kg K)	Linear expansion coefficient 10 ⁻⁶ K ⁻¹
Aluminum	2700	221	0,92	23,8
Concrete	2400	2,1	0,92 - 1,09	11,0 - 12,0
Bitumen (Solid)	1050	0,17	1,72 - 1,93	200,0
Bronze, red brass	8200	61	0,37	17,5
Cast iron	7100 - 7300	42 - 63	0,54	10,4
Wrought (cast) iron	7800	67	0,46	11,7
Copper	8960	393	0,40	16,5
Wet soil	1600 - 2000	1,2 - 3,0	2,0	-
Dry soil	1400 - 1600	0,4 - 0,6	0,84	-
Stainless steel	7700 - 8100	10 - 46	0,50	16,0
Iron	7850	46 - 52	0,48	11,0

3.3.2 Fluids which are commonly used in process industry

Group	Material	Density kg/m ³	Specific heat capacity kJ/(kg K) at 20 °C
General	Water	1000	4,19
Alcohols	Ethanol	714	2,34
	Methanol	792	2,495
Food	Beer	1030	3,77
	Milk	1030	3,94
	Olive oil	920	1,97
Fuels	Petrol	620 - 780	2,02
	Diesel	830	1,93
	Fuel oil (HEL)	850	1,88
	Fuel oil (HS)	980	1,72
	Petroleum	790	2,20



3.3 Usage tables

3.3.2 Fluids which are commonly used in process industry



Group	Material	Density kg/m ³	Specific heat capacity kJ/(kg K) at 20 °C
Oils	Silicone oil	940	
	Machine oil	910	1,67
Acids	Hydrochloric acid (10%)	1070	-
	Hydrochloric acid (30%)	1150	3,64
	Nitric acid (10 %)	1050	-
	Nitric acid (<90%)	1500	1,72
	Sulfuric acid (10%)	1070	-
	Sulfuric acid (50%)	1400	-
	Sulfuric acid (100%)	1840	1,06
Bases	Ammonia (30%)	609	4,74
	Sodium hydroxide (50%)	1524	-
Various	Benzol	879	1,73
	Dichlormethane	1336	1,16
	Toluene	867	1,72
	Bitumen (fluid)	1100 - 1500	2,09 - 2,3

3.3.3 Gases which are commonly used in process industry

Gas	Density at 1 bar kg/m ³	Specific heat capacity kJ/(kg K) at 20 °C
Acetylene	1,070	1,687
Ammonia	0,710	2,093
Chlorine	2,950	0,477
Ethane	1,240	1,754
Ethylene	1,150	1,553
Carbon dioxide	1,780	0,846
Carbon monoxide	1,150	1,038
Air	1,190	1,007
Methane	0,660	2,227
Propane	1,850	1,671
Oxygen	1,310	0,913
Nitrogen	1,150	1,038
Hydrogen	0,820	14,34

3.3.4 Conversion factors in relation to the heat of combustion

Fuel	Heat of combustion TJ/Gg	Conversion factor tCO ₂ / TJ	Conversion factor kgCO ₂ /kg fuel
Oil	42,3	73,3	3,1
Liquified gas	44,2	64,1	28,3
Petrol	44,3	69,2	3,1
Kerosene	43,8	71,8	3,1
Diesel	43,0	74,0	3,2
Ethane	46,4	61,6	2,9
Petroleum cokes	32,5	97,5	3,2
Black coal	28,2	94,5	2,7
Brown coal	11,9	101,1	1,2
Gas cokes	28,2	107,0	3,0
Gas	48,0	56,1	2,7

3.3 Usage tables

3.3.5 Specific enthalpy super heated steam in kJ/kg

Pressure in bar	Steam temperature in °C										
	150	200	250	300	350	400	450	500	600	700	800
1	2776,1	2874,8	2973,9	3073,9	3175,3	3278,0	3382,3	3488,2	3705,0	3928,8	4159,7
5		2854,9	2960,1	3063,7	3167,4	3271,7	3377,2	3483,9	3701,9	3926,5	4157,8
10		2827,4	2941,9	3050,6	3157,3	3263,8	3370,7	3478,6	3698,1	3923,6	4155,5
20			2901,6	3022,7	3136,6	3247,5	3357,5	3467,7	3690,2	3917,6	4150,9
30			2854,8	2922,6	3114,8	3230,7	3344,1	3456,6	3682,3	3911,7	4146,3
40				2959,7	3091,8	3213,4	3330,4	3445,4	3674,3	3905,7	4141,7
50				2923,5	3067,7	3195,5	3316,3	3433,9	3666,2	3899,7	4137,0
60				2883,2	3042,2	3177,0	3301,9	3422,3	3658,1	3893,6	4132,3
70				2837,6	3015,1	3157,9	3287,3	3410,5	3649,8	3887,5	4127,6
80				2784,6	2986,3	3138,0	3272,2	3398,5	3641,5	3881,4	4122,9
90					2955,5	3117,5	3256,9	3386,4	3633,2	3875,2	4118,2
100					2922,2	3096,1	3241,1	3374,0	3624,7	3869,0	4113,5
150					2691,3	2974,7	3156,6	3309,3	3581,5	3837,6	4089,6
200						2816,9	3060,8	3239,4	3536,7	3805,5	4065,4
250						2578,1	2950,6	3164,2	3490,4	3773,0	4041,1
300						2150,7	2822,3	3083,5	3443,1	3740,1	4016,7
350						1988,3	2672,9	2997,3	3394,7	3706,9	3992,2
400						1930,8	2513,2	2906,7	3345,8	3673,8	3967,8
450						1897,3	2377,7	2814,2	3296,6	3640,7	3943,6
500						1874,1	2284,7	2724,2	3247,7	3607,8	3919,5
600						1843,0	2180,0	2571,9	3152,3	3543,5	3872,3
700						1822,8	2123,6	2466,9	3063,8	3481,9	3826,7
800						1808,7	2087,9	2397,7	2985,4	3424,2	3783,3
900						1798,4	2063,2	2350,3	2918,7	3371,1	3742,4
1000						1790,9	2045,1	2316,2	2863,4	3323,1	3704,3

3.3.6 Density super heated steam

Pressure in bar	Steam temperature in °C										
	150	200	250	300	350	400	450	500	600	700	800
1	0,5164	0,4604	0,4156	0,379	0,3483	0,3223	0,2999	0,2805	0,2483	0,2227	0,2019
5		2,3537	2,1083	1,9137	1,7540	1,6200	1,5056	1,4066	1,2437	1,1149	1,0105
10		4,8566	4,2984	3,8771	3,5402	3,2617	3,0263	1,8241	2,4932	2,2331	2,0228
20			8,9757	7,9713	7,2169	6,6142	6,1153	5,6926	5,0101	4,4794	4,0531
30			14,172	12,326	11,047	10,065	9,2708	8,6076	7,5512	6,7390	6,0908
40				17,000	15,052	13,623	12,497	11,571	10,117	9,0121	8,1360
50				22,073	19,255	17,299	15,798	14,586	12,709	11,299	10,189
60				27,662	23,687	21,102	19,179	17,653	15,326	13,599	12,249
70				33,944	28,384	25,045	22,646	20,776	17,970	15,914	14,316
80				41,226	33,394	29,143	26,202	23,957	20,642	18,242	16,391
90					38,776	33,411	29,855	27,198	23,341	20,584	18,474
100					44,611	37,867	33,611	30,503	26,068	22,941	20,564
150					87,191	63,889	51,200	48,077	40,154	34,943	31,124
200						100,54	78,732	67,711	55,039	47,319	41,871
250						166,63	109,09	89,904	70,794	60,080	52,803
300						358,05	148,45	115,26	87,481	73,234	63,919
350						474,89	201,63	144,43	105,15	86,779	75,214
400						523,67	270,91	177,97	123,81	100,71	86,682
450						554,78	343,37	215,87	143,44	115,01	98,312
500						577,99	402,28	256,95	163,99	129,64	110,09
600						612,45	479,87	338,44	207,20	159,77	134,02
700						638,30	528,62	405,76	251,73	190,65	158,30
800						659,27	563,69	456,99	295,45	221,74	182,72
900						677,05	591,14	496,53	336,53	252,48	207,03
1000						692,58	613,80	528,21	373,93	282,36	231,03

3.3 Usage tables

3.3.7 Dew point table

Air temperature	Maximum water content in g/m ³	Maximum cooling of air temperature (to avoid condensation) at a humidity of													
		35 %	40 %	45 %	50 %	55 %	60 %	65 %	70 %	75 %	80 %	85 %	90 %	95 %	
-30	0,35	11,1	9,8	8,6	7,5	6,6	5,7	4,9	4,2	3,5	2,8	2,2	1,6	1,1	0,6
-25	0,55	11,5	10,1	8,9	7,8	6,8	5,9	5,1	4,3	3,6	2,9	2,3	1,7	1,1	0,6
-20	0,90	12,0	10,4	9,1	8,0	7,0	6,0	5,2	4,5	3,7	2,9	2,3	1,7	1,1	0,6
-15	1,40	12,3	10,8	9,6	8,3	7,3	6,4	5,4	4,6	3,8	3,1	2,5	1,8	1,2	0,6
-10	2,17	12,9	11,3	9,9	8,7	7,6	6,6	5,7	4,8	3,9	3,2	2,5	1,8	1,2	0,6
-5	3,27	13,4	11,7	10,3	9,0	7,9	6,8	5,9	5,0	4,1	3,3	2,6	1,9	1,2	0,6
0	4,8	13,9	12,2	10,7	9,3	8,1	7,1	6,0	5,1	4,2	3,5	2,7	1,9	1,3	0,7
2	5,6	14,3	12,6	11,0	9,7	8,5	7,4	6,4	5,4	4,6	3,8	3,0	2,2	1,5	0,7
4	6,4	14,7	13,0	11,4	10,1	8,9	7,7	6,7	5,8	4,9	4,0	3,1	2,3	1,5	0,7
6	7,3	15,1	13,4	11,8	10,4	9,2	8,1	7,0	6,1	5,1	4,1	3,2	2,3	1,5	0,7
8	8,3	15,6	13,8	12,2	10,8	9,6	8,4	7,3	6,2	5,1	4,2	3,2	2,3	1,5	0,8
10	9,4	16,0	14,2	12,6	11,2	10,0	9,6	7,4	6,3	5,2	4,2	3,3	2,4	1,6	0,8
12	10,7	16,5	14,6	13,0	11,6	10,1	8,8	7,5	6,4	5,3	4,3	3,3	2,4	1,6	0,8
14	12,1	16,9	15,1	13,4	11,7	10,3	8,9	7,6	6,5	5,4	4,3	3,4	2,5	1,6	0,8
16	13,6	17,4	15,5	13,6	11,9	10,4	9,0	7,8	6,6	5,5	4,4	3,5	2,5	1,7	0,8
18	15,4	17,8	15,7	13,8	12,1	10,6	9,2	7,9	6,7	5,6	4,5	3,5	2,5	1,7	0,8
20	17,3	18,1	15,9	14,0	12,3	10,7	9,3	8,0	6,8	5,6	4,6	3,6	2,6	1,7	0,8
22	19,4	18,4	16,1	14,2	12,5	10,9	9,5	8,1	6,9	5,7	4,7	3,6	2,6	1,7	0,8
24	21,8	18,6	16,4	14,4	12,6	11,1	9,6	8,2	7,0	5,8	4,7	3,7	2,7	1,8	0,8
26	24,4	18,9	16,6	14,7	12,8	11,2	9,7	8,4	7,1	5,9	4,8	3,7	2,7	1,8	0,9
28	27,2	19,2	16,9	14,9	13,0	11,4	9,9	8,5	7,2	6,0	4,9	3,8	2,8	1,8	0,9
30	30,3	19,5	17,1	15,1	13,2	11,6	10,1	8,6	7,3	6,1	5,0	3,8	2,8	1,8	0,9
35	39,4	20,2	17,7	15,7	13,7	12,0	10,4	9,0	7,6	6,3	5,1	4,0	2,9	1,9	0,9
40	50,7	20,9	18,4	16,1	14,2	12,4	10,8	9,3	7,9	6,5	5,3	4,1	3,0	2,0	0,9
45	64,5	21,6	19,0	16,7	14,7	12,8	11,2	9,6	8,1	6,8	5,5	4,3	3,1	2,1	0,9
50	82,3	22,3	19,7	17,3	15,2	13,8	11,6	9,9	8,4	7,0	5,7	4,4	3,2	2,1	0,9
55	104,4	23,0	20,2	17,8	15,6	13,7	11,8	10,2	8,6	7,1	5,8	4,5	3,2	2,1	0,9
60	130,2	23,7	20,9	18,4	16,1	14,1	12,2	10,5	8,9	7,3	5,9	4,6	3,3	2,1	0,9
65	161,3	24,5	21,6	19,0	16,6	14,5	12,6	10,8	9,1	7,6	6,1	4,7	3,4	2,1	0,9
70	188,2	25,2	22,2	19,5	17,1	15,0	13,0	11,1	9,4	7,9	6,2	4,8	3,4	2,1	0,9
75	242,0	26,0	22,9	20,1	17,7	15,4	13,3	11,4	9,6	8,0	6,4	4,9	3,5	2,2	0,9
80	283,4	26,8	23,6	20,7	18,2	15,8	13,7	11,7	9,9	8,2	6,6	5,0	3,6	2,2	0,9

3.3.8 Climate data

3.3.8.1 Average year temperature and humidity

Europe	Temperature (°C)	Humidity (%)
Athens	17.6	66
Berne	8.6	-
Geneva	9.2	-
Amsterdam	9,8	83
Innsbruck	8.4	-
London	9.9	79
Madrid	13.4	67
Moscow	3.6	79
Paris	10.3	77
Rome	15.4	72
Salzburg	8.2	-
Warsaw	7.3	82
Vienna	9.8	77
Zurich	8.2	-
Other parts of the world	Temperature (°C)	Humidity (%)
Jakarta	25.9	85
Buenos Aires	16.1	84
Dar es Salaam	25.3	-
Havana	25.2	76
Cairo	21.1	-
Kolkata	25.5	-
New York	11.1	76
Rio de Janeiro	22.7	74
San Francisco	12.8	82
Santiago	13.9	68
Shanghai	15.8	-
Sydney	17.3	13.4
Tokyo	13.8	73



3.3 Usage tables

3.3.8 Climate data



The Netherlands	Temperature (°C)	Humidity (%)
Amsterdam (Schiphol)	9,8	84
Arnhem (Deelen)	9,4	81
Den Haag	9,9	83
Den Helder	9,6	84
Eindhoven	9,9	81
Enschede	9,3	83
Groningen	9,0	86
Leeuwarden	9,2	85
Maastricht	9,8	82
Rotterdam	10	84
's Hertogenbosch	9,8	82
Soesterberg	9,6	81
Utrecht (De Bilt)	9,8	82
Vlissingen	10,4	82

Belgium	Temperature (°C)	Humidity (%)
Antwerpen	9,6	-
Beauvechain	9,2	-
Botrange	5,7	-
Brussel	9,7	81
Chièvres	9,0	-
Dourbes	8,6	-
Elsenborn	5,7	-
Florennes	8,2	-
Gent	9,5	-
Kleine Brogel	9,0	-
Koksijde	9,4	-
Libramont	7,5	-
Spa	7,4	-
St-Hubert	6,8	-
Virton	8,7	-





Germany	Temperature (°C)	Humidity (%)
Berlin	9.1	77
Braunschweig	8.6	-
Bremerhaven	8.8	-
Dresden	9.3	74
Essen	9.5	82
Erfurt	8.0	-
Frankfurt/M.	10.1	76
Frankfurt a.O.	8.2	-
Giessen	9.0	-
Görlitz	8.3	-
Halle	9.1	76
Hamburg	8.4	80
Magdeburg	9.1	-
Mannheim	10.2	-
Munich	8.1	-
Nuremberg	8.5	-
Plauen	7.2	-
Regensburg	8.1	-
Rostock	7.8	-
Stuttgart	8.6	-
Trier	9.1	-

France	Min. Temperature (°C)	Max. Temperature (°C)	Humidity (%)
Ajaccio	10	20,1	-
Bourges	0,8	15,8	-
Bordeaux	8,5	18,1	-
Dijon	6,4	15,1	-
La Rochelle	9,5	16,5	-
Lille	6,5	14,1	-
Lyon	7,5	16,4	-
Nice	12	19,2	-
Paris	8,6	15,5	77
Perpignan	11	19,8	-
Rennes	7,6	16	-
Strasbourg	6,1	14,8	-

3.3 Usage tables

3.3.8.2 Wind speed

Beaufort scale	Wind speed (m/s)	Definition
0	0 - 0,2	Calm
1	0,3 - 1,5	Light air
2	1,6 - 3,3	Light breeze
3	3,4 - 5,4	Gentle breeze
4	5,5 - 7,9	Moderate breeze
5	8,0 - 10,7	Fresh breeze
6	10,8 - 13,8	Strong breeze
7	13,9 - 17,1	Moderate gale (strong wind)
8	17,2 - 20,7	Fresh gale (strong wind)
9	20,8 - 24,4	Strong gale (strong wind)
10	24,5 - 28,4	Whole gale / storm
11	28,5 - 32,6	Violent storm
≥12	>32,7	Hurricane

Generally speaking, the wind speed is also dependent on the height and location (inland, coastal). In order to calculate the insulation thickness, the following wind speeds are generally used:

- Inside: 0,5 m/s
- Outside in protected conditions: 1 m/s
- Outside: 5 m/s
- Outside in windy conditions (e.g. near to coast): 10 m/s

3.3.9 Guidelines average velocities in pipe work

Type of fluid / piping		Velocity (m/s)
Steam piping	Saturated steam	20 - 35
	LP(low-pressure) steam	30
	MP(medium-pressure) steam	40
	HP(high-pressure) steam	60
(Hot) water supply	Feed	2 -3
	Return	1
Oil	Low viscosity	1,5
	High viscosity	0,5
District heating	Average	2
Central heating (non residential buildings)	Main feed stock	0,5

3.3.10 Pipe diameter

Many different standards exist in relation to pipe sizes, the distribution of which varies according to the sector of industry and geographical area. The denotation of the pipe size generally comprises two numbers; one, which indicates the external diameter or nominal diameter, and a further number that indicates the wall thickness.

- In North America and Great Britain, high-pressure pipe systems are generally classified by means of the Nominal Pipe Size (NPS) System in Inches. The pipe sizes are documented in a series of standards. In the USA, these standards include API 5L, ANSI/ASME B36.10M and in Great Britain BS 1600 and BS 1387. As a rule, the pipe wall thickness is the fixed variable and the internal diameter is permitted to vary
- In Europe, the same internal diameter and wall strengths as used in the Nominal Pipe Size system are used for high-pressure pipe systems, however they are conveyed in a metric nominal diameter instead in inches as given in the NPS system. For

nominal pipe sizes above 14, the nominal diameter (DN) size corresponds to the NPS size multiplied by 25 (not 25.4). These pipes are documented in the EN 10255 standard (formerly DIN 2448 and BS 1387) and in the ISO 65 standard and are often denoted as DIN- or ISO-pipes.

In order to ensure a joint-free laying of the insulation, it is important that you know the actual external diameter of the pipe, as there are an immense number of pipe dimensions.

The following table provides a general overview of common pipe diameters with a comparison between the inches and DN size.

3.3.10 Pipe diameter

Nominal Pipe Size (NPS in inch)	Nominal diameter (DN/Metric)	Outer diameter (mm)
1/8	DN 6	10,3
1/4	DN 8	13,7
3/8	DN 10	17,1
1/2	DN 15	21,3
3/4	DN 20	26,7
1	DN 25	33,4
1 ¼	DN 32	42,2
1 ½	DN 40	48,3
2	DN 50	60,3
2 ½	DN 65	73,0
3	DN 80	88,9
3 ½	DN 90	101,6
4	DN 100	114,3
4 ½	DN 115	127,0
5	DN 125	141,3
6	DN 150	168,3
8	DN 200	219,1
10	DN 250	273,1
12	DN 300	323,9
14	DN 350	355,6
16	DN 400	406,4
18	DN 450	457,2
20	DN 500	508,0
22	DN 550	558,8
24	DN 600	609,6
26	DN 650	660,4
28	DN 700	711,2
30	DN 750	762,0
32	DN 800	812,8
34	DN 850	863,6
36	DN 900	914,0

3.3.11 Equivalent pipe length for flanges & valves

Reference values for plant related thermal bridges (table A14 - VDI 2055)

Item no.		Temperature range in °C		
		50-100	150-300	400-500
		Equivalent length in m		
1	Flanges for pressure stages PN25 to PN100			
1.1	Uninsulated for pipes			
1.1.1	In buildings 20°C			
	DN 50	3 - 5	5 - 11	9 - 15
	DN 100	4 - 7	7 - 16	13 - 16
	DN 150	4 - 9	7 - 17	17 - 30
	DN 200	5 - 11	10 - 26	20 - 37
	DN 300	6 - 16	12 - 37	25 - 57
1.1.2	In the open air 0°C			
	DN 50	7 - 11	9 - 16	12 - 19
	DN 100	9 - 14	13 - 23	18 - 28
	DN 150	11 - 18	14 - 29	22 - 37
	DN 200	13 - 24	18 - 38	27 - 46
	DN 300	16 - 32	21 - 54	32 - 69
	DN 400	22 - 31	28 - 53	44 - 68
	DN 500	25 - 32	31 - 52	48 - 69
1.2	Insulated in buildings 20°C and in the open air 0°C for pipes			
	DN 50	0,7 - 1,0	0,7 - 1,0	1,0 - 1,1
	DN 100	0,1 - 1,0	0,8 - 1,2	1,1 - 1,4
	DN 150	0,8 - 1,1	0,8 - 1,3	1,3 - 1,6
	DN 200	0,8 - 1,3	0,9 - 1,4	1,3 - 1,7
	DN 300	0,8 - 1,4	1,0 - 1,6	1,4 - 1,9
	DN 400	1,0 - 1,4	1,1 - 1,6	1,6 - 1,9
	DN 500	1,1 - 1,3	1,1 - 1,6	1,6 - 1,8
2	Fittings for pressure stages PN 25 to PN 100			
2.1	Uninsulated for pipes			
2.1.1	In buildings 20°C			
	DN 50	9 - 15	16 - 29	27 - 39
	DN 100	15 - 21	24 - 46	42 - 63
	DN 150	16 - 28	26 - 63	58 - 90
	DN 200	21 - 35	37 - 82	73 - 108
	DN 300	29 - 51	50 - 116	106 - 177
	DN 400	36 - 60	59 - 136	126 - 206
	DN 500	46 - 76	75 - 170	158 - 267

3.3 Usage tables



Item no.		Temperature range in °C		
		50-100	150-300	400-500
		Equivalent length in m		
2.1.2	In the open air 0°C / Only for pressure stage PN 25			
	DN 50	22 - 24	27 - 34	35 - 39
	DN 100	33 - 36	42 - 52	56 - 61
	DN 150	39 - 42	50 - 68	77 - 83
	DN 200	51 - 56	68 - 87	98 - 101
	DN 300	59 - 75	90 - 125	140 - 160
	DN 400	84 - 88	106 - 147	165 - 190
	DN 500	108 - 114	134 - 182	205 - 238
2.2	Insulated for pipes			
2.2.1	In buildings 20°C and in the open air 0°C for pipes			
	DN 50	4 - 5	5 - 6	6 - 7
	DN 100	4 - 5	5 - 6	6 - 7
	DN 150	4 - 5	5 - 6	6 - 7
	DN 200	5 - 7	5 - 9	7 - 10
	DN 300	5 - 9	6 - 12	7 - 13
	DN 400	6 - 9	7 - 12	8 - 15
	DN 500	7 - 11	8 - 15	9 - 19
3	Pipe suspensions	supplementary value Z*		
3.1	In buildings	0,15		
3.2	In the open air	0,25		


* The ranges given cover the effect of the temperature and of the pressure stages. Flanges and fittings for higher pressure stages give higher values so overlappings in the given temperature ranges are possible.

3.3.12 Minimum radius Rockwool slabs


Minimal radius Rockwool Technical Insulation slabs							
Product	insulation thickness (mm)						
	40	50	60	70	80	100	120
Rockwool Flexiboard	500	700	900	1100	1300	1800	2000
Rockwool Multiboard	500	700	1000	1200	1500	1900	2400
Rockwool HT600	500	700	1000	1200	1400	-	-

3.3.13 Fire curve: ISO and hydrocarbon

ISO fire curve

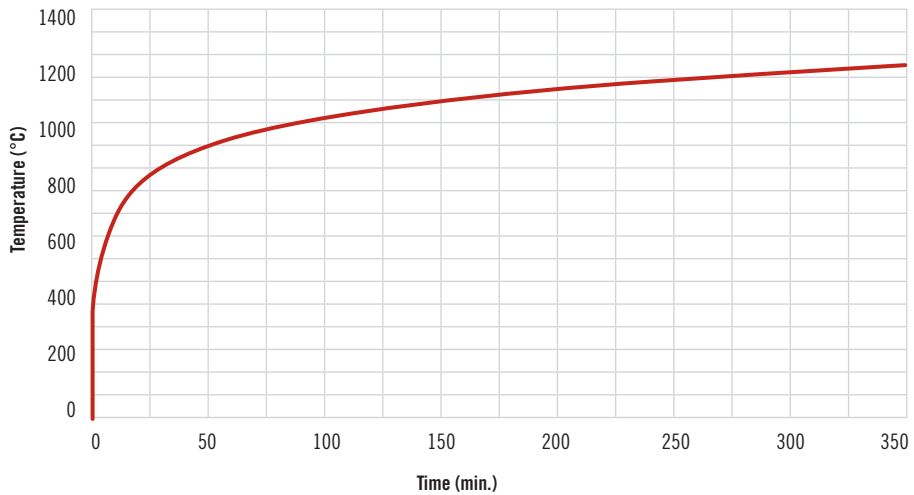

Hydrocarbon fire curve

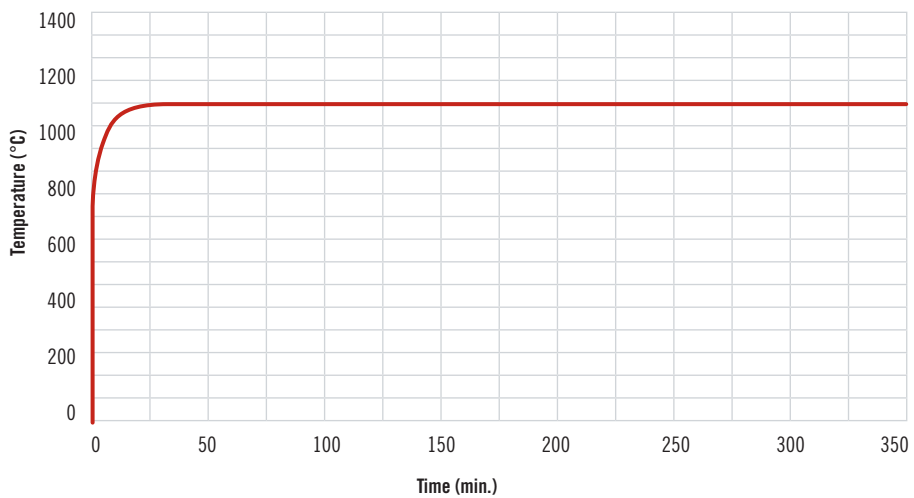



4. Products

Application selector

		Process pipe work	Valves, bends, flanges	Columns	Boilers	Furnaces	Tank walls, drums	Tank roofs	Voids, seams	Acoustic applications	Cryogen installations and cold boxes
Pipe Sections	Rockwool 850	●									
	Rockwool 851	●									
Wired Mats	ProRox WM 70	●	●	●			●			●	
	ProRox WM 80	●	●							●	
	ProRox WM 100	●	●		●	●				●	
Load bearing mat	Rockwool Duraflex	●		●	●		●				
Slabs	Rockwool Flexiboard			●			●			●	
	Rockwool Multiboard			●			●				
	Rockwool HT600			●	●	●					
	Rockwool HT660				●	●				●	
	Rockwool HT700				●	●				●	
	Rockwool CRS							●		●	
	Rockwool 251				●	●				●	
Finishing	Rocktight	●		●			●	●			
Loose wool	Rockwool Loose Fill		●						●		
	Rockwool Granulate		●						●		●

Remarks

Due to an almost limitless range of applications, we have not provided detail information for all the applications. Information is available in the following manuals/standards for industrial insulation:

- CINI manual 'Insulation for industries'
- AGI Q101 (Dämmarbeiten an Kraftwerk-komponenten)

- DIN 4140 (Insulation work on industrial installations and building equipment)

For specific applications, our RTI sales team will be pleased to advise you.

4. Products

Important Product Properties

Maximum Service Temperature Limit

The maximum service temperature limit is used to rank the insulating materials in terms of their behavior at higher temperatures. It replaces the term classification temperature, which was still in current usage in AGI Q132 from 1995. The maximum service temperature limit is determined in the laboratory during static loading, taking the delivery form (mat, plate, shell) into account.

Maximum Service Temperature

The maximum service temperature is the temperature to which the insulating material can be continuously exposed, under operating conditions and the static and dynamic loads occurring in the use case, without its properties being impaired. Insulating materials may only be used up to a temperature at which the thermal insulating action is not unduly impaired by dimensional, structural or chemical changes. The maximum service temperature of insulating materials is generally lower than the maximum service temperature limit.

AS Quality

Alloying elements, such as e.g. chromium, nickel or molybdenum, are added to austenitic steels in order to increase the corrosion resistance. Under certain marginal conditions, such as component stresses and contact with water-soluble chloride ions, austenitic steels tend to develop stress corrosion cracking. For this reason, only insulating materials that conform to AS Quality requirements may be used. For these insulating materials, the chloride ion content may not exceed a nominal value of 10 mg/kg. As chloride ions are present almost everywhere in the environment, products of AS quality must be stored in a dry and weatherproof manner.


Thermal Conductivity

The thermal insulating action of insulating materials is defined by the thermal conductivity λ described. Lambda λ is specified in the physical unit W/(mK). The thermal conductivity is a temperature-dependent value. The thermal conductivity increases with rising temperatures. The thermal conductivity is, in other words, dependent on the structure, the fiber orientation and the bulk density of the insulating material. For pipe insulating materials, which are used in accordance with EnEV [German Energy Saving Regulations for Buildings], the characteristic thermal conductivity λ_r is given at an average temperature of 40 °C. For insulating materials which are used in industrial plants, the thermal conductivity is specified as a function of the temperature, usually in 50 °C-stages.

Insulating Material Designation Code

The insulating material designation code is a 10 digit code which is used to characterize insulating materials for industrial plants. The insulating material designation code for the Rockwool wired mat is shown here by way of example:

10.01.02.64.08

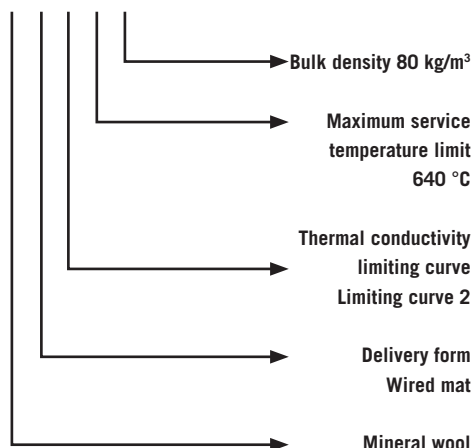

Rockwool 850

Industrial pipe section

Applications

Rockwool 850 is a pre-formed stone wool pipe section. The sections are supplied split and hinged for easy snap-on assembly, and are suitable for the thermal and acoustic insulation of industrial pipe work.



Advantages

- Excellent thermal and acoustic insulation
- Easy to handle and install
- Wide range of diameters and insulation thicknesses
- Optimal performance due to the extensive range of diameters
- Suitable for use over stainless steel
- For temperatures up to 350°C, a support construction is not generally necessary
- Long lasting
- Excellent fit provides optimal performance
- Fast return on investment

Product properties

	Performance							Standard
Thermal conductivity	t_m (°C)	50	100	150	200	250	300	EN ISO 8497, ASTM C335
	λ (W/mK)	0.038	0.044	0.051	0.061	0.073	0.087	
	t_m (°F)	100	200	300	400	500	600	
	λ (BTU.in/ft ² .h.°F)	0.257	0.296	0.354	0.429	0.524	0.637	
Maximum Service Temperature	620 °C (1148 °F) 750 °C (1382 °F)							EN 14707 ASTM C411
Reaction to fire	A1 Non-combustible Low Surface Flame Spread Surface burning characteristics: Flame spread=passed, Smoke development=passed							EN 13501-1 IMO A799 (19) IMO A653 (16) ASTM E84 (UL 723)
Water leachable chloride content	< 10 mg/kg, AS-quality for use on stainless steel Conforms to the stainless steel corrosion specification as per ASTM test methods < 10mg/kg (pH-value neutral to slightly alkaline) C692 and C871							EN 13468 ASTM C795 ASTM C871
Water absorption	Water absorption < 1 kg/m ² Water vapour absorption (vapor sorption) ± 0.02 %vol							EN 13472 ASTM C1104/C1104M
Nominal density	100 - 125 kg/m ³ (6.24 - 7.80 lb/ft ³)							
Water vapour resistance factor	$\mu = 1,0$							EN 13469
Compliance	Rockwool sections. For the thermal insulation of pipes. Standard specification for mineral fibre pre-formed pipe insulation, type I, II and IV							CINI 2.2.03 ASTM C547-06

Rockwool 850 is certificated by ButgB, technical approval ATG 2193

4. Products

Rockwool 851

Industrial pipe section

Applications

Rockwool 851 is a pre-formed high density stone wool pipe section. The sections are supplied split and hinged for easy snap-on assembly, and are especially suitable for the thermal and acoustic insulation of industrial pipe work which is exposed to high temperature and light (e.g. vibrations) mechanical loads.



Advantages

- Excellent thermal and acoustic insulation
- Easy to handle and install
- Wide range of diameters and insulation thicknesses
- Optimal performance due to the extensive range of insulation thicknesses
- Suitable for use over stainless steel
- For temperatures up to 350 °C, support construction is not generally necessary
- Long lasting
- Excellent fit provides optimal performance
- Fast return on investment

Product properties

	Performance							Standard
Thermal conductivity	t _m (°C)	50	100	150	200	250	300	EN ISO 8497, ASTM C335
	λ (W/mK)	0.038	0.044	0.051	0.059	0.069	0.079	
	t _m (°F)	100	200	300	400	500	600	
	λ (BTU.in/ft ² .h.°F)	0.255	0.298	0.353	0.416	0.490	0.574	
Maximum Service Temperature	640 °C (1184 °F) 750 °C (1382 °F)							EN 14707 ASTM C411
Reaction to fire	A1 Surface burning characteristics: Flame spread=passed, Smoke development=passed							EN 13501-1 ASTM E84 (UL 723)
Water leachable chloride content	< 10mg/kg, AS-quality for use over stainless steel Conforms to the stainless steel corrosion specification as per ASTM test methods C692 and C871 <10mg/kg (ph-value neutral to slightly alkaline)							EN 13468 ASTM C795 ASTM C871
Water absorption	Water absorption < 1 kg/m ² Water vapour absorption (vapor sorption) ± 0.02 %vol							EN 13472 ASTM C1104/C1104M
Nominal density	140 kg/m ³ (8.75 lb/ft ³)							
Water vapour resistance factor	μ = 1.0							EN 13469
Compliance	Rockwool sections. For the thermal insulation of pipes. Standard specification for mineral fibre pre-formed pipe insulation, type I, II and IV							CINI 2.2.03 ASTM C547-06



4. Products

ProRox WM 70

(previously Rockwool 160)

Wired mat

Thickness in mm	Length in mm	Width in mm	Packaging m ² /roll	Packaging m ² /pallet
50	4500	500	4,5	94,5
60	4000	500	4,0	84,0
80	3000	500	3,0	63,0
100	2500	500	2,5	52,5
120	2000	500	2,0	42,0

The following variants are available on request:

- ProRox WM 70 SW: Stainless steel mesh and stitching wire
- ProRox WM 70 S: Galvanised steel mesh and stainless steel stitching wire
- ProRox WM 70 ALU: Galvanised steel mesh and stitching wire with addition of aluminium foil between mesh and rock wool
- ProRox WM 70 SW ALU: Stainless steel mesh and stitching wire with addition of aluminium foil between mesh and rock wool

Applications

ProRox WM 70 is a lightly bonded rock wool mat stitched on galvanised wired mesh with galvanised wire. The wired mat is suitable for thermal and acoustic insulation of industrial pipe work, boiler walls, furnaces and industrial smoke exhaust ducts.

Advantages

- Excellent thermal and acoustic insulation
- Suitable for use over irregular surfaces
- Available in a wide range of thickness up to 120 mm
- Suitable for use over stainless steel
- Compressed and palletized packaging



Product properties ProRox WM 70

	Performance									Standard
Thermal conductivity	t° (°C)	50	100	150	200	250	300	400	500	EN 12667, ASTM C177
	λ (W/mK)	0.039	0.047	0.055	0.064	0.075	0.088	0.119	0.157	
	t° (°F)	100	200	300	400	500	600	700	800	
	λ (BTU.in/ft².h.°F)	0.262	0.316	0.380	0.455	0.543	0.645	0.763	0.897	
Maximum Service Temperature	580 °C (1076 °F) 750 °C (1382 °F)									EN 14706 ASTM C411
Reaction to fire	A1 Surface burning characteristics: Flame spread=passed, Smoke development=passed									EN 13501-1 ASTM E84 (UL 723)
Water leachable chloride content	< 10mg/kg, AS-quality for use over stainless steel Conforms to the stainless steel corrosion specification as per ASTM test methods C692 and C871 < 10mg/kg (ph-value neutral to slightly alkaline)									EN 13468 ASTM C795 ASTM C871
Water absorption	Water absorption < 1 kg/m² Water vapour absorption (vapor sorption) ± 0.02 %vol									EN 1609 ASTM C1104/C1104M
Nominal density	70 kg/m³ (4.37 lb/ft³)									
Water vapour resistance factor	μ = 1.0									EN 12086
Compliance	Rockwool (RW) wire mesh blankets for thermal insulation of large diameter pipes, flat walls and equipment Standard specification for mineral fibre blanket insulation, type I and II									CINI 2.2.02 ASTM C592-06

4. Products

ProRox WM 80

(previously Rockwool 164)

Wired mat

Thickness in mm	Length in mm	Width in mm	Packaging m ² /roll	Packaging m ² /pallet
50	4000	500	4,0	84,0
60	3500	500	3,5	73,5
80	3000	500	3,0	63,0
100	2500	500	2,5	52,5
120	2000	500	2,0	42,0

The following variants are available on request:

- ProRox WM 80 SW: Stainless steel mesh and stitching wire
- ProRox WM 80 S: Galvanised steel mesh and stainless steel stitching wire
- ProRox WM 80 ALU: Galvanised steel mesh and stitching wire with addition of aluminium foil between mesh and rock wool
- ProRox WM 80 SW ALU: Stainless steel mesh and stitching wire with addition of aluminium foil between mesh and rock wool

Applications

ProRox WM 80 is a lightly bonded stone wool mat stitched on galvanised wire mesh using galvanised wire. The wired mat is suitable for thermal and acoustic insulation of industrial applications reaching high temperatures, such as industrial pipe work, boiler walls, furnaces and smoke ducts.

Advantages

- Excellent thermal and acoustic insulation
- Suitable for use over irregular surfaces
- Available in a wide range of thicknesses up to 120 mm
- Suitable for use over stainless steel
- Compressed and palletized packaging



Product properties ProRox WM 80

	Performance										Standard
Thermal conductivity	t° (°C)	50	100	150	200	250	300	400	500	600	EN 12667, ASTM C177
	λ (W/mK)	0.039	0.045	0.053	0.062	0.072	0.084	0.112	0.146	0.192	
	t° (°F)	100	200	300	400	500	600	700	800	900	
	λ (BTU.in/ft².h.°F)	0.253	0.301	0.357	0.422	0.498	0.587	0.691	0.812	0.951	
Maximum Service Temperature	640 °C (1184 °F) 750 °C (1382 °F)										EN 14706 ASTM C411
Reaction to fire	A1 Surface burning characteristics: Flame spread=passed, Smoke development=passed										EN 13501-1 ASTM E84 (UL 723)
Water leachable chloride content	< 10mg/kg, AS-quality for use over stainless steel Conforms to the stainless steel corrosion specification as per ASTM test methods C692 and C871 < 10mg/kg (ph-value neutral to slightly alkaline)										EN 13468 ASTM C795 ASTM C871
Water absorption	Water absorption < 1 kg/m² Water vapour absorption (vapor sorption) ± 0.02 %vol										EN 1609 ASTM C1104/C1104M
Nominal density	80 kg/m³ (5 lb/ft³)										
Water vapour resistance factor	μ = 1.0										EN 12086
Compliance	Rockwool (RW) wire mesh blankets for thermal insulation of large diameter pipes, flat walls and equipment Standard specification for mineral fibre blanket insulation, type I and II										CINI 2.2.02 ASTM C592-06

4. Products

ProRox WM 100

(previously Rockwool 159)

Wired mat

Thickness in mm	Length in mm	Width in mm	Packaging m ² /roll	Packaging m ² /pallet
50	4000	500	4,0	84,0
60	3000	500	3,0	63,0
80	2500	500	2,5	52,5
100	2000	500	2,0	42,0
120	2000	500	2,0	42,0

The following variants are available on request:

- ProRox 100 SW: Stainless steel mesh and stitching wire
- ProRox 100 S: Galvanised steel mesh and stainless steel stitching wire
- ProRox 100 ALU: Galvanised steel mesh and stitching wire with addition of aluminium foil between mesh and rock wool
- ProRox 100 SW ALU: Stainless steel mesh and stitching wire with addition of aluminium foil between mesh and rock wool

Applications

ProRox WM 100 is a lightly bonded heavy stone wool mat stitched on galvanised wired mesh with galvanised wire. The wired mat is especially suitable for industrial installations such as high-pressure steam pipes, reactors, furnaces, etc. where high demands are made on the temperature resistance of the insulation.

Advantages

- Excellent thermal and acoustic insulation
- Suitable for use over irregular surfaces
- Available in a wide range of thicknesses up to 120 mm
- Suitable for use over stainless steel



Product properties ProRox WM 100

	Performance										Standard
Thermal conductivity	t° (°C)	50	100	150	200	250	300	400	500	600	EN 12667, ASTM C177
	λ (W/mK)	0.039	0.045	0.051	0.059	0.067	0.078	0.102	0.131	0.167	
	t° (°F)	100	200	300	400	500	600	700	800	900	
	λ (BTU.in/ft².h.°F)	0.265	0.308	0.359	0.421	0.492	0.574	0.668	0.773	0.891	
Maximum Service Temperature	680 °C (1256 °F) 750 °C (1382 °F)										EN 14706 ASTM C411
Reaction to fire	A1 Surface burning characteristics: Flame spread=passed, Smoke development=passed										EN 13501-1 ASTM E84 (UL 723)
Water leachable chloride content	< 10mg/kg, AS-quality for use over stainless steel Conforms to the stainless steel corrosion specification as per ASTM test methods C692 and C871 < 10mg/kg (ph-value neutral to slightly alkaline)										EN 13468 ASTM C795 ASTM C871
Water absorption	Water absorption < 1 kg/m² Water vapour absorption (vapor sorption) ± 0.02 %vol										EN 1609 ASTM C1104/C1104M
Nominal density	100 kg/m³ (6.24 lb/ft³)										
Water vapour resistance factor	μ = 1.0										EN 12086
Compliance	Rockwool (RW) wire mesh blankets for thermal insulation of large diameter pipes, flat walls and equipment Standard specification for mineral fibre blanket insulation, type I and II										CINI 2.2.02 ASTM C592-06

4. Products

Rockwool Duraflex

Load bearing insulation mat

Thickness mm	Length mm	Width mm	Packaging m ² /duo roll	m ² per 40ft HC container*
30	8000	500	8.0	2336
40	6000	500	6.0	1752
50	5000	500	5.0	1400
60	4500	500	4.5	1170
70	4000	500	4.0	1000
80	3500	500	3.5	875
90	3000	500	3.0	780
100	3000	500	3.0	700

Applications

Rockwool Duraflex is a stone wool insulation mat bonded onto fibreglass reinforced aluminium foil. The insulation mat is suitable for the thermal and acoustic insulation of especially vessels, ducts, and equipment up to intermediate temperatures.

Advantages

- Excellent thermal and acoustic insulation
- Easy to handle and install
- No support construction needed



Product properties Rockwool Duraflex

	Performance					Standard
Thermal conductivity	t° (°C)	50	100	150	200	EN 12667 ASTM C177
	λ (W/mK)	0.043	0.053	0.064	0.077	
	t° (°F)	100	200	300	400	
	λ (BTU.in/ft ² .h.°F)	0.280	0.339	0.415	0.508	
Maximum Service Temperature	300°C (572 °F). Outer foil temperature limited to 80 °C					EN 17706 ASTM C411
Reaction to fire	A2 Surface burning characteristics: Flame spread=passed, Smoke development=passed					EN 13501-1 ASTM E84 (UL 723)
Water absorption	Water absorption < 1 kg/m ² Water vapour absorption (vapor sorption) ± 0.02 %vol					EN 1609 ASTM C1104
Water leachable chloride content	< 10 mg/kg, AS-quality for use over stainless steel Conforms to the stainless steel corrosion specification as per ASTM test methods C692 and C871					EN 13468 ASTM C795
Compression resistance	> 10 kPa at 10 % deformation					EN 826
Nominal density	60 kg/m ³ (3.75 lb/ft ³)					
Water vapour resistance aluminium foil	S _d ≥ 100m					EN 12086
Compliance	Rockwool Lamella Mats for the thermal insulation of air ducts, pipe bundles and equipment					CINI 2.2.05

4. Products

Rockwool Flexiboard

Thickness in mm	Length in mm	Width in mm	Packaging m ² / pack	m ² per 40ft HC container*
25	1000	600	14.4	2419
30	1000	600	12.0	2016
40	1000	600	9.0	1512
50	1000	600	7.2	1210
60	1000	600	6.0	1008
70	1000	600	3.6	907
75	1000	600	4.8	806
80	1000	600	3.6	756
100	1000	600	3.6	605

Available on request with a one-sided facing of fibreglass reinforced aluminium foil (Alu) or glass tissue

Applications

Rockwool Flexiboard is a strong but flexible stone wool board for the thermal and acoustic insulation of horizontal and vertical walls or acoustic panels.

Advantages

- Excellent thermal and acoustic insulation
- Flexible application



Product properties Rockwool Flexiboard

	Performance				Standard
Thermal conductivity	t_m (°C)	50	100	150	EN 12667 ASTM C177
	λ (W/mK)	0.041	0.054	0.066	
	t_m (°F)	100	200	300	
	λ (BTU.in/ft ² .h.°F)	0.273	0.355	0.466	
Maximum Service Temperature	300 °C (572 °F) 450 °C (662 °F)				EN 14706 ASTM C411
Reaction to fire	A1 Surface burning characteristics: Flame spread=passed, Smoke development=passed				EN 13501-1 ASTM E84 (UL 723)
Water absorption	Water absorption < 1 kg/m ² Water vapour absorption (vapor sorption) ± 0.02 %vol				EN 1609 ASTM C1104/C1104M
Water leachable chloride content	Conforms to the stainless steel corrosion specification as per ASTM test methods C692 and C871				ASTM C795
Nominal density	40 kg/m ³ (2.5 lb/ft ³)				
Water vapour resistance factor	$\mu = 1.0$				EN 12086
Compliance	Rockwool (RW) slabs for thermal insulation of equipment Standard specification for mineral fibre block and board thermal insulation, type IA				CINI 2.2.01 ASTM C612-04

4. Products

Rockwool Multiboard

Thickness in mm	Length in mm	Width in mm	Packaging m ² / pack	m ² per 40ft HC container*
40	1000	600	6.0	1620
50	1000	600	4.8	1210
60	1000	600	4.8	1008
70	1000	600	3.6	907
75	1000	600	3.6	756
80	1000	600	3.6	756
90	1000	600	3.0	630
100	1000	600	2.4	648

Available on request with a one-sided facing of fibreglass reinforced aluminium foil (Alu) or glass tissue

Applications

Rockwool Multiboard is a strong and rigid board for the thermal and acoustic insulation of horizontal and vertical walls where a stable insulation product is required. For example, tank walls or acoustic panels.

Advantages

- Excellent thermal and acoustic insulation
- Rigid product combined with aluminium foil or fibreglass coating provides a smart, smooth surface finish



Product properties Rockwool Multiboard

	Performance				Standard
Thermal conductivity	t_m (°C)	50	100	150	EN 12667, ASTM C177
	λ (W/mK)	0.039	0.048	0.058	
	t_m (°F)	100	200	300	
	λ (BTU.in/ft ² .h.°F)	0.268	0.317	0.396	
Maximum Service Temperature	350 °C (662 °F) 450 °C (842 °F)				EN 14706 ASTM C411
Reaction to fire	A1 Surface burning characteristics: Flame spread=passed, Smoke development=passed				EN 13501-1 ASTM E84 (UL 723)
Water absorption	Water absorption < 1 kg/m ² Water vapour absorption (vapor sorption) ± 0.02 %vol				EN 1609 ASTM C1104/C1104M
Water leachable chloride content	Conforms to the stainless steel corrosion specification as per ASTM test methods C692 and C871				ASTM C795
Nominal density	55 kg/m ³ (3.44 lb/ft ³)				
Water vapour resistance factor	$\mu = 1.0$				EN 12086
Compliance	Rockwool (RW) slabs for thermal insulation of equipment Standard specification for mineral fibre block and board thermal insulation, type IA and IB				CINI 2.2.01 ASTM C612-04

4. Products

Rockwool HT600

High temperature board

Thickness in mm	Length in mm	Width in mm	Packaging m ² /pack	m ² per 40ft HC container*
25	1000	600	9.6	2592
30	1000	600	6.0	2016
40	1000	600	6.0	1620
50	1000	600	4.8	1296
60	1000	600	3.0	1008
80	1000	600	3.0	810
100	1000	600	2.4	648
120	1000	600	1.8	529

Applications

Rockwool HT600 is a strong, rigid board, specially developed for the thermal and acoustic insulation of boilers, columns and high-temperature (exhaust) ducts.

Advantages

- Excellent thermal and acoustic insulation
- Suitable for high temperature applications
- Retains shape
- Long lasting
- Rapid return on investment



Product properties Rockwool HT600

	Performance							Standard
Thermal conductivity	t_m (°C)	50	100	150	200	250	300	EN 12667, ASTM C177
	λ (W/mK)	0.038	0.044	0.052	0.062	0.074	0.088	
	t_m (°F)	100	200	300	400	500	600	
	λ (BTU.in/ft ² .h.°F)	0.260	0.297	0.355	0.433	0.534	0.657	
Maximum Service Temperature	600 °C (1112 °F) 750 °C (1382 °F)							EN 14706 ASTM C411
Reaction to fire	A1 Surface burning characteristics: Flame spread=passed, Smoke development=passed							EN 13501-1 ASTM E84 (UL 723)
Water absorption	Water absorption < 1 kg/m ² Water vapour absorption (vapor sorption) ± 0.02 %vol							EN 1609 ASTM C1104/C1104M
Water leachable chloride content	Conforms to the stainless steel corrosion specification as per ASTM test methods C692 and C871							ASTM C795
Nominal density	80 kg/m ³ (5 lb/ft ³)							
Water vapour resistance factor	$\mu = 1.0$							EN 12086
Compliance	Rockwool (RW) slabs for thermal insulation of equipment Standard specification for mineral fibre block and board thermal insulation, type IA, IB, II, III, IVA, IVB							CINI 2.2.01 ASTM C612-04

4. Products

Rockwool HT660

High temperature board

Thickness in mm	Length in mm	Width in mm	Packaging m ² / pack	m ² / per 40ft HC container*
30	1000	600	6.0	2016
40	1000	600	4.8	1613
50	1000	600	3.6	1210
60	1000	600	3.0	1008
80	1000	600	1.8	832

Applications

Rockwool HT660 is a strong, rigid board for the thermal and acoustic insulation of constructions where higher temperatures and light mechanical loads (e.g. vibrations) occur.

Advantages

- Excellent thermal and acoustic insulation
- Suitable for high temperature applications
- Retains shape
- Long lasting
- Rapid return on investment



Product properties Rockwool HT660

	Performance							Standard
Thermal conductivity	t_m (°C)	50	100	150	200	250	300	EN 12667 ASTM C177
	λ (W/mK)	0.038	0.043	0.049	0.058	0.067	0.078	
	t_m (°F)	100	200	300	400	500	600	
	λ (BTU.in/ft ² .h.°F)	0.259	0.291	0.340	0.402	0.481	0.576	
Maximum Service Temperature	660 °C (1220 °F) 750 °C (1382 °F)							EN 14706 ASTM C411
Reaction to fire	A1 Surface burning characteristics: Flame spread=passed, Smoke development=passed							EN 13501-1 ASTM E84 (UL 723)
Water absorption	Water absorption < 1 kg/m ² Water vapour absorption (vapor sorption) \pm 0.02 %vol							EN 1609 ASTM C1104/C1104M
Water leachable chloride content	Conforms to the stainless steel corrosion specification as per ASTM test methods C692 and C871							ASTM C795
Compression resistance	15 kPa at 10 % deformation							EN 826
Nominal density	115 kg/m ³ (7.18 lb/ft ³)							
Water vapour resistance factor	$\mu = 1.0$							EN 12086
Compliance	Rockwool (RW) slabs for thermal insulation of equipment Standard specification for mineral fibre block and board thermal insulation, type IA, IB, II, III, IVA, IVB							CINI 2.2.01 ASTM C612-06

4. Products

Rockwool HT700

High temperature board

Thickness in mm	Length in mm	Width in mm	Packaging m ² / pack	m ² / per 40ft HC container*
30	1000	600	6.0	2016
40	1000	600	4.8	1613
50	1000	600	3.6	1210
60	1000	600	3.0	1008
80	1000	600	1.8	832

Applications

Rockwool HT700 is a strong, rigid board for the thermal and acoustic insulation of constructions where higher temperatures and/or mechanical loads (e.g. vibrations) occur.

Advantages

- Excellent thermal and acoustic insulation
- Suitable for high temperature applications
- Retains shape
- Long lasting
- Rapid return on investment



Product properties Rockwool HT700

	Performance								Standard
Thermal conductivity	t_m (°C)	50	100	150	200	250	300	350	EN 12667, ASTM C177
	λ (W/mK)	0.039	0.044	0.050	0.057	0.065	0.075	0.087	
	t_m (°F)	100	200	300	400	500	600	700	
	λ (BTU.in/ft ² .h.°F)	0.267	0.298	0.342	0.398	0.467	0.548	0.641	
Maximum Service Temperature	700 °C (1292 °F) 750 °C (1382 °F)								EN 14706 ASTM C411
Reaction to fire	A1 Surface burning characteristics: Flame spread=passed, Smoke development=passed								EN 13501-1 ASTM E84 (UL 723)
Water absorption	Water absorption < 1 kg/m ² Water vapour absorption (vapor sorption) \pm 0.02 %vol								EN 1609 ASTM C1104/C1104M
Water leachable chloride content	Conforms to the stainless steel corrosion specification as per ASTM test methods C692 and C871								ASTM C795
Compression resistance	40 kPa at 10 % deformation								EN 826
Nominal density	145 kg/m ³ (9.05 lb/ft ³)								
Water vapour resistance factor	$\mu = 1.0$								EN 12086
Compliance	Rockwool (RW) slabs for thermal insulation of equipment Standard specification for mineral fibre block and board thermal insulation, type IA, IB, II, III, IVA, IVB								CINI 2.2.01 ASTM C612-04

4. Products

Rockwool CRS

Compression resistant slab

Thickness mm	Length mm	Width mm	Packaging m ² /pack	m ² per 40ft HC container*
40	1000	600	3.0	1638
50	1000	600	2.4	1310
60	1000	600	2.4	1109
80	1000	600	1.8	832
100	1000	600	1.2	655

Applications

Rockwool Compression Resistant Slab (CRS) is a rigid, pressure-resistant stone wool insulation slab with high resistance to mechanical loads (e.g. foot traffic). The Compression Resistant Slab is developed for the thermal insulation of tank roofs subject to pedestrian traffic, and the thermal/acoustic insulation of constructions subject to mechanical load.

Advantages

- Excellent thermal and acoustic insulation
- Resistant to foot traffic
- Resistant to mechanical loads



Product properties Rockwool CRS

	Performance				Standard
Thermal conductivity	t_m (°C)	50	100	150	EN 12667, ASTM C177
	λ (W/mK)	0.040	0.043	0.049	
	t_m (°F)	100	200	300	
	λ (BTU.in/ft ² .h.°F)	0.270	0.302	0.345	
Maximum Service Temperature	250 °C (482 °F)				EN 14706, ASTM C411
Reaction to fire	A1 Surface burning characteristics: Flame spread=passed, Smoke development=passed				EN 13501-1 ASTM E84 (UL 723)
Water absorption	Water absorption < 1 kg/m ² Water vapour absorption (vapor sorption) ± 0.02 %vol				EN 1609 ASTM C1104/C1104M
Water leachable chloride content	Conforms to the stainless steel corrosion specification as per ASTM test methods C692 and C871				ASTM C795
Compression resistance	60 kPa at 10 % deformation				EN 826
Nominal density	150 kg/m ³ (9.05 lb/ft ³)				
Water vapour resistance factor	$\mu = 1.0$				EN 12086
Compliance	Rockwool (RW) slabs for thermal insulation of equipment Standard specification for mineral fibre block and board thermal insulation, type IA, IB and II				CINI 2.2.01 ASTM C612-04

4. Products

Rockwool 251

Industrial slab

Thickness in mm	Length in mm	Width in mm	Packaging m ² / pack	m ² / per 40ft HC container*
40	1000	600	2.4	1613
50	1000	600	1.8	1285
60	1000	600	1.8	1058
80	1000	600	1.2	806
100	1000	600	1.2	655

Applications

Rockwool 251 is a highly pressure resistant stone wool slab for the thermal and acoustic insulation of constructions where high temperatures and mechanical loads (e.g. vibrations) occur.

Advantages

- Excellent thermal and acoustic insulation
- Resistant to high temperatures
- Resistant to mechanical loads



Product properties Rockwool 251

	Performance							Standard
Thermal conductivity	t_m (°C)	50	100	150	200	250	300	EN 12667, ASTM C177
	λ (W/mK)	0.041	0.045	0.051	0.058	0.066	0.075	
	t_m (°F)	100	200	300	400	500	600	
	λ (BTU.in/ft ² .h.°F)	0.276	0.309	0.353	0.405	0.468	0.541	
Maximum Service Temperature	700°C (1292 °F) 750°C (1382 °F)							EN 14706 ASTM C411
Reaction to fire	A1 Surface burning characteristics: Flame spread=passed, Smoke development=passed							EN 13501-1 ASTM E84 (UL 723)
Water absorption	Water absorption < 1 kg/m ² Water vapour absorption (vapor sorption) ± 0.02 %vol							EN 1609 ASTM C1104/C1104M
Water leachable chloride content	Conforms to the stainless steel corrosion specification as per ASTM test methods C692 and C871							ASTM C795
Compression resistance	50 kPa at 10 % deformation							EN 826
Nominal density	175 kg/m ³ (10.94 lb/ft ³)							
Water vapour resistance factor	$\mu = 1.0$							EN 12086
Compliance	Rockwool (RW) slabs for thermal insulation of equipment Standard specification for mineral fibre block and board thermal insulation, type IA, IB, II, III, IVA							CINI 2.2.01 ASTM C612-04

4. Products

Rockwool Rocktight

Rocktight: the watertight insulation system

Achieving the best insulation system for your application is not easy. Besides the right choice and implementation of the insulation, the insulation protection system also plays an important role. Specific uses call for specific solutions. Certain processes require a fully watertight and closed finish. Strong and easy to clean, with great durability and chemical resistance. An insulation protection that results in a high amount of operational safety, low maintenance costs and limited energy costs. Rockwool Technical Insulation, together with FiberTec Europe, has therefore developed an innovative protection system for Rockwool insulation: Rocktight.

Rocktight: for a durable insulation protection

Rockwool Rocktight is a fiberglass reinforced polyester mat positioned between two sheets of film. The material contains resins, fiberglass and special fillers and is ready to use. Unprocessed it is soft and malleable. In this state, Rocktight can be cut or trimmed into any shape which makes it easy to apply to the insulation. The polyester subsequently cures under the influence of ultraviolet (UV) light. After curing, Rocktight is absolutely watertight and is able to give optimal mechanical protection.

The advantages

The Rocktight system has important advantages that enhances the quality of your work.

- **Great durability:** Rocktight forms a seamless connection that offers a watertight protection to the Rockwool insulation. It minimizes the damaging effects of the weather (wind, rain, seawater, etc.)

or general wear and tear. It is chemically resistant and withstands mechanical stresses (i.e. can be walked upon).

- **Easy to clean:** Rocktight can withstand spray-cleaning. Cleaning with water is possible without damaging the insulation.
- **Low start-up costs:** processing and installation takes place on location. This makes investments for the pre-fabrication of the insulation protection unnecessary.
- **Flexible use:** cold and hot insulation, underground and above ground cables and pipes, on and offshore. Rocktight molds itself to every technical application.



Multi use

Rocktight is used in various sectors where it continuously satisfies the highest standards.

Food & Pharmaceutical: hygiene and cleaning

The food industry and the pharmaceutical sector also adhere to very rigorous standards and rules as far as insulation is concerned. Those strict rules and regulations must prevent dirt, bacteria or moisture from accumulating in the (damaged) insulation.

- Rocktight is the **ideal solution** for making insulation around pipes, cables, storage tanks, installations, etc. **sealed, watertight and damage resistant.**
- In addition, Rocktight can **withstand spray-cleaning.** The insulation material can be cleaned with water without causing any damage.
- Thanks to the low permeability of Rocktight as well as the thermal resistance of Rockwool insulation, a **durable insulation of dual temperature systems** is possible.

Tank roof insulation: durable & money-saving

Conventional systems for tank roof insulation are often sensitive to damage from the weather (water, wind, etc.) and the effect of chemicals. The costs of maintenance and the consequent lowered operational safety resulting from this are often higher than the (energy) cost-savings that are realized by the insulation. For this reason many tank roofs, especially in the lower temperature ranges, are not insulated.

- Rocktight is applied directly on Rockwool tank roof insulation **on site.** Since direct cladding supports are no longer needed, it fits to all parts of the tank **seamlessly** and has an **unequalled hardness and mechanical strength** (e.g. can be walked upon).
- Where there are **high wind stresses**, a special cable construction can be applied that will keep the insulation in its place under the most extreme weather conditions.
- An **anti-slip coating** is available that can easily be installed to Rocktight.
- The absence of cladding supports virtually **eliminates any risk of corrosion under insulation.**
- This ensures **perfect protection** to the insulation and storage tank which guarantees the **durability** of the insulation.

Technical information

Definition

Rockwool Rocktight is a fiberglass-reinforced 1-component polyester (GRP) that in un-processed state is soft and malleable. The material contains resins, fiberglass and special fillers and is ready to use. Rockwool Rocktight can be cut or trimmed into any shape which makes it easy to apply to the insulation.

The material cures under the influence of ultraviolet light. Once cured, Rockwool Rocktight has an extremely high level of hardness and mechanical strength compared to conventional polyester. In addition, Rocktight is impermeable and resistant to a large number of chemicals. The fire properties are unique in its class.

4. Products

Ancillaries

Rockwool Rocktight HMO is used for the most common applications. Besides special versions (e.g. higher chemical resistance), related products, such as UV-curing Rocktight Primer and Gel, UV-lamps and safety-goggles are available upon request.

Curing

The curing will depend upon the ambient temperature and the intensity of the UV-light. Under the influence of sunlight or 400 W UV-lamps, placed at a distance of 0.5 meters, Rockwool Rocktight cures in 30 minutes (T 20 °C / RV 50 %).

Packaging and storage

Rockwool Rocktight is supplied in rolls of 10 m in length and 1 m in width, packed in boxes. Each roll (including packaging) weighs approx. 30 kg. The storage life is 6 months (after date of delivery). The contents measure 9.5 m² per roll. Always store Rockwool Rocktight in the original packaging in an ambient temperature of a maximum of 25 °C. Avoid direct contact with sunlight during use.

Product properties


Rockwool Rocktight	Performances	Norm
Color	grey	
Handling temperature	min. 5°C - max. 45°C	
Application temperature (cured)	min. -50°C - max. 90°C	
Thickness (after curing)	1,5 mm - 2,0 mm	
Styrene emission (non-cured)	< 20 ppm (MAC-value 25 ppm), safety sheet available upon request	
Flashpoint (non-cured)	125°C	
Fire class	B1 Flame spread index = 0 Low flame spread characteristics	DIN 4102 ASTM E 84 IMO A.653
Specific gravity	±1800 kg/m ³	DIN 53479
Compressive strength	150 N/mm ²	DIN 53454
Fiber content	20% w/w	DIN 53479
Linear expansion coefficient	30 * 10 ⁻⁶ K ⁻¹	DIN 53452
Impact resistance	57,5 kJ/m ²	DIN 53453
Bending strength	146 N/mm ²	DIN 53452
Tensile strength	55,7 N/mm ²	DIN 53455
Stretch at breaking point	1,1%	DIN 53455
Permeability	0,34 mg/100u	DIN 53495
Hardness	60 Barcol	
Chemical resistance	Available upon request	
Rocktight conforms to CINI 3.2.11 'Weather resistant UV-curing fiberglass reinforced polyester (GRP)'. (Small divergences from the declared values are not fully precluded.)		

Rockwool Loose Fill

Product	Packaging	kg/packaging	kg per 40 ft HC Container
Rockwool Loose Fill (Rolls)	Bag	15	5250

Applications

Rockwool Loose Fill is lightly bonded impregnated stone wool. This product is especially suitable for thermal insulation and acoustic insulation of joints and irregularly formed constructions.

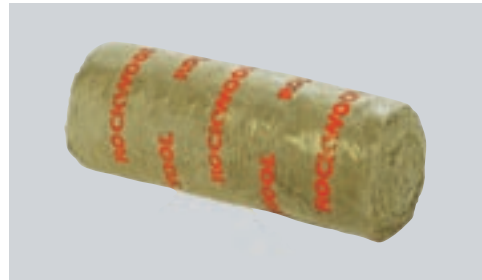

Advantages

- Excellent thermal and acoustic insulation
- Flexible application

Product properties

	Performance							Standard
	t_m (°C)	50	100	150	200	250	300	
Thermal conductivity (stuffing density 100 kg/m ³)	λ (W/mK)	0.040	0.049	0.057	0.067	0.075	0.091	EN 12667, ASTM C177
	t_m (°F)	100	200	300	400	500	600	
	λ (BTU.in/ft ² .h.°F)	0.276	0.338	0.393	0.462	0.517	0.628	
Maximum Service Temperature	680 °C (1256 °F) 750 °C (1382 °F)							EN 14706 ASTM C411
Reaction to fire	A1 Surface burning characteristics: Flame spread=passed, Smoke development=passed							EN 13501-1 ASTM E84 (UL 723)
Water leachable chloride content	< 10 mg/kg, AS-quality for use over stainless steel Conforms to the stainless steel corrosion specification as per ASTM test methods C692 and C871 <10 mg/kg (ph-value neutral to slightly alkaline)							EN 13468 ASTM C795 ASTM C871
Water absorption	Water absorption < 1 kg/m ² Water vapour absorption (vapor sorption) \pm 0.02 %vol							EN 1609 ASTM C1104/C1104M
Compliance	Loose Rockwool for the thermal insulation of valve boxes and the specification stuffing of insulation mattresses							CINI 2.2.04

4. Products

Rockwool Granulate

Product	Packaging	kg/package	kg per 40 ft HC Container
Rockwool Loose	Bag	20	12000

Applications

Rockwool Granulate is a stone wool granulate with no additives. The granulate is especially suitable for the thermal insulation of cold boxes and air separation plants.

Advantages

- Non-combustible
- Chemically inert
- Easy to remove for inspection purposes
- Long lasting
- Short return on investment



Product properties

	Performance							Standard
	t _m (°C)	20	-20	-60	-100	-140	-180	
Thermal conductivity (Stuffing density 100-200 kg/m ³)	λ (W/mK)	0.039	0.033	0.027	0.022	0.018	0.015	EN 12667, ASTM C177
	t _m (°F)	50	0	-50	-150	-250	-300	
	λ (BTU.in/ft ² .h.°F)	0.260	0.229	0.201	0.153	0.115	0.101	
Reaction to fire	A1 Surface burning characteristics: Flame spread=passed, Smoke development=passed							EN 13501-1 ASTM E84 (UL 723)
Water leachable chloride content	< 10 mg/kg, AS-quality for use over stainless steel Conforms to the stainless steel corrosion specification as per ASTM test methods C692 and C871 <10 mg/kg (ph-value neutral to slightly alkaline)							EN 13468 ASTM C795 ASTM C871

Rockwool Granulate complies with AGI Q 118 “insulation work for refrigeration on industrial installations; air separations plants”

Contents

1	System solutions	5
	1.1 Planning and preparation	7
	1.2 Insulation of piping	19
	1.3 Insulation of vessels	46
	1.4 Insulation of columns	52
	1.5 Insulation of storage tanks	58
	1.6 Insulation of boilers	68
	1.7 Insulation of flue gas ducts	77
	1.8 Cold boxes	85
2	Theory	89
	2.1 Norms & standards	90
	2.2 Product properties & test methods	110
	2.3 Bases for thermal calculations	122
3	Tables	129
	3.1 Units, conversion factors and tables	130
	3.2 Product properties insulation and cladding materials	142
	3.3 Usage tables	145
4	Products	163
	Rockwool 850	165
	Rockwool 851	166
	ProRox WM 70	168
	ProRox WM 80	170
	ProRox WM 100	172
	Rockwool Duraflex	174
	Rockwool Flexiboard	176
	Rockwool Multiboard	178
	Rockwool HT600	180
	Rockwool HT660	182
	Rockwool HT700	184
	Rockwool CRS	186
	Rockwool 251	188
	Rockwool Rocktight	190
	Rockwool Loose fill	193
	Rockwool Granulate	194

Rockwool Technical Insulation bv

Delfstoffenweg 2
NL-6045 JH Roermond
Tel. +31 (0) 475 35 36 18
Fax +31 (0) 475 35 36 01
www.rockwool-rti.com

for Belgium: +32 (0)2 715 68 20
for Germany: +49 (0) 2043 408 606
for France: +33 (0) 1 40 77 82 11
for Export (Africa, Middle East, India):
+31 (0) 475 35 38 35

for Poland: +48 601 848 482
for Czech Republic: +420 606 702 056
for Slovakia: +421 903 235 027
for Baltics: +370 69 94 33 92
for Switzerland: +41 81 734 11 11

RTI, excellence in firesafe solutions

Rockwool Technical Insulation (RTI), a division of the international Rockwool Group, is the world wide market leader in technical insulation. Our experts offer you a complete range of techniques and systems for the firesafe insulation of technical installations. In all segments of HVAC, process industry, ship building and passive fire protection, RTI stands for a total approach. From quality products to reliable expert advice, from documentation to delivery and after sales service. Throughout the whole chain from specifier, through dealer to contractor and installer we aim to add value. We don't just sell products, we supply solutions. It's this total approach that makes RTI the ideal choice for professionalism, innovation and trust.

All explanations correspond to our current range of knowledge and are therefore up-to-date. The examples of use outlined in this process manual serve only to provide a better description and do not take special circumstances of specific cases into account. Rockwool Technical Insulation places great value upon continuous development of products, to the extent that we too continuously work to improve our products without prior notice. We therefore recommend that you use the most recent edition of our publications, as our wealth of experience and knowledge is always growing. Should you require related information for your specific application or have any technical queries, please contact our sales department or visit our website rockwool-rti.com.

Rockwool is a registered trademark of Rockwool International. Rockwool Technical Insulation reserves the right to change the information in this brochure without prior notice.



EXCELLENCE
IN FIRESAFE SOLUTIONS